




A. Site Energy Production Summary

	Energy Production (kWh)				
	Site		By Turbine		
	Expected Production	Actual YTD	WTG A	WTG B	WTG C
Mar-16	1,242,761	1,496,180	519,070	479,870	497,240
Apr-16	1,447,248	1,455,700	502,520	466,720	486,460
May-16	1,010,966	1,082,840	378,340	343,790	360,710
Jun-16	668,411	845,300	282,600	284,650	278,050
Jul-16	638,097	527,650	167,110	181,730	178,810
Aug-16	577,992	623,970	212,730	207,380	203,860
Sep-16	631,697	779,920	270,220	251,650	258,050
Oct-16	1,003,602	1,090,010	414,286	397,098	278,626
Nov-16	1,395,914	1,417,200	491,080	464,290	461,830
Dec-16	1,278,858	1,765,070	595,620	592,130	577,320
Jan-17	1,332,437	1,587,840	547,800	521,640	518,400
Feb-17	1,157,019	1,601,650	550,370	513,360	537,920
Mar-17	1,242,761	1,682,140	564,140	545,320	572,680
2017 Annual	12,384,999	4,871,630	1,662,310	1,580,320	1,629,000
Rolling 12 month Capacity Factor:					36.68%

B. Site Energy Production Graph

March-2017

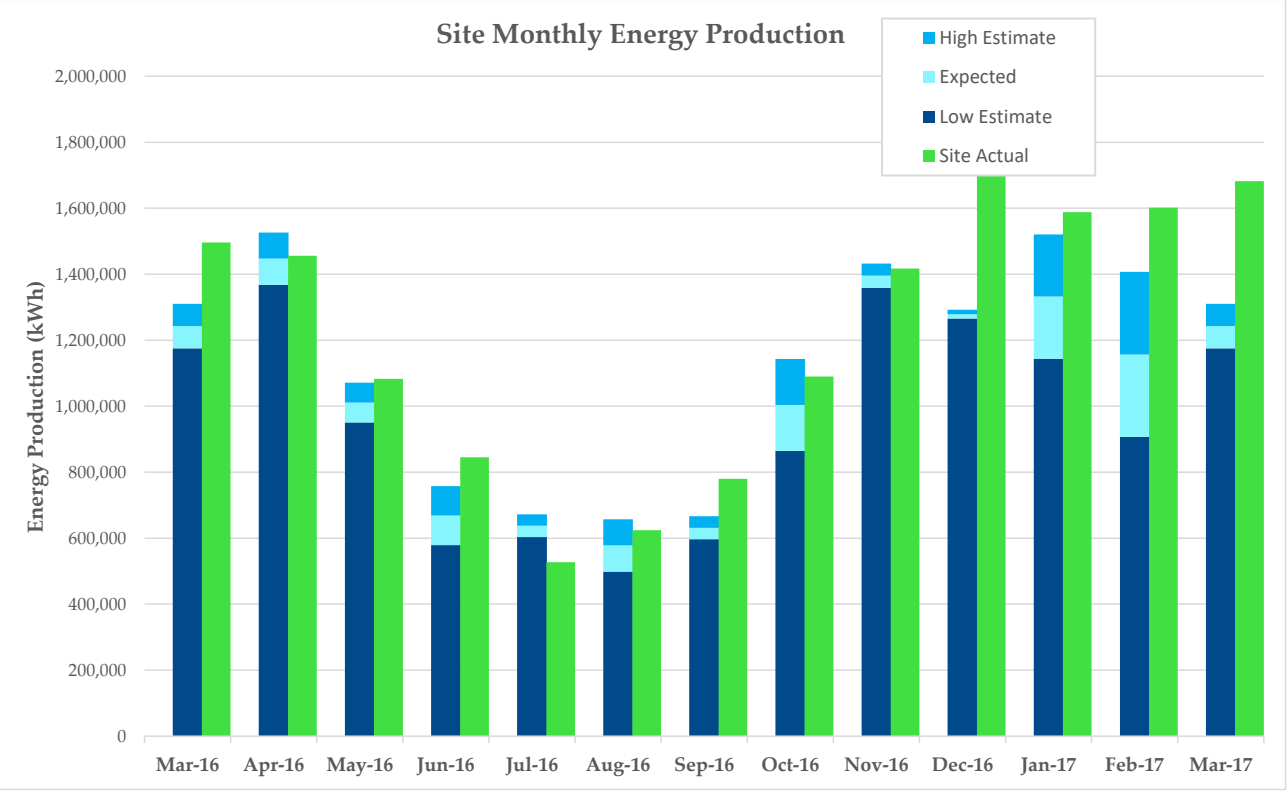

Monthly Report
March-2017



C. Safety Summary

	This Month	Project Cumulative
Recordable Incident(s):	0	0
Near Miss(es):	0	0

D. Planned Maintenance Events

Date	Event	Duration (hrs)	Turbine
May-2017	Goldwind 5 year maintenance	~8	WTG A
May-2017	Goldwind 5 year maintenance	~8	WTG B
May-2017	Goldwind 5 year maintenance	~8	WTG C

E. Actual Maintenance Events - March 2017

Date	Event	Planned/Unplanned	Duration (hrs)	Turbine
3/8/2017	High Wind Event	Unplanned	7.28	WTG A, B, C
3/12-3/13/2017	Provitbus Error (Sunday Exclusion)	Unplanned	25.10	WTG A

F. Turbine Availability & Downtime

Availability (%)	This Month	2017 Annual
WTG A	98.53%	99.49%
WTG B	100.00%	99.45%
WTG C	100.00%	99.67%
Avg		99.54%

Downtime (hrs)	This Month	2017 Annual
WTG A	42.50	54.23
WTG B	10.92	27.36
WTG C	11.69	16.30
Total	65.11	97.89

G. Wind Speed & Capacity Factor

Wind Speed (mph)	This Month	2017 Annual
WTG A	15.24	14.98
WTG B	14.82	14.64
WTG C	15.71	15.36
Estimated	14.92	13.39

Capacity Factor (%)	This Month	2017 Annual
WTG A	50.55%	51.31%
WTG B	48.86%	48.78%
WTG C	51.32%	50.28%
Low Estimate	35.10%	50.12%

H. Report Notes and Comments