




A. Site Energy Production Summary

	Energy Production (kWh)				
	Site		By Turbine		
	Expected Production	Actual YTD	WTG A	WTG B	WTG C
May-16	1,010,966	1,082,840	378,340	343,790	360,710
Jun-16	668,411	845,300	282,600	284,650	278,050
Jul-16	638,097	527,650	167,110	181,730	178,810
Aug-16	577,992	623,970	212,730	207,380	203,860
Sep-16	631,697	779,920	270,220	251,650	258,050
Oct-16	1,003,602	1,090,010	414,286	397,098	278,626
Nov-16	1,395,914	1,417,200	491,080	464,290	461,830
Dec-16	1,278,858	1,765,070	595,620	592,130	577,320
Jan-17	1,332,437	1,587,840	547,800	521,640	518,400
Feb-17	1,157,019	1,601,650	550,370	513,360	537,920
Mar-17	1,242,761	1,682,140	564,140	545,320	572,680
Apr-17	1,447,248	1,676,860	570,960	544,340	561,560
May-17	1,010,966	1,309,614	447,560	424,304	437,750
2017 Annual	12,384,999	7,858,104	2,680,830	2,548,964	2,628,310
Rolling 12 month Capacity Factor:					37.82%

B. Site Energy Production Graph

May-2017

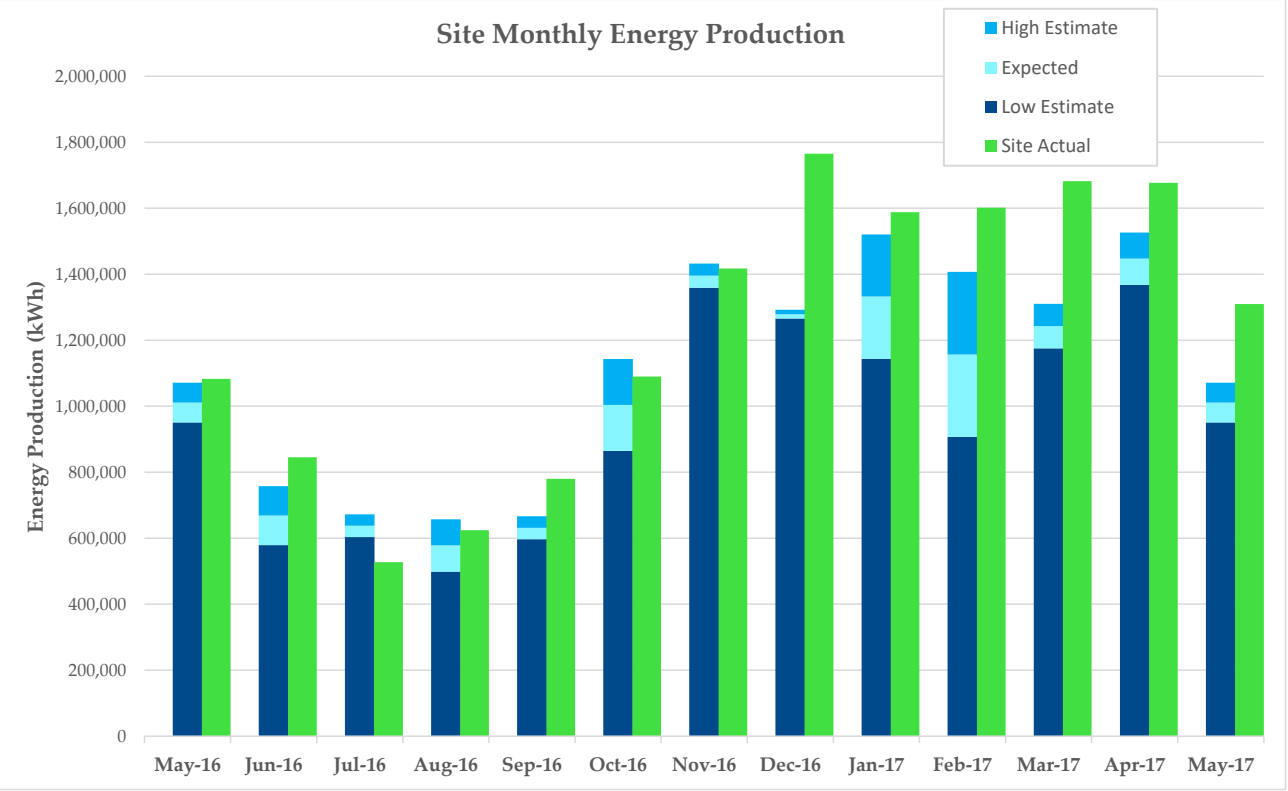

Monthly Report
May-2017



C. Safety Summary

	This Month	Project Cumulative
Recordable Incident(s):	0	0
Near Miss(es):	0	0

D. Planned Maintenance Events

Date	Event	Duration (hrs)	Turbine
June-2017	Goldwind 5 year maintenance	~8	WTG B
June-2017	Goldwind 5 year maintenance	~8	WTG C

E. Actual Maintenance Events - May 2017

Date	Event	Planned/Unplanned	Duration (hrs)	Turbine
5/11/2017	Converter Over Current Investigation	Unplanned	9.74	WTG A
5/18-5/22/2017	Grid Fault - Line Down	Unplanned	79.91	WTG A,B,C
5/23/2017	Goldwind 5 year maintenance	Planned	4.85	WTG A

F. Turbine Availability & Downtime

Availability (%)	This Month	2017 Annual
WTG A	97.86%	99.25%
WTG B	99.74%	99.62%
WTG C	99.36%	99.65%
Avg	98.99%	99.51%

Downtime (hrs)	This Month	2017 Annual
WTG A	102.12	159.11
WTG B	82.36	111.39
WTG C	94.58	113.89
Total	279.06	384.39

G. Wind Speed & Capacity Factor

Wind Speed (mph)	This Month	2017 Annual
WTG A	14.60	15.00
WTG B	14.12	14.65
WTG C	14.87	15.41
Estimated	13.57	13.39

Capacity Factor (%)	This Month	2017 Annual
WTG A	44.40%	50.32%
WTG B	42.09%	47.84%
WTG C	43.43%	49.33%
Low Estimate	28.39%	49.16%

H. Report Notes and Comments

*Goldwind 5 year maintenance for WTG B and C moved to June 2017.