



BALL CORPORATION - ZEPHYR WIND PROJECT


North Findlay Wind Campus, Findlay, OH

A. Site Energy Production Summary

	Energy Production (kWh)				
	Site		By Turbine		
	P50 (Expected Production)	Actual Production	Z1	Z2	Z3
Oct-16	992,000	931,925	303,980	309,926	318,019
Nov-16	1,295,000	1,209,020	415,317	397,636	396,067
Dec-16	1,565,000	1,428,145	509,779	450,115	468,251
Jan-17	1,325,000	1,304,579	450,536	420,186	433,857
Feb-17	1,391,000	1,372,648	473,614	443,979	455,055
Mar-17	1,229,000	1,339,090	447,685	437,432	453,973
Apr-17	1,453,000	1,263,804	425,766	415,442	422,596
May-17	924,000	1,123,269	395,614	347,574	380,081
Jun-17	645,000	952,539	334,400	300,615	317,524
Jul-17	586,000	453,808	163,793	151,302	138,713
Aug-17	614,000	448,585	157,969	145,785	144,831
Sep-17	529,000	440,963	153,200	143,235	144,528
Oct-17	992,000	1,058,436	362,133	353,715	342,588
Production 2017 (ytd) (kWh)	9,688,000	9,757,721	3,364,710	3,159,265	3,233,746
Total Production (kWh)*	12,548,000	12,394,886	4,289,806	4,007,016	4,098,064
Capacity Factor*	31.44%		*Value calculated over the last 12 months		

B. Site Energy Production Graph

October-2017

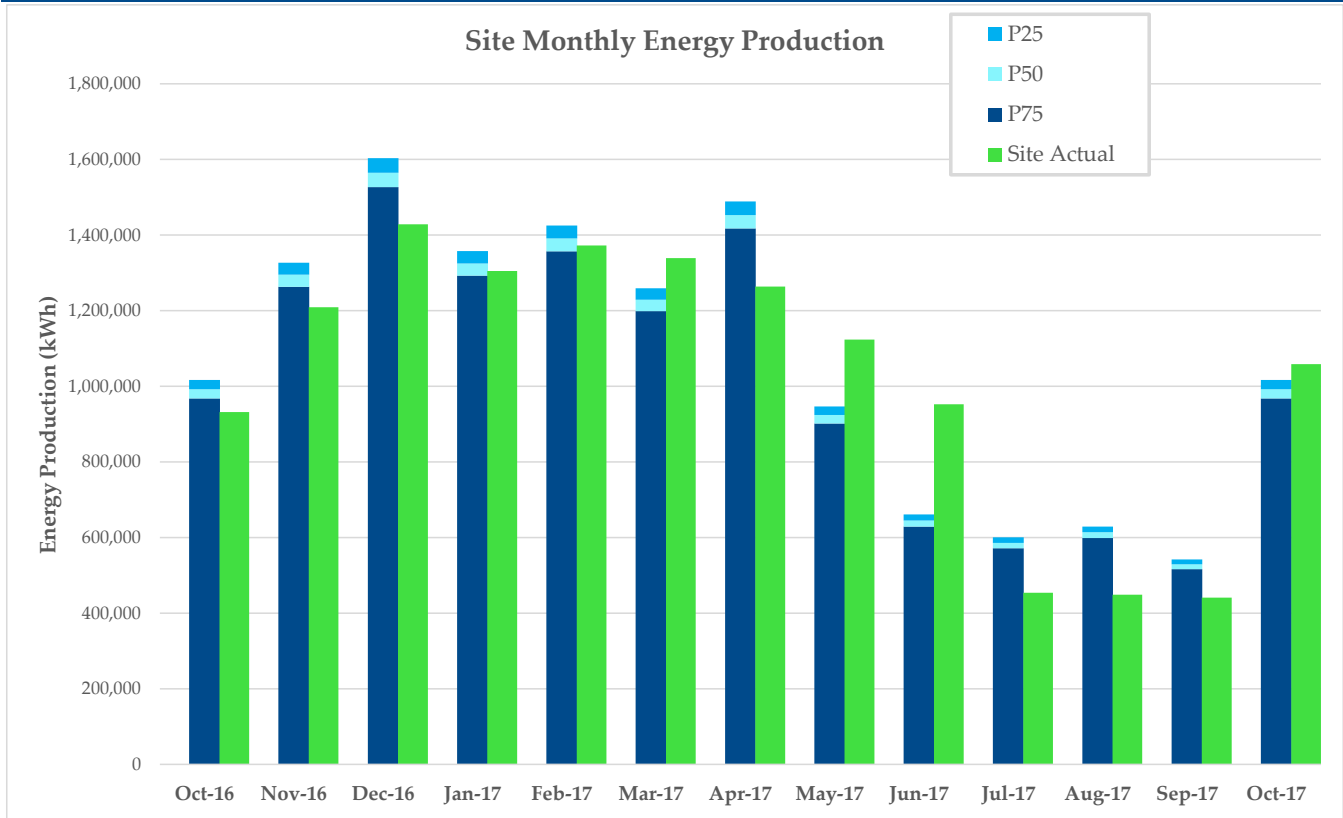

Monthly Report

October-2017



C. Safety Summary

	This Month	Project Cumulative
Recordable Incident(s)	0	0
Near Miss(es)	0	0

D. Planned Maintenance Events**

Date	Event	Duration (hr)	Turbine
November-2017	Goldwind 1.5 Year Maintenance	~15	Z1

E. Actual Maintenance Events

Date	Event	Planned/Unplanned	Duration (hrs)	Turbine
10/3/2017	Goldwind 1.5 Year Maintenance	Planned	4.62	Z3
10/6/2017	Circuit Maintenance	Unplanned	4.32	Z1, Z2, Z3

F. Turbine Availability & Downtime

Availability	This Month	Year To Date
Z1	100.00%	99.28%
Z2	100.00%	98.46%
Z3	100.00%	99.50%
Avg	100.00%	99.08%

Downtime (hr)	This Month	Year To Date
Z1	7.05	244.63
Z2	7.05	335.34
Z3	11.67	244.92
Total	25.77	824.89

G. Billed Data

Meter Reading (Date/Time)	10/16/2017 12:00 AM
Meter To Date Produced	19,513,803 kWh
Meter To Date Consumed	23,934 kWh
Last Reading Produced	18,986,561 kWh
Last Reading Consumed	22,336 kWh
Billed kWh	525,644 kWh
Next Meter Reading	11/16/2017 12:00 AM

H. Report Notes and Comments

**Goldwind 1.5 year maintenance for Z1 moved to November-2017.