




A. Site Energy Production Summary

	Energy Production (kWh)				
	Site		By Turbine		
	Expected Production	Actual Production	WTG A	WTG B	WTG C
Dec-16	1,278,858	1,765,070	595,620	592,130	577,320
Jan-17	1,332,437	1,587,840	547,800	521,640	518,400
Feb-17	1,157,019	1,601,650	550,370	513,360	537,920
Mar-17	1,242,761	1,682,140	564,140	545,320	572,680
Apr-17	1,447,248	1,676,860	570,960	544,340	561,560
May-17	1,010,966	1,309,614	447,560	424,304	437,750
Jun-17	668,411	1,199,560	427,710	365,940	405,910
Jul-17	638,097	608,374	208,860	199,814	199,700
Aug-17	577,992	550,820	193,760	179,770	177,290
Sep-17	631,697	605,096	208,710	201,632	194,754
Oct-17	1,003,602	1,223,590	422,370	411,740	389,480
Nov-17	1,395,914	1,441,140	493,690	470,470	476,980
Dec-17	1,278,858	1,521,630	522,010	495,750	503,870
Production 2017 (ytd) (kWh)	12,384,999	15,008,314	5,157,940	4,874,080	4,976,294
Total Production (kWh)*	12,384,999	15,008,314	5,157,940	4,874,080	4,976,294
Capacity Factor*	38.07%		*Value calculated over the last 12 months		

B. Site Energy Production Graph

December-2017

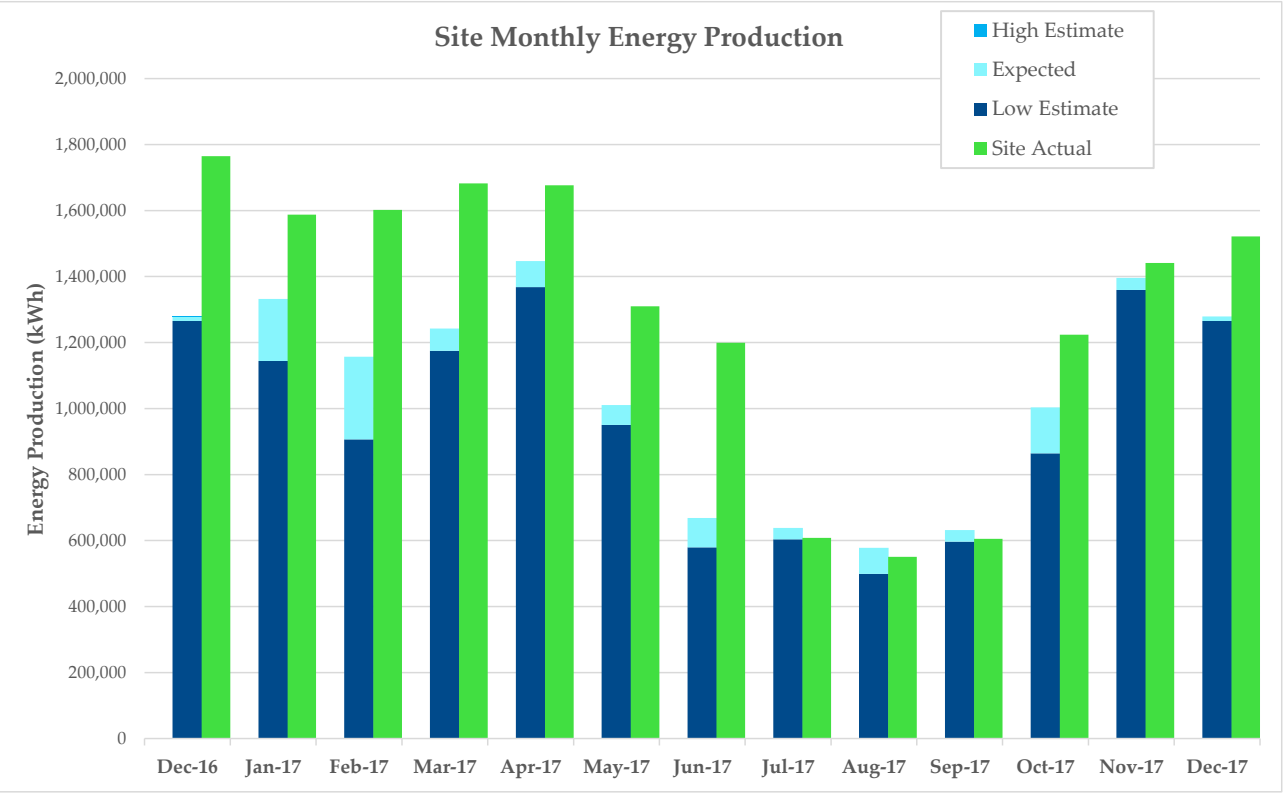

Monthly Report
December-2017



C. Safety Summary

	This Month	Project Cumulative
Recordable Incident(s)	0	0
Near Miss(es)	0	0

D. Planned Maintenance Events*

Date	Event	Duration (hr)	Turbine
January-2018	Goldwind 5.5 Year Maintenance	~8	WTG A
January-2018	Goldwind 5.5 Year Maintenance	~8	WTG B
January-2018	Goldwind 5.5 Year Maintenance	~8	WTG C

E. Actual Maintenance Events - December 2017

Date	Event	Planned/Unplanned	Duration (hr)	Turbine
12/13/2017	Safety Chain Error	Unplanned	5.46	WTG B

F. Turbine Availability & Downtime

Availability (%)	This Month	Year to Date
WTG A	99.86%	99.27%
WTG B	99.27%	99.08%
WTG C	100.00%	99.30%
Avg	99.71%	99.22%

Downtime (hr)	This Month	Year to Date
WTG A	3.19	252.73
WTG B	7.59	263.43
WTG C	2.30	223.46
Total	13.08	739.62

G. Wind Speed & Capacity Factor

Wind Speed (mph)	This Month	2017 Annual
WTG A	13.52	12.97
WTG B	13.52	12.89
WTG C	13.92	13.45
Estimated	14.23	13.39

Capacity Factor (%)	This Month	2017 Annual
WTG A	46.78%	39.58%
WTG B	44.42%	37.40%
WTG C	45.15%	38.19%
Low Estimate	37.80%	38.39%

H. Report Notes and Comments

*Goldwind 5.5 year maintenance moved to January-2018.