


A. Site Energy Production Summary

	Energy Production (kWh)			
	Site		By Turbine	
	P50 (Expected Production)	Actual Production	W1	W2
Dec-16	1,029,000	1,040,001	516,469	523,532
Jan-17	872,000	875,991	434,082	441,909
Feb-17	914,000	919,768	449,933	469,835
Mar-17	808,000	874,319	455,715	418,604
Apr-17	955,000	865,246	435,360	429,886
May-17	607,000	792,979	401,772	391,207
Jun-17	425,000	675,393	338,704	336,689
Jul-17	385,000	331,091	167,175	163,916
Aug-17	404,000	319,203	161,508	157,695
Sep-17	348,000	337,245	168,680	168,565
Oct-17	653,000	711,340	360,752	350,588
Nov-17	851,000	787,741	386,194	401,547
Dec-17	1,029,000	866,109	435,332	430,777
Production 2017 (ytd) (kWh)	8,251,000	8,356,425	4,195,207	4,161,218
Total Production (kWh)*	8,251,000	8,356,425	4,195,207	4,161,218
Capacity Factor*	31.80%		*Value calculated over the last 12 months	

B. Site Energy Production Graph

December-2017

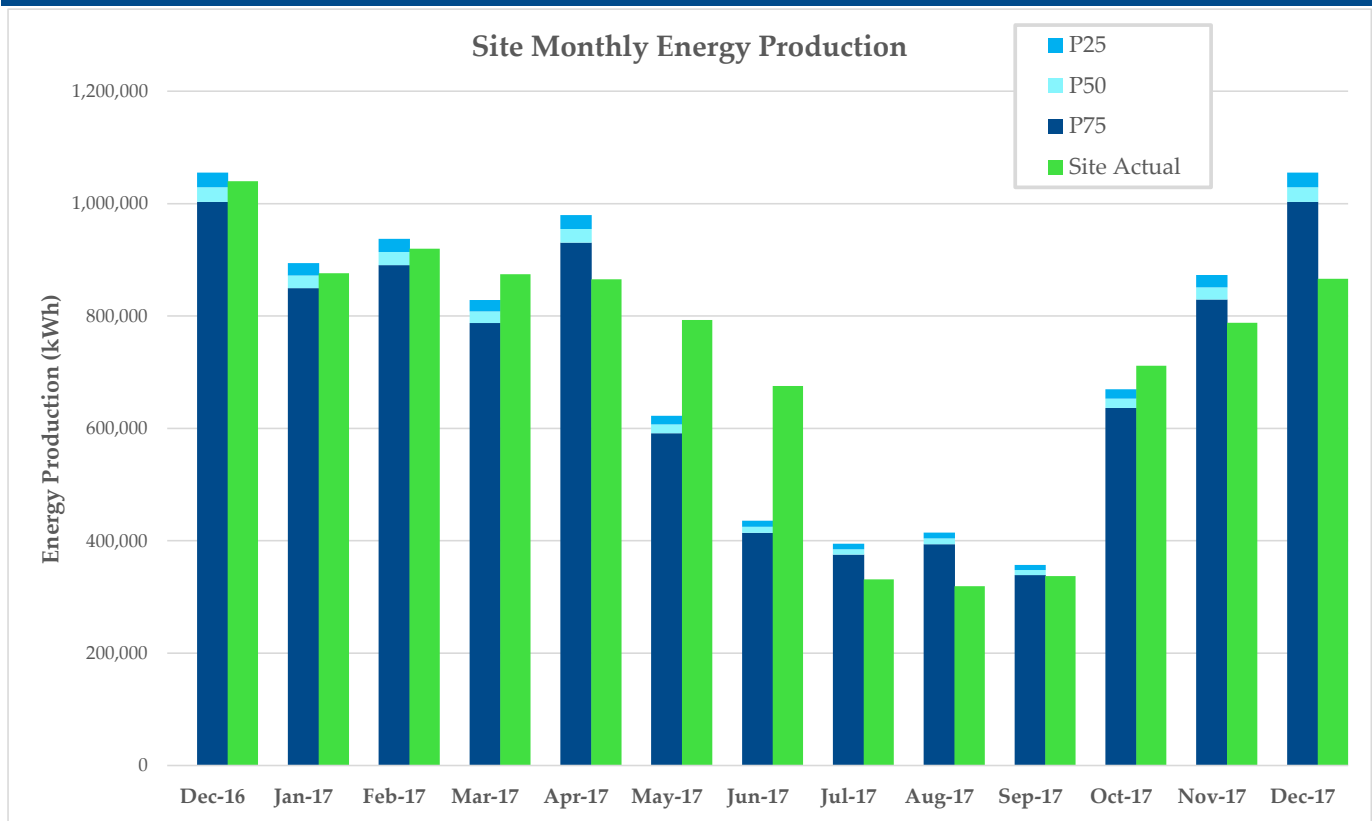

Monthly Report

December-2017

C. Safety Summary

	This Month	Project Cumulative
Recordable Incident(s)	0	0
Near Miss(es)	0	0

D. Planned Maintenance Events**

Date	Event	Duration (hr)	Turbine
January-2018	Goldwind 1.5 Year Maintenance	~8	W2

E. Actual Maintenance Events

Date	Event	Planned/Unplanned	Duration (hr)	Turbine
12/7/2017	Goldwind 1.5 Year Maintenance	Planned	1.36	W1
12/8/2017	Goldwind 1.5 Year Maintenance	Planned	0.87	W1
12/8/2017	Goldwind 1.5 Year Maintenance	Planned	0.67	W2
12/11/2017	Goldwind 1.5 Year Maintenance	Planned	1.04	W1
12/14/2017	Icing Event	Unplanned	10.00	W1 & W2
12/20/2017	Goldwind 1.5 Year Maintenance	Planned	7.71	W1
12/28/2017	Goldwind 1.5 Year Maintenance	Planned	2.63	W1
12/28/2017	Goldwind 1.5 Year Maintenance	Planned	4.51	W2

F. Turbine Availability & Downtime

Availability	This Month	Annual To Date
W1	99.61%	99.03%
W2	100.00%	99.85%
Avg	99.81%	99.44%
Downtime (hr)	This Month	Annual To Date
W1	28.31	189.55
W2	15.31	139.87
Total	43.62	329.42

G. Billed Data

Meter Reading (Date/Time)	12/28/2018 12:00 AM
Meter To Date Produced	15,404,558 kWh
Meter To Date Consumed	29,910 kWh
Last Reading Produced	14,479,742 kWh
Last Reading Consumed	29,017 kWh
Billed kWh	923,923 kWh
Next Meter Reading	1/28/2018 12:00 AM

H. Report Notes and Comments

**Goldwind 1.5 year maintenance for W2 to be completed January-2018.