




A. Site Energy Production Summary**

	Energy Production (kWh)				
	Site		By Turbine		
	P50 (Expected Production)	Actual Production	W1	W2	W3
Nov-17	1,123,000	466,686	-	-	-
Dec-17	1,153,000	852,755	-	-	-
Jan-18	1,306,000	1,214,611	405,820	399,594	409,197
Feb-18	1,137,000	-	-	-	-
Mar-18	1,134,000	-	-	-	-
Apr-18	1,176,000	-	-	-	-
May-18	927,000	-	-	-	-
Jun-18	634,000	-	-	-	-
Jul-18	527,000	-	-	-	-
Aug-18	449,000	-	-	-	-
Sep-18	610,000	-	-	-	-
Oct-18	990,000	-	-	-	-
Nov-18	1,123,000	-	-	-	-
Production 2018 (ytd) (kWh)	1,306,000	1,214,611	405,820	399,594	409,197
Total Production (kWh)*	-	-	-	-	-
Capacity Factor*	-		*Value calculated over the last 12 months		

B. Site Energy Production Graph

January-2018

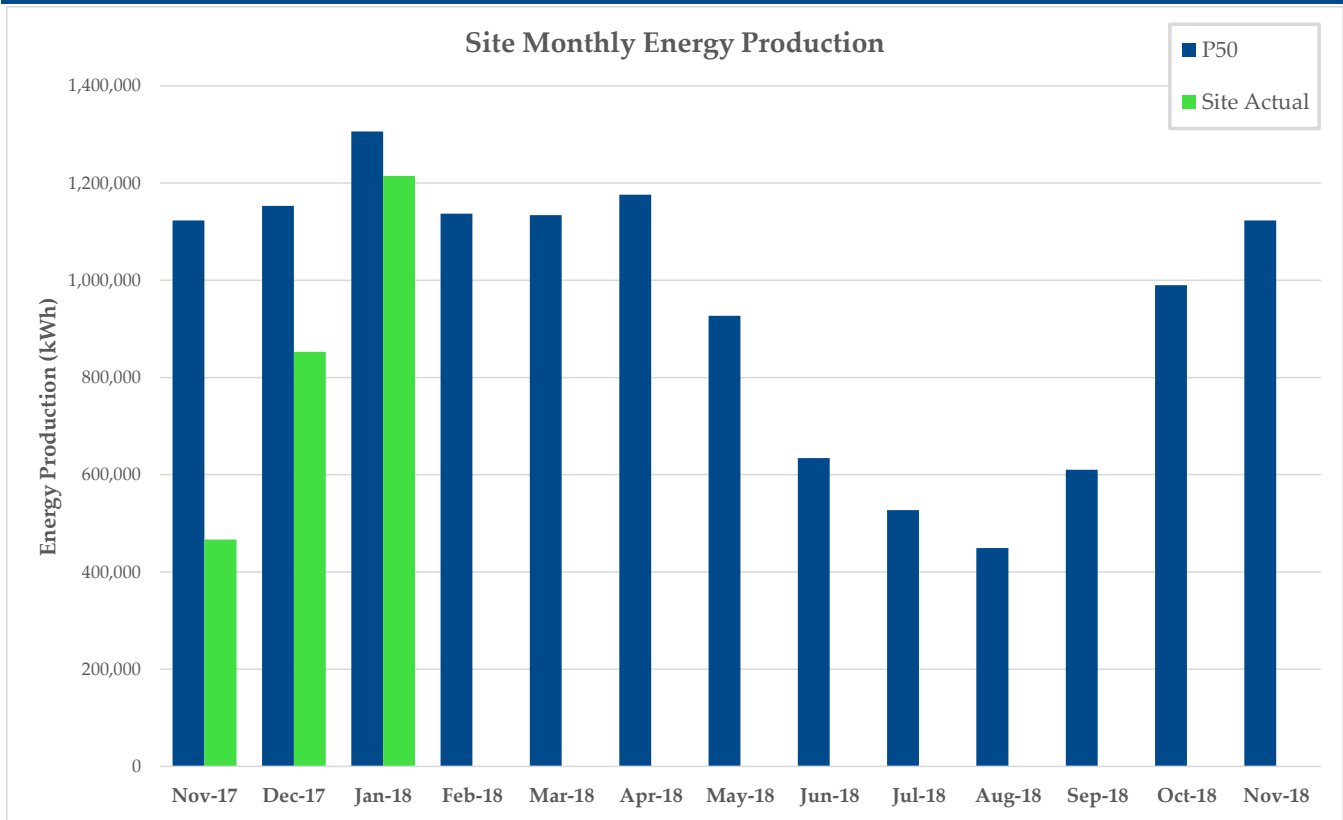

Monthly Report
January-2018

C. Safety Summary

	This Month	Project Cumulative
Recordable Incident(s)	0	0
Near Miss(es)	0	0

D. Planned Maintenance Events

Date	Event	Duration (hr)	Turbine
May-2018	Goldwind 6 Month Maintenance	~8	W1
May-2018	Goldwind 6 Month Maintenance	~8	W2
May-2018	Goldwind 6 Month Maintenance	~8	W3

E. Actual Maintenance Events

Date	Event	Planned/Unplanned	Duration (hrs)	Turbine
1/1-1/3/2018	Icing Event	Unplanned	51.55	W1
1/1-1/3/2018	Icing Event	Unplanned	51.29	W2
1/1-1/3/2018	Icing Event	Unplanned	51.43	W3
1/7-1/8/2018	Grid Fault	Unplanned	24.33	W1
1/10/2018	Grid Fault	Unplanned	6.34	W2
1/10/2018	Grid Fault	Unplanned	7.44	W3
1/24-1/25/2018	Icing Event	Unplanned	28.65	W1
1/24-1/25/2018	Icing Event	Unplanned	22.54	W2

F. Turbine Availability & Downtime

Availability	This Month	Year To Date
W1	100.00%	100.00%
W2	99.89%	99.89%
W3	99.96%	99.96%
Avg	99.95%	99.95%

Downtime (hr)	This Month	Year To Date
W1	106.39	106.39
W2	82.99	82.99
W3	61.16	61.16
Total	250.54	250.54

G. Billed Data

Meter Reading (Date/Time)	1/26/2018 12:00 AM
Meter To Date Produced	2,243,035 kWh
Meter To Date Consumed	2,794 kWh
Last Reading Produced	1,266,518 kWh
Last Reading Consumed	5,871 kWh
Billed kWh	979,594 kWh
Next Meter Reading	2/26/2018 12:00 AM

H. Report Notes and Comments

**Nov-17 and Dec-17 production data read from meter. Capacity factor will be included once a year of data has been collected.