




A. Site Energy Production Summary

	Energy Production (kWh)				
	Site		By Turbine		
	Expected Production	Actual Production	WTG A	WTG B	WTG C
Jun-17	668,411	1,199,560	427,710	365,940	405,910
Jul-17	638,097	608,374	208,860	199,814	199,700
Aug-17	577,992	550,820	193,760	179,770	177,290
Sep-17	631,697	605,096	208,710	201,632	194,754
Oct-17	1,003,602	1,223,590	422,370	411,740	389,480
Nov-17	1,395,914	1,441,140	493,690	470,470	476,980
Dec-17	1,278,858	1,521,630	522,010	495,750	503,870
Jan-18	1,332,437	1,726,420	585,680	568,390	572,350
Feb-18	1,157,019	1,303,000	447,860	426,380	428,760
Mar-18	1,242,761	1,576,970	530,020	505,480	541,470
Apr-18	1,447,248	1,316,810	462,450	405,270	449,090
May-18	1,010,966	1,077,570	344,730	377,970	354,870
Jun-18	668,411	686,130	223,300	224,540	238,290
Production 2018 (ytd) (kWh)	6,858,840	7,686,900	2,594,040	2,508,030	2,584,830
Total Production (kWh)*	12,384,999	13,637,550	4,643,440	4,467,206	4,526,904
Capacity Factor*	34.60% *Value calculated over the last 12 months				

B. Site Energy Production Graph

June-2018

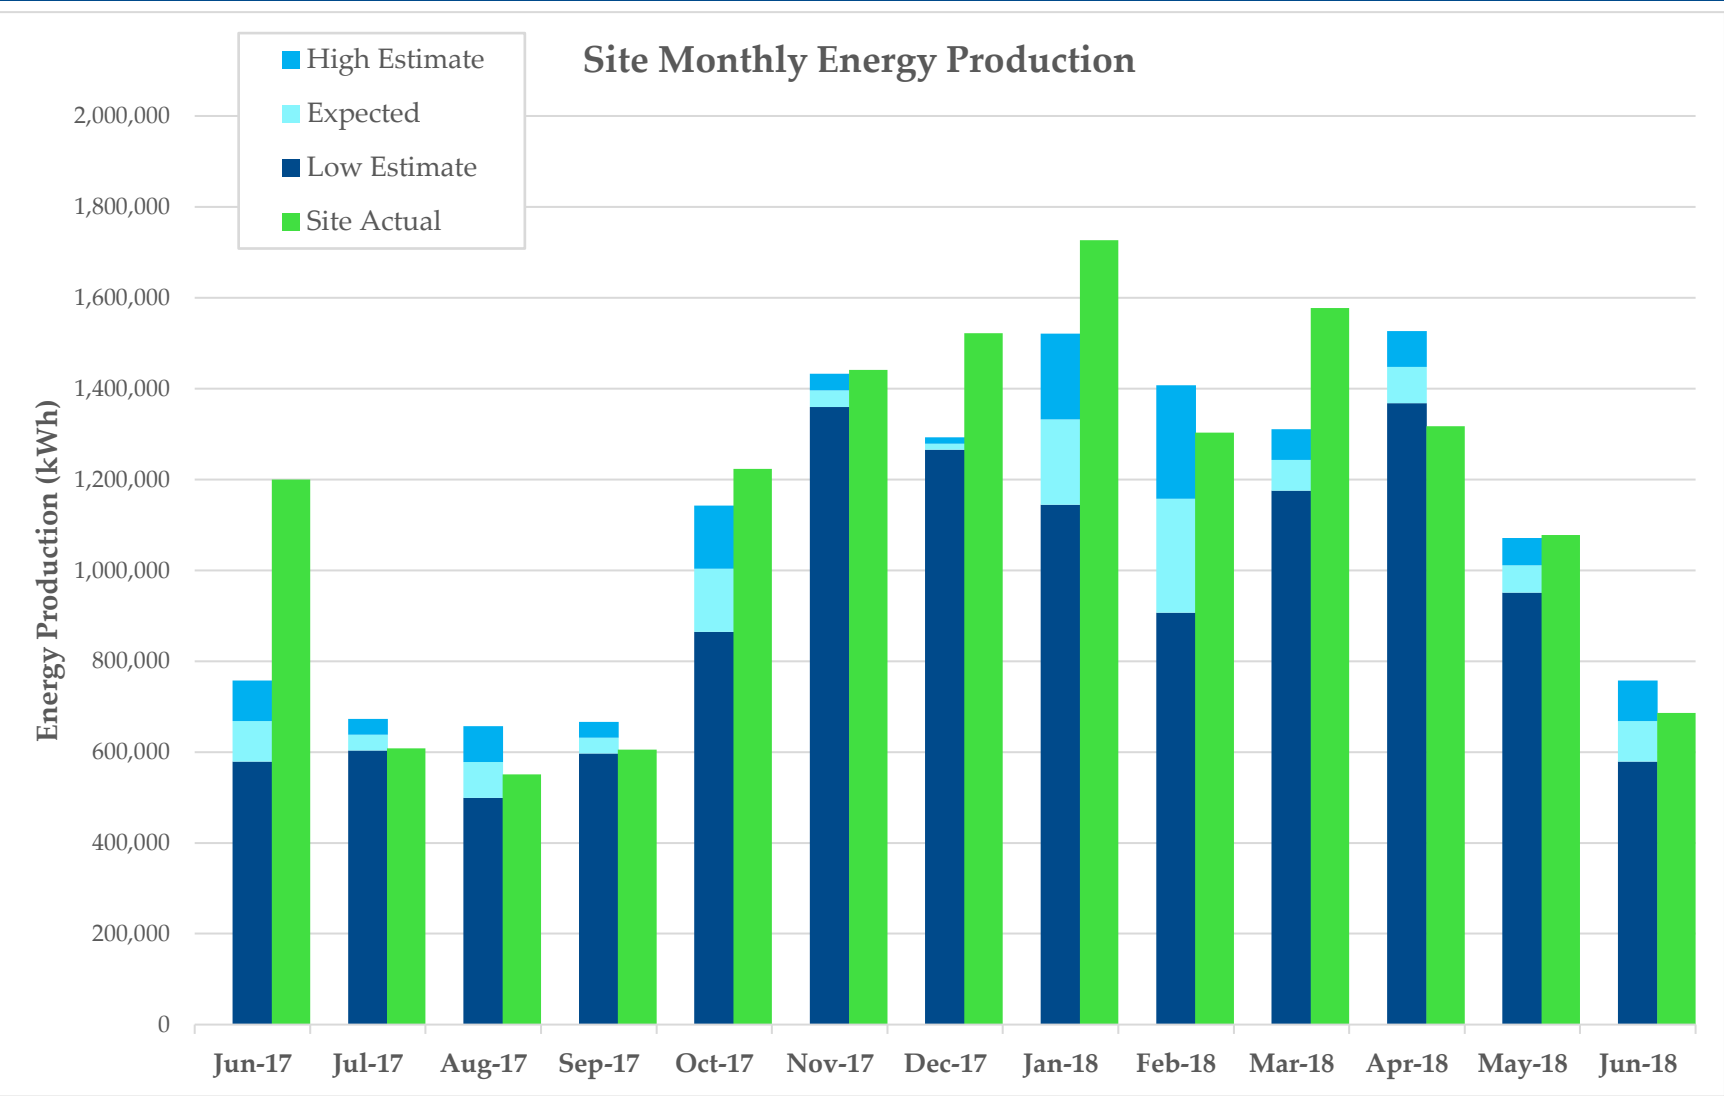

Monthly Report
June-2018



C. Safety Summary

	This Month	Project Cumulative
Recordable Incident(s)	0	0
Near Miss(es)	0	0

D. Planned Maintenance Events*

Date	Event	Duration (hr)	Turbine
July-2018	Goldwind 6 Year Maintenance	~15	WTG A
July-2018	Goldwind 6 Year Maintenance	~15	WTG B
July-2018	Goldwind 6 Year Maintenance	~15	WTG C

E. Actual Maintenance Events - June 2018

Date	Event	Planned/Unplanned	Duration (hr)	Turbine
6/12/2018	Troubleshooting Warning	Unplanned	4.66	WTG B
6/25/2018	Pitch Motor Seal Replacement	Unplanned	15.95	WTG A
6/26/2018	Pitch Motor Seal Replacement	Unplanned	24.00	WTG A

F. Turbine Availability & Downtime

Availability (%)	This Month	Year to Date
WTG A	93.46%	98.03%
WTG B	99.35%	98.50%
WTG C	99.96%	99.65%
Avg	97.59%	98.73%

Downtime (hr)	This Month	Year to Date
WTG A	51.11	149.47
WTG B	7.67	144.77
WTG C	3.31	99.65
Total	62.09	393.89

G. Wind Speed & Capacity Factor

Wind Speed (mph)	This Month	2018 Annual
WTG A	9.93	13.04
WTG B	10.04	13.02
WTG C	10.82	13.71
Estimated	11.44	13.39

Capacity Factor (%)	This Month	2018 Annual
WTG A	20.68%	39.81%
WTG B	20.79%	38.49%
WTG C	22.06%	39.67%
Low Estimate	17.87%	39.32%

H. Report Notes and Comments

*Annual Maintenance moved to July-2018