




A. Site Energy Production Summary**

		Energy Production (kWh)				
		Site		By Turbine		
		P50 (Expected Production)	Actual Production	W1	W2	W3
	Nov-17	1,123,000	466,686	-	-	-
	Dec-17	1,153,000	852,755	-	-	-
	Jan-18	1,306,000	1,214,611	405,820	399,594	409,197
	Feb-18	1,137,000	881,991	301,494	285,462	295,035
	Mar-18	1,134,000	1,184,135	407,384	386,300	390,451
	Apr-18	1,176,000	996,362	345,950	318,571	331,841
	May-18	927,000	759,639	251,931	248,291	259,417
	Jun-18	634,000	418,217	145,680	129,185	143,352
	Jul-18	527,000	-	-	-	-
	Aug-18	449,000	-	-	-	-
	Sep-18	610,000	-	-	-	-
	Oct-18	990,000	-	-	-	-
	Nov-18	1,123,000	-	-	-	-
Production 2018 (ytd) (kWh)		6,314,000	5,454,955	1,858,259	1,767,403	1,829,293
Total Production (kWh)*		-	-	-	-	-
Capacity Factor*		-		*Value calculated over the last 12 months		

B. Site Energy Production Graph

June-2018

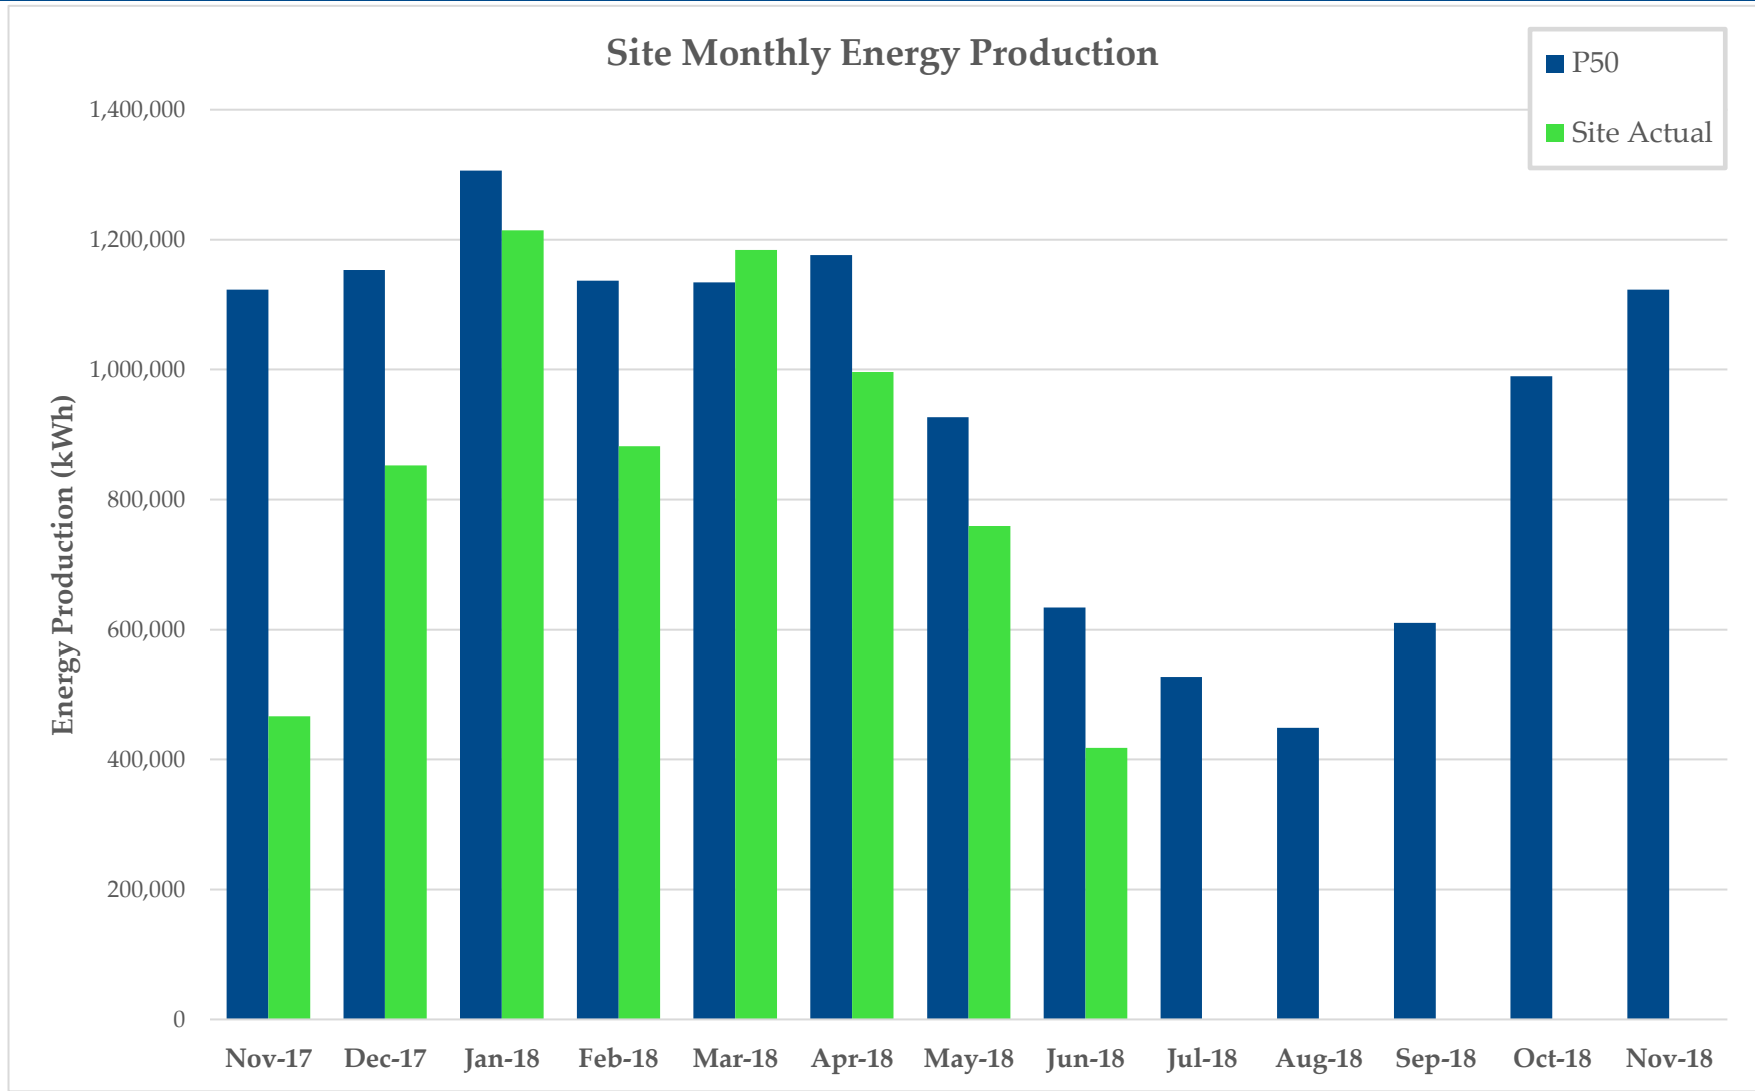

Monthly Report
June-2018

C. Safety Summary

	This Month	Project Cumulative
Recordable Incident(s)	0	0
Near Miss(es)	0	0

D. Planned Maintenance Events

Date	Event	Duration (hr)	Turbine
October-2018	Goldwind 1 Year Maintenance	~15	W1
October-2018	Goldwind 1 Year Maintenance	~15	W2
October-2018	Goldwind 1 Year Maintenance	~15	W3

E. Actual Maintenance Events***

Date	Event	Planned/Unplanned	Duration (hrs)	Turbine
6/4-6/8/2018	Goldwind 6 Month Maintenance	Planned	~6	W1
6/4-6/8/2018	Goldwind 6 Month Maintenance	Planned	~6	W2
6/4-6/8/2018	Goldwind 6 Month Maintenance	Planned	~6	W3
6/14/2018	Goldwind 6 Month Basement Maintenance	Planned	~2	W1
6/14/2018	Goldwind 6 Month Basement Maintenance	Planned	~2	W2
6/14/2018	Goldwind 6 Month Basement Maintenance	Planned	~2	W3
6/22/2018	System Safety Chain Error	Unplanned	7.95	W2
6/23/2018	System Safety Chain Error	Unplanned	8.67	W2

F. Turbine Availability & Downtime

Availability	This Month	Year To Date
W1	100.00%	99.78%
W2	97.69%	99.31%
W3	100.00%	99.87%
Avg	99.23%	99.65%

Downtime (hr)	This Month	Year To Date
W1	8.64	247.39
W2	20.88	228.39
W3	19.28	181.73
Total	48.80	657.51

G. Billed Data

Meter Reading (Date/Time)	6/20/2018 12:00 AM
Meter To Date Produced	6,493,803 kWh
Meter To Date Consumed	15,716 kWh
Last Reading Produced	6,050,221 kWh
Last Reading Consumed	12,690 kWh
Billed kWh	440,556 kWh
Next Meter Reading	7/20/2018 12:00 AM

H. Report Notes and Comments

**Nov-17 and Dec-17 production data read from meter. Capacity factor will be included once a year of data has been collected.

***Maintenance downtimes are approximate (~) due to an issue with SCADA, Numbers will be updated when the issue is resolved