




A. Site Energy Production Summary**

	Energy Production (kWh)				
	Site		By Turbine		
	P50 (Expected Production)	Actual Production	W1	W2	W3
Nov-17	1,123,000	466,686	-	-	-
Dec-17	1,153,000	852,755	-	-	-
Jan-18	1,306,000	1,214,611	405,820	399,594	409,197
Feb-18	1,137,000	881,991	301,494	285,462	295,035
Mar-18	1,134,000	1,184,135	407,384	386,300	390,451
Apr-18	1,176,000	996,362	345,950	318,571	331,841
May-18	927,000	759,639	251,931	248,291	259,417
Jun-18	634,000	418,217	145,680	129,185	143,352
Jul-18	527,000	333,148	111,051	106,463	115,634
Aug-18	449,000	-	-	-	-
Sep-18	610,000	-	-	-	-
Oct-18	990,000	-	-	-	-
Nov-18	1,123,000	-	-	-	-
Production 2018 (ytd) (kWh)	6,841,000	5,788,103	1,969,310	1,873,866	1,944,927
Total Production (kWh)*	-	-	-	-	-
Capacity Factor*	*Value calculated over the last 12 months				

B. Site Energy Production Graph

July-2018

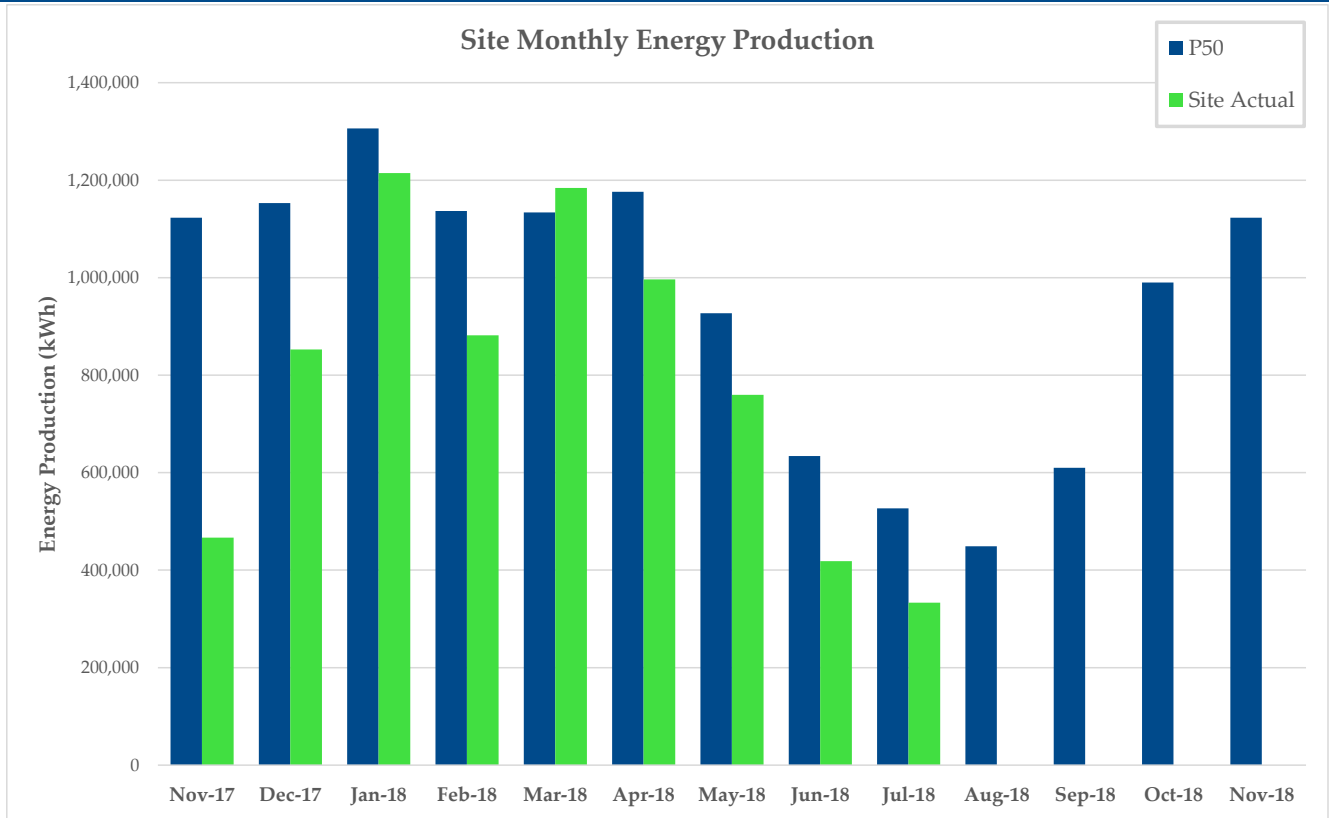

Monthly Report

July-2018

C. Safety Summary

	This Month	Project Cumulative
Recordable Incident(s)	0	0
Near Miss(es)	0	0

D. Planned Maintenance Events

Date	Event	Duration (hr)	Turbine
October-2018	Goldwind 1 Year Maintenance	~15	W1
October-2018	Goldwind 1 Year Maintenance	~15	W2
October-2018	Goldwind 1 Year Maintenance	~15	W3

E. Actual Maintenance Events***

Date	Event	Planned/Unplanned	Duration (hrs)	Turbine
6/4-6/8/2018	Goldwind 6 Month Maintenance	Planned	13.83	W1
6/5-6/8/2018	Goldwind 6 Month Maintenance	Planned	8.78	W2
6/5-6/8/2018	Goldwind 6 Month Maintenance	Planned	13.52	W3
6/14/2018	Goldwind 6 Month Basement Maintenance	Planned	5.77	W1
6/14/2018	Goldwind 6 Month Basement Maintenance	Planned	5.77	W2
6/14/2018	Goldwind 6 Month Basement Maintenance	Planned	5.77	W3

F. Turbine Availability & Downtime

Availability	This Month	Year To Date
W1	100.00%	99.81%
W2	99.97%	99.41%
W3	100.00%	99.89%
Avg	99.99%	99.70%

Downtime (hr)	This Month	Year To Date
W1	1.00	261.38
W2	1.38	242.09
W3	0.92	187.69
Total	3.30	691.16

G. Billed Data

Meter Reading (Date/Time)	7/20/2018 12:00 AM
Meter To Date Produced	6,823,455 kWh
Meter To Date Consumed	19,380 kWh
Last Reading Produced	6,493,803 kWh
Last Reading Consumed	15,716 kWh
Billed kWh	325,988 kWh
Next Meter Reading	8/20/2018 12:00 AM

H. Report Notes and Comments

**Nov-17 and Dec-17 production data read from meter. Capacity factor will be included once a year of data has been collected.

***June Maintenance numbers updated due to resolution of SCADA issue