



BALL CORPORATION - ZEPHYR WIND PROJECT


North Findlay Wind Campus, Findlay, OH

A. Site Energy Production Summary*

	Energy Production (kWh)				
	Site		By Turbine		
	P50 (Expected Production)	Actual Production	Z1	Z2	Z3
Sep-17	529,000	440,963	153,200	143,235	144,528
Oct-17	992,000	1,058,436	362,133	353,715	342,588
Nov-17	1,295,000	458,432	161,489	151,599	145,344
Dec-17	1,565,000	1,254,048	438,743	412,984	402,321
Jan-18	1,325,000	1,462,888	465,096	513,360	484,432
Feb-18	1,391,000	1,063,264	366,030	354,111	343,123
Mar-18	1,229,000	1,271,280	440,697	415,334	415,249
Apr-18	1,453,000	1,062,956	353,238	350,019	359,699
May-18	924,000	881,519	299,414	291,873	290,232
Jun-18	645,000	582,026	202,282	189,017	190,727
Jul-18	586,000	427,049	144,281	141,401	141,367
Aug-18	614,000	497,290	178,457	162,111	156,722
Sep-18	515,000	561,865	196,611	183,795	181,459
Production 2018 (ytd) (kWh)	8,682,000	7,810,137	2,646,106	2,601,021	2,563,010
Total Production (kWh)*	12,534,000	10,581,053	3,608,471	3,519,319	3,453,263
Capacity Factor*	26.84%		*Value calculated over the last 12 months		

B. Site Energy Production Graph

September-2018

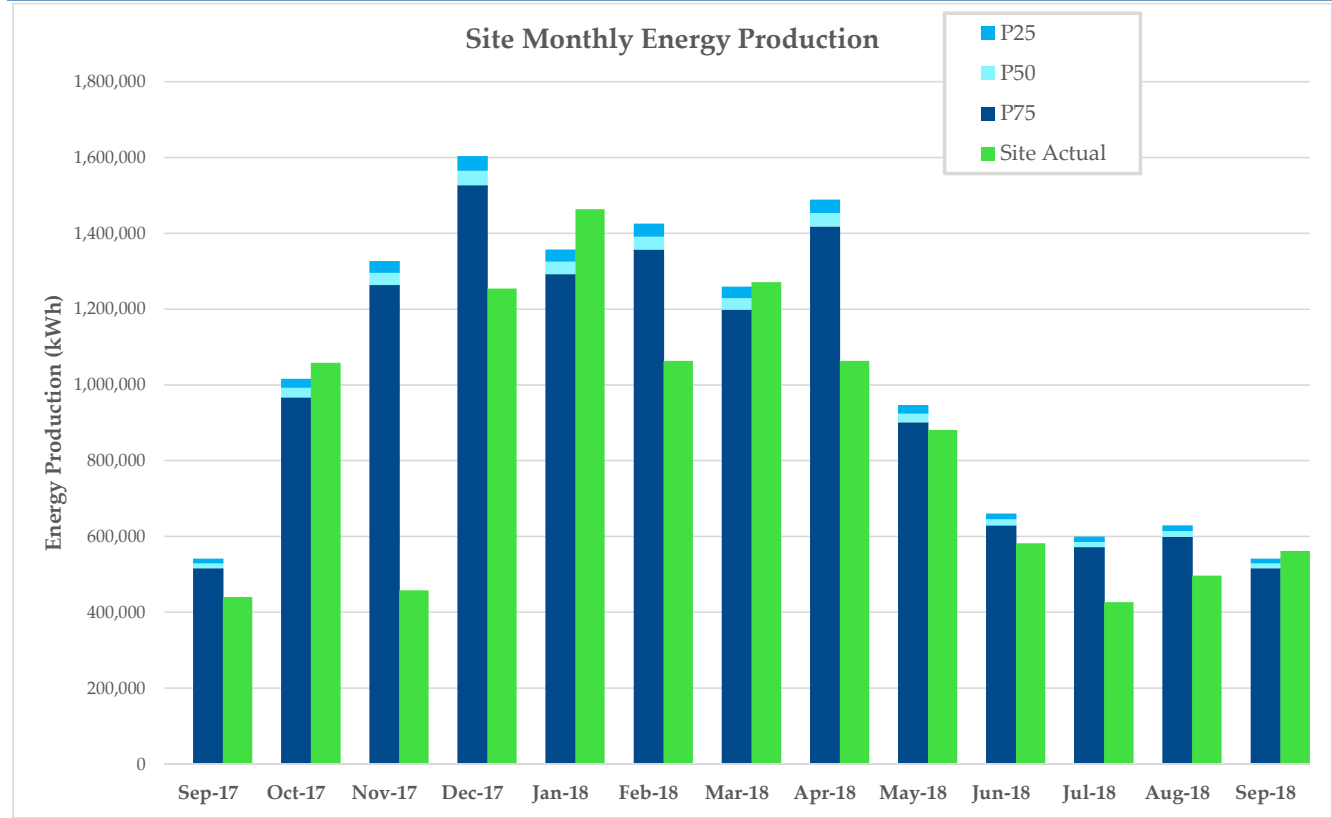

Monthly Report September-2018



C. Safety Summary

	This Month	Project Cumulative
Recordable Incident(s)	0	0
Near Miss(es)	0	0

D. Planned Maintenance Events

Date	Event	Duration (hr)	Turbine
March-2019	Goldwind 2.5 Year Maintenance	~8	Z1
March-2019	Goldwind 2.5 Year Maintenance	~8	Z2
March-2019	Goldwind 2.5 Year Maintenance	~8	Z3

E. Actual Maintenance Events

Date	Event	Planned/Unplanned	Duration (hrs)	Turbine
9/18/2018	Goldwind 2.5 Year Maintenance	Planned	8.58	Z2
9/20/2018	Goldwind 2.5 Year Maintenance	Planned	6.76	Z1
9/24/2018	Goldwind 2.5 Year Maintenance	Planned	5.36	Z3
9/27/2018	Goldwind 2.5 Year Maintenance	Planned	5.54	Z1

F. Turbine Availability & Downtime

Availability	This Month	Year To Date
Z1	99.82%	98.04%
Z2	99.47%	99.92%
Z3	99.99%	99.78%
Avg	99.76%	99.25%

Downtime (hr)	This Month	Year To Date
Z1	14.40	235.30
Z2	12.99	102.45
Z3	7.05	144.23
Total	34.44	481.98

G. Billed Data

Meter Reading (Date/Time)	9/17/2018 12:00 AM
Meter To Date Produced	29,205,290 kWh
Meter To Date Consumed	36,005 kWh
Last Reading Produced	28,611,715 kWh
Last Reading Consumed	35,011 kWh
Billed kWh	592,581 kWh
Next Meter Reading	10/17/2018 12:00 AM

H. Report Notes and Comments

*Change to P50 Expected Production due to Material Change in Circumstance.