




A. Site Energy Production Summary*

	Energy Production (kWh)			
	Site		By Turbine	
	P50 (Expected Production)	Actual Production	W1	W2
Oct-17	653,000	711,340	360,752	350,588
Nov-17	851,000	787,741	386,194	401,547
Dec-17	1,029,000	866,109	435,332	430,777
Jan-18	872,000	1,041,086	531,433	509,653
Feb-18	914,000	718,724	362,629	356,095
Mar-18	808,000	853,902	432,831	421,071
Apr-18	955,000	748,389	381,330	367,059
May-18	607,000	594,897	296,616	298,281
Jun-18	425,000	410,074	205,521	204,553
Jul-18	385,000	278,804	145,255	133,549
Aug-18	404,000	365,718	185,127	180,591
Sep-18	346,000	399,326	202,515	196,811
Oct-18	649,000	709,011	359,965	349,046
Production 2018 (ytd) (kWh)	6,365,000	6,119,931	3,103,222	3,016,709
Total Production (kWh)*	8,245,000	7,773,781	3,924,748	3,849,033
Capacity Factor*	29.58%		*Value calculated over the last 12 months	

B. Site Energy Production Graph

October-2018

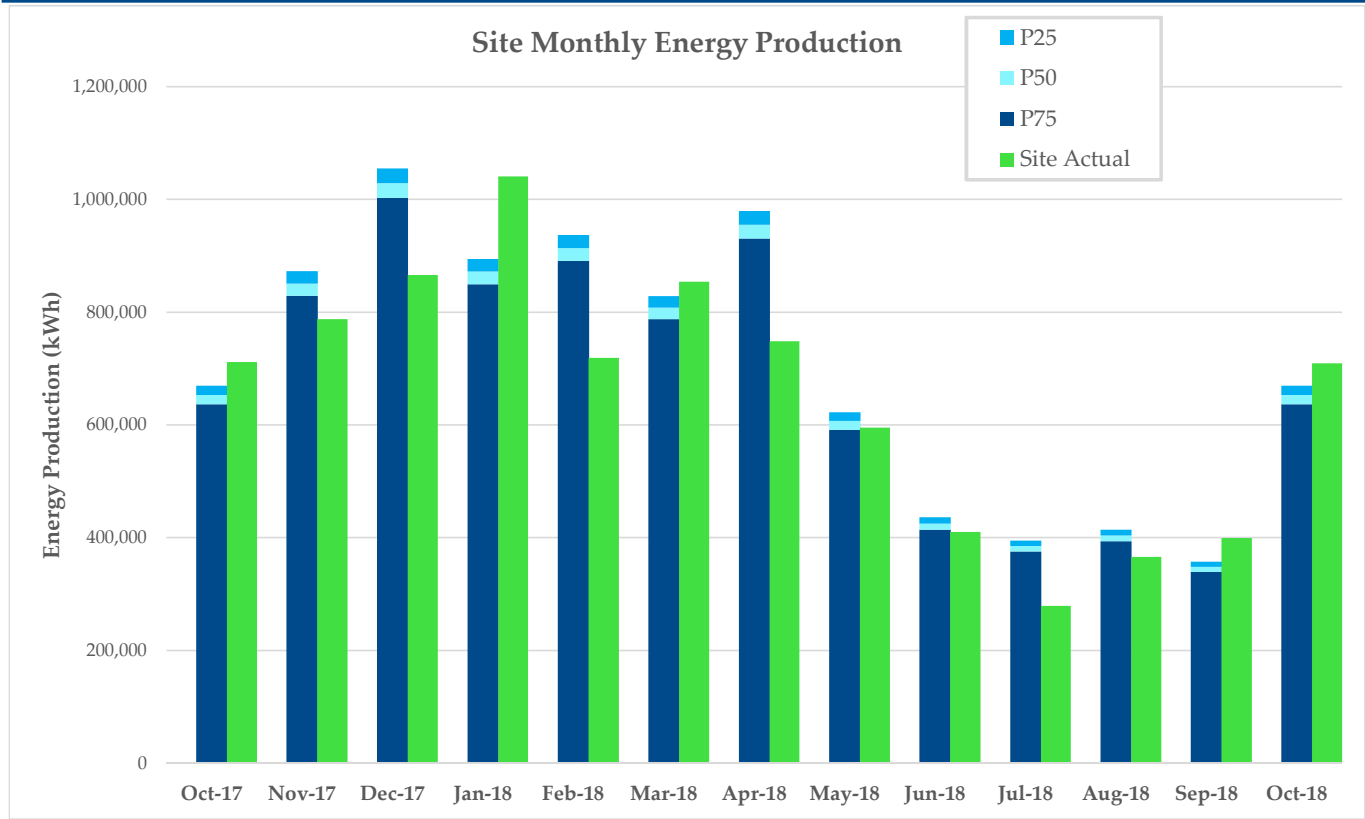

Monthly Report
October-2018



C. Safety Summary

	This Month	Project Cumulative
Recordable Incident(s)	0	0
Near Miss(es)	0	0

D. Planned Maintenance Events**

Date	Event	Duration (hr)	Turbine
December-2018	Goldwind 2.5 Year Maintenance	~8	W1
December-2018	Goldwind 2.5 Year Maintenance	~8	W2

E. Actual Maintenance Events

Date	Event	Planned/Unplanned	Duration (hr)	Turbine
------	-------	-------------------	---------------	---------

F. Turbine Availability & Downtime

Availability	This Month	Annual To Date
W1	99.97%	99.93%
W2	100.00%	99.96%
Avg	99.99%	99.94%
Downtime (hr)	This Month	Annual To Date
W1	4.71	139.61
W2	2.28	113.07
Total	6.99	252.68

G. Billed Data

Meter Reading (Date/Time)	10/28/2018 12:00 AM
Meter To Date Produced	21,414,893 kWh
Meter To Date Consumed	42,992 kWh
Last Reading Produced	20,772,846 kWh
Last Reading Consumed	42,148 kWh
Billed kWh	641,203 kWh
Next Meter Reading	11/28/2018 12:00 AM

H. Report Notes and Comments

*Change to P50 Expected Production due to Material Change in Circumstance.
**Dates updated to reflect Goldwind's projected maintenance schedule.