


A. Site Energy Production Summary*

	Energy Production (kWh)				
	Site		By Turbine		
	P50 (Expected Production)	Actual Production	V1	V2	
Sep-18	449,000	151,192	-	-	**
Oct-18	688,000	665,292	327,890	337,402	
Nov-18	804,000	-	-	-	
Dec-18	822,000	-	-	-	
Jan-19	924,000	-	-	-	
Feb-19	736,000	-	-	-	
Mar-19	794,000	-	-	-	
Apr-19	734,000	-	-	-	
May-19	574,000	-	-	-	
Jun-19	429,000	-	-	-	
Jul-19	357,000	-	-	-	
Aug-19	314,000	-	-	-	
Sep-19	449,000	-	-	-	
Production 2018 (ytd) (kWh)	1,137,000	816,835	327,890	337,402	
Total Production (kWh)*	-	-	-	-	
Capacity Factor*	-		*Value calculated over the last 12 months		

B. Site Energy Production Graph

October-2018

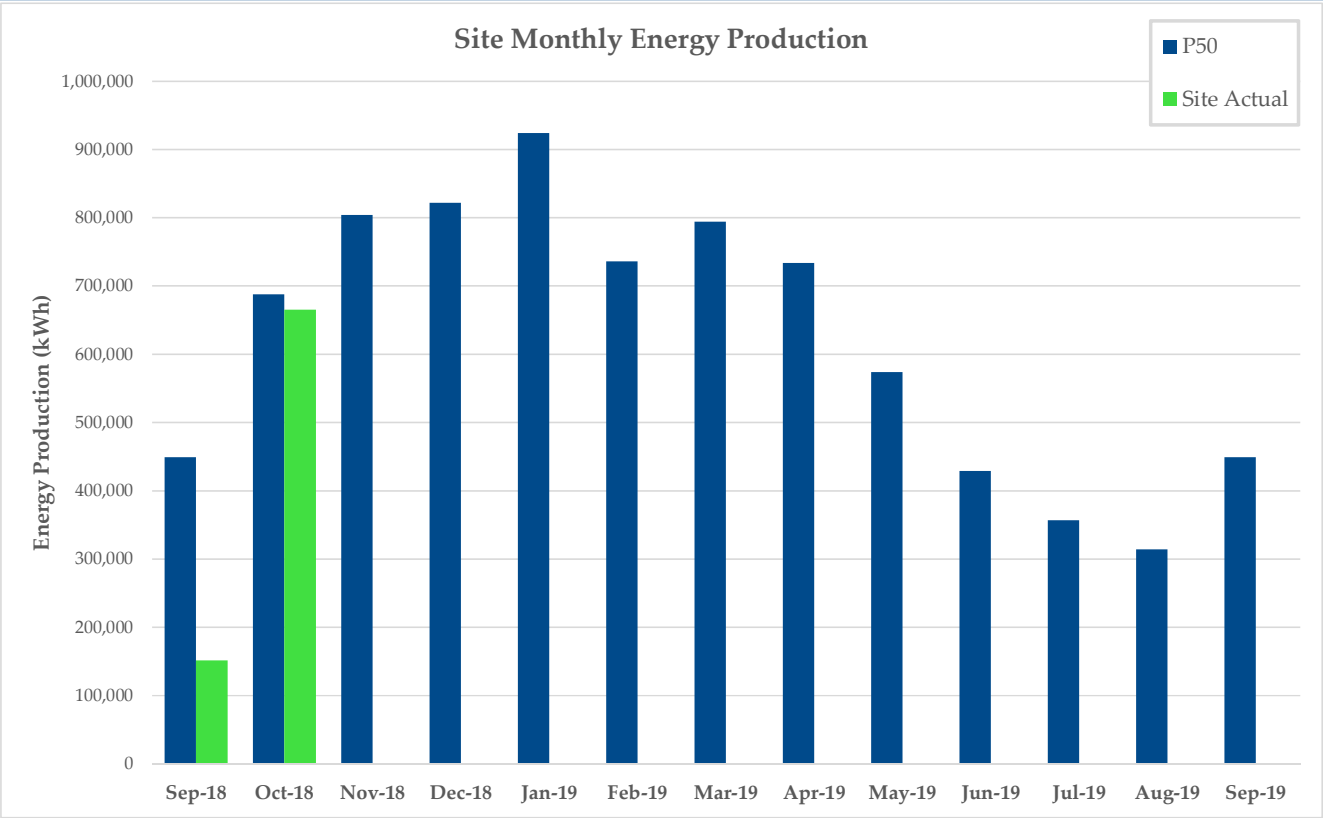

C. Safety Summary

	This Month	Project Cumulative
Recordable Incident(s)	0	0
Near Miss(es)	0	0

D. Planned Maintenance Events***

Date	Event	Duration (hr)	Turbine
November-18	Goldwind 500 Hour Maintenance	~8	V1
November-18	Goldwind 500 Hour Maintenance	~8	V2

E. Actual Maintenance Events

Date	Event	Planned/Unplanned	Duration (hrs)	Turbine
10/1/2018	Capacitor Feedback Fault	Unplanned	8.74	V2
10/5/2018	Goldwind 500 Hour Maintenance	Planned	4.46	V1
10/8/2018	Goldwind 500 Hour Maintenance	Planned	9.64	V1
10/8/2018	Goldwind 500 Hour Maintenance	Planned	7.14	V1
10/12/2018	Goldwind 500 Hour Maintenance	Planned	0.35	V2
10/14/2018	Goldwind 500 Hour Maintenance	Planned	7.31	V2
10/16/2018	Brake Inspection	Unplanned	4.42	V1
10/22/2018	Brake Resurfacing	Unplanned	7.89	V2
10/24/2018	Goldwind 500 Hour Maintenance	Unplanned	9.82	V2

F. Turbine Availability & Downtime

Availability	This Month	Year To Date
V1	98.95%	98.95%
V2	98.44%	98.44%
Avg	98.70%	98.70%
Downtime (hr)	This Month	Year To Date
V1	32.91	32.91
V2	41.74	41.74
Total	74.65	74.65

G. Billed Data

Meter Reading (Date/Time)	10/31/2018 12:00 AM
Meter To Date Produced	783,429 kWh
Meter To Date Consumed	1,344 kWh
Last Reading Produced	151,543 kWh
Last Reading Consumed	351 kWh
Billed kWh	630,893 kWh
Next Meter Reading	11/30/2018 12:00 AM

H. Report Notes and Comments

**Sep-18 production data read from meter. Capacity factor to be included once full year of data is available.

***Goldwind 500 Hour Maintenance to be completed in November.