


A. Site Energy Production Summary*

	Energy Production (kWh)				
	Site		By Turbine		
	P50 (Expected Production)	Actual Production	WG1	WG2	WG3
Oct-18	990,000	679,703	238,340	226,535	214,828
Nov-18	1,123,000	816,424	287,961	268,275	260,188
Dec-18	1,153,000	-	-	-	-
Jan-19	1,306,000	-	-	-	-
Feb-19	1,137,000	-	-	-	-
Mar-19	1,134,000	-	-	-	-
Apr-19	1,176,000	-	-	-	-
May-19	927,000	-	-	-	-
Jun-19	634,000	-	-	-	-
Jul-19	527,000	-	-	-	-
Aug-19	449,000	-	-	-	-
Sep-19	610,000	-	-	-	-
Oct-19	990,000	-	-	-	-
Production 2017 (ytd) (kWh)	2,113,000	1,496,127	526,301	494,810	475,016
Total Production (kWh)*	11,166,000	816,424	287,961	268,275	260,188
Capacity Factor*	-		*Value calculated over the last 12 months		

B. Site Energy Production Graph

November-2018

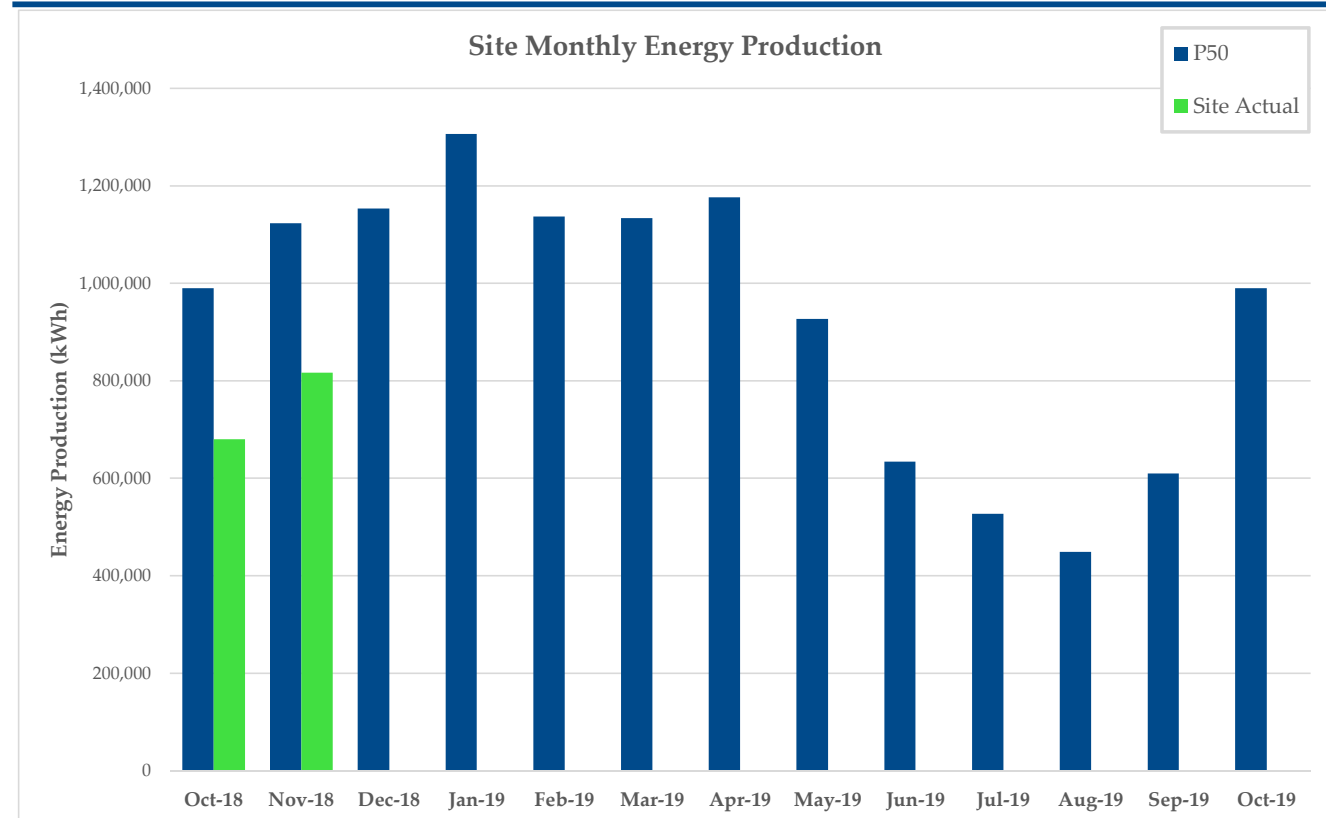

C. Safety Summary

	This Month	Project Cumulative
Recordable Incident(s)	0	0
Near Miss(es)	0	0

D. Planned Maintenance Events***

Date	Event	Duration (hr)	Turbine
December-2018	Goldwind 500 Hour Maintenance	~8	WG 1
December-2018	Goldwind 500 Hour Maintenance	~8	WG 2
December-2018	Goldwind 500 Hour Maintenance	~8	WG 3

E. Actual Maintenance Events

Date	Event	Planned/Unplanned	Duration (hrs)	Turbine
11/13/2018	Customer Tour	Unplanned	4.73	WG1
11/13/2018	Goldwind 500 Hour Maintenance	Planned	2.09	WG1
11/13/2018	Goldwind 500 Hour Maintenance	Planned	2.51	WG2
11/13/2018	Goldwind 500 Hour Maintenance	Planned	1.98	WG3
11/14/2018	Goldwind 500 Hour Maintenance	Planned	12.37	WG2
11/14-16/2018	Icing Event	Unplanned	43.21	WG1,WG2,WG3
11/16-18/2018	Ethernet Replacement	Unplanned	38.59	WG3
11/29-30/2018	Icing Event	Unplanned	31.18	WG1,WG2,WG3

F. Turbine Availability & Downtime

Availability	This Month	Year To Date
WG1	100.00%	100.00%
WG2	100.00%	100.00%
WG3	100.00%	98.85%
Avg	100.00%	99.62%

Downtime (hr)	This Month	Year To Date
WG1	81.21	218.22
WG2	89.27	175.63
WG3	114.96	263.51
Total	285.44	657.36

G. Billed Data**

Meter Reading (Date/Time)	11/28/2018 12:00 AM
Meter To Date Produced	1,332,616 kWh
Meter To Date Consumed	5,480 kWh
Last Reading Produced	425,326 kWh
Last Reading Consumed	1,697 kWh
Billed kWh	903,508 kWh
Next Meter Reading	12/28/2018 12:00 AM

H. Report Notes and Comments

*Capacity factor to be included once full year of data is available.

**Billing began 10/11/2018.

***Goldwind 500 Hour Maintenance to be continued December 2018.