


A. Site Energy Production Summary**

	Energy Production (kWh)					
	Site		By Turbine			
	P50 (Expected Production)	Actual Production	W1	W2	W3	
Nov-17	1,123,000	466,686	-	-	-	**
Dec-17	1,153,000	852,755	-	-	-	**
Jan-18	1,306,000	1,214,611	405,820	399,594	409,197	
Feb-18	1,137,000	881,991	301,494	285,462	295,035	
Mar-18	1,134,000	1,184,135	407,384	386,300	390,451	
Apr-18	1,176,000	996,362	345,950	318,571	331,841	
May-18	927,000	759,639	251,931	248,291	259,417	
Jun-18	634,000	418,217	145,680	129,185	143,352	
Jul-18	527,000	333,148	111,051	106,463	115,634	
Aug-18	449,000	397,006	132,087	128,358	136,562	***
Sep-18	610,000	436,562	146,398	140,120	150,044	
Oct-18	990,000	742,865	258,249	240,231	244,385	
Nov-18	1,123,000	835,265	299,643	268,523	267,099	
Production 2018 (ytd) (kWh)	10,013,000	8,199,801	2,805,687	2,651,098	2,743,017	
Total Production (kWh)*	11,166,000	9,052,556	-	-	-	
Capacity Factor*	22.96%		*Value calculated over the last 12 months			

B. Site Energy Production Graph

November-2018

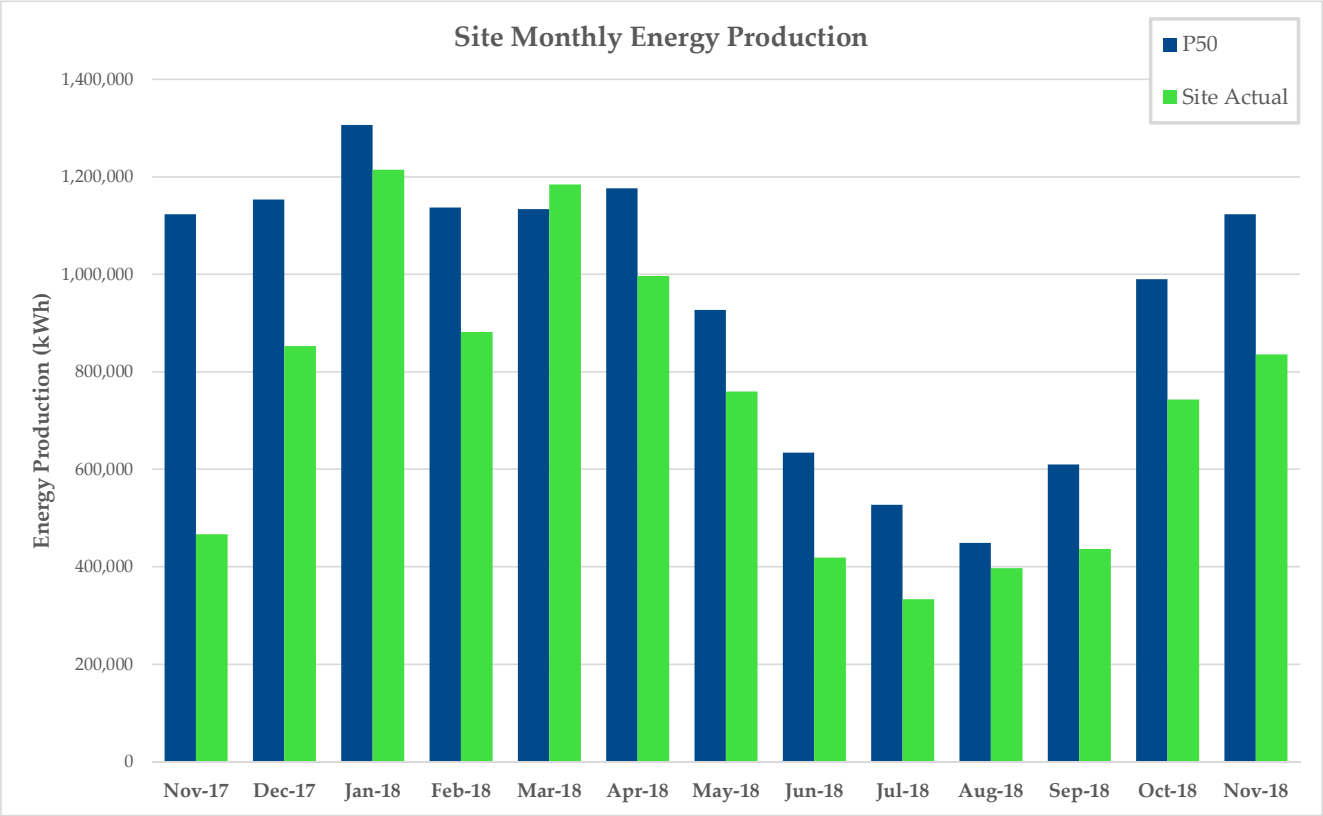

C. Safety Summary

	This Month	Project Cumulative
Recordable Incident(s)	0	0
Near Miss(es)	0	0

D. Planned Maintenance Events*

Date	Event	Duration (hr)	Turbine
December-2018	Goldwind 1 Year Maintenance	~15	W1
December-2018	Goldwind 1 Year Maintenance	~15	W2
December-2018	Goldwind 1 Year Maintenance	~15	W3

E. Actual Maintenance Events

Date	Event	Planned/Unplanned	Duration (hrs)	Turbine
11/15-16/2018	Icing Event	Unplanned	31.47	W1
11/15-16/2018	Icing Event	Unplanned	31.47	W2
11/15-16/2018	Icing Event	Unplanned	39.16	W3
11/20/2018	Goldwind 1 Year Maintenance	Planned	6.62	W1
11/28/2018	Convertor Fan Feedback Loss Error	Unplanned	4.60	W3
11/28/2018	Goldwind 1 Year Maintenance	Planned	7.99	W3
11/29/2018	Convertor Fan Feedback Loss Error	Unplanned	10.68	W3
11/29/2018	Goldwind 1 Year Maintenance	Unplanned	4.23	W2

F. Turbine Availability & Downtime

Availability	This Month	Year To Date
W1	100.00%	99.84%
W2	100.00%	99.56%
W3	97.88%	99.68%
Avg	99.29%	99.69%

Downtime (hr)	This Month	Year To Date
W1	38.09	354.07
W2	35.70	333.92
W3	62.43	309.84
Total	136.22	997.83

G. Billed Data

Meter Reading (Date/Time)	11/20/2018 12:00 AM
Meter To Date Produced	8,966,516 kWh
Meter To Date Consumed	31,189 kWh
Last Reading Produced	8,225,646 kWh
Last Reading Consumed	28,791 kWh
Billed kWh	738,473 kWh
Next Meter Reading	12/20/2018 12:00 AM

H. Report Notes and Comments

*Goldwind 1 Year Maintenance continuing in December 2018.
**Nov-17 and Dec-17 production data read from meter.
***August production data includes three days read from meter due to SCADA issue.