

A. Site Energy Production Summary**

	Energy Production (kWh)					
	Site		By Turbine			
	P50 (Expected Production)	Actual Production	W1	W2	W3	
Dec-17	1,153,000	852,755	-	-	-	**
Jan-18	1,306,000	1,214,611	405,820	399,594	409,197	**
Feb-18	1,137,000	881,991	301,494	285,462	295,035	
Mar-18	1,134,000	1,184,135	407,384	386,300	390,451	
Apr-18	1,176,000	996,362	345,950	318,571	331,841	
May-18	927,000	759,639	251,931	248,291	259,417	
Jun-18	634,000	418,217	145,680	129,185	143,352	
Jul-18	527,000	333,148	111,051	106,463	115,634	
Aug-18	449,000	397,006	132,087	128,358	136,562	
Sep-18	610,000	436,562	146,398	140,120	150,044	***
Oct-18	990,000	742,865	258,249	240,231	244,385	
Nov-18	1,123,000	835,265	299,643	268,523	267,099	
Dec-18	1,153,000	990,824	341,399	318,787	330,638	
Production 2018 (ytd) (kWh)	11,166,000	9,190,625	3,147,086	2,969,885	3,073,655	
Total Production (kWh)*	11,166,000	9,190,625	3,147,086	2,969,885	3,073,655	
Capacity Factor*	23.31%		*Value calculated over the last 12 months			

C. Safety Summary

	This Month	Project Cumulative
Recordable Incident(s)	0	0
Near Miss(es)	0	0

D. Planned Maintenance Events*


Date	Event	Duration (hr)	Turbine
January-2019	Goldwind 1 Year Maintenance	~15	W1
January-2019	Goldwind 1 Year Maintenance	~15	W2
January-2019	Goldwind 1 Year Maintenance	~15	W3

E. Actual Maintenance Events

Date	Event	Planned/Unplanned	Duration (hrs)	Turbine
12/4/2018	Goldwind 1 Year Maintenance	Planned	10.18	W2
12/5/2018	Goldwind 1 Year Maintenance	Planned	3.22	W2
12/31/2018	High Wind Event	Unplanned	6.07	W1, W2, W3

B. Site Energy Production Graph

December-2018

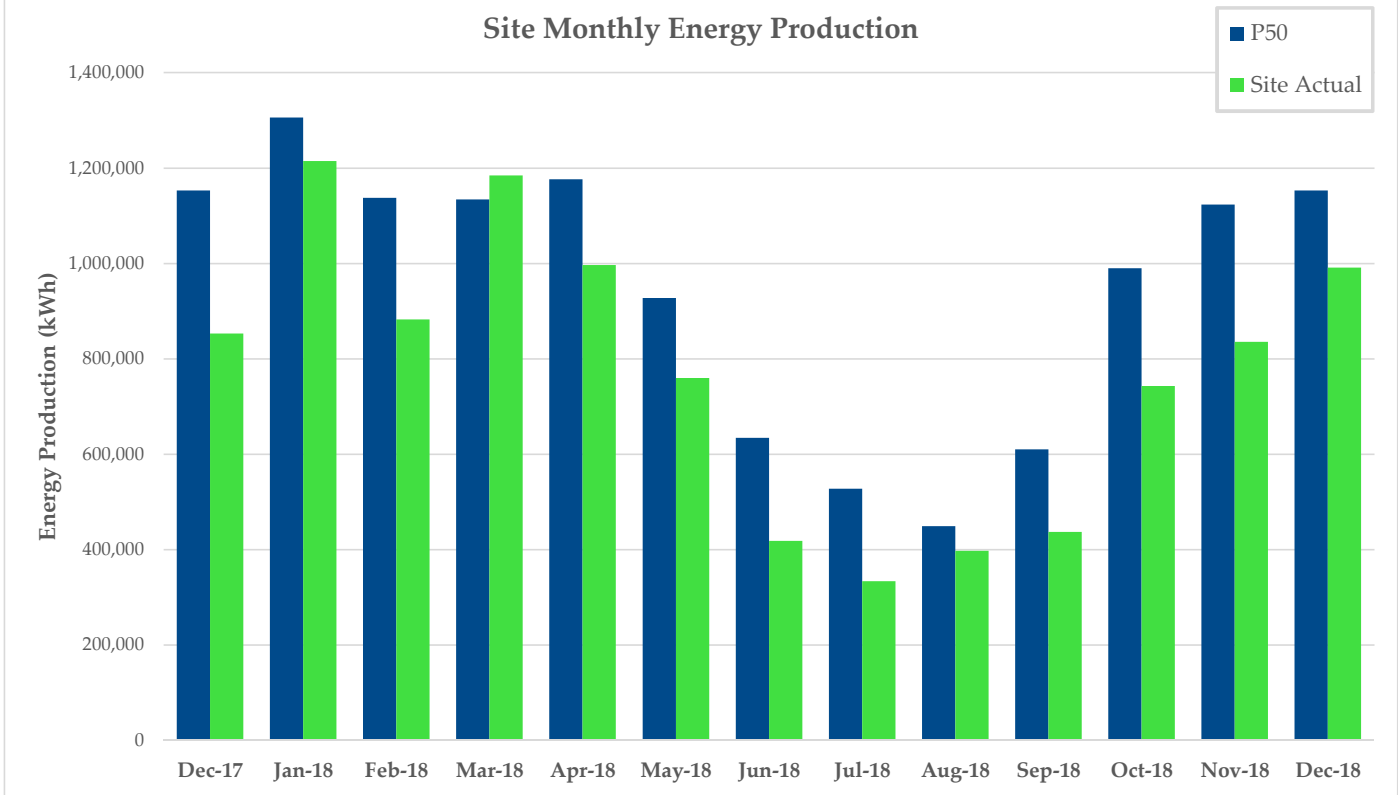

F. Turbine Availability & Downtime

Availability	This Month	Year To Date
W1	100.00%	99.85%
W2	100.00%	99.60%
W3	100.00%	99.70%
Avg	100.00%	99.72%

Downtime (hr)	This Month	Year To Date
W1	6.07	360.14
W2	19.47	353.39
W3	6.07	315.91
Total	31.61	1029.44

G. Billed Data

Meter Reading (Date/Time)	12/20/2018 12:00 AM
Meter To Date Produced	9,845,456 kWh
Meter To Date Consumed	32,610 kWh
Last Reading Produced	8,966,516 kWh
Last Reading Consumed	31,189 kWh
Billed kWh	877,518 kWh
Next Meter Reading	1/20/2019 12:00 AM

H. Report Notes and Comments

*Goldwind 1 Year Maintenance continuing in January 2019.
**Dec-17 production data read from meter.
***August production data includes three days read from meter due to SCADA issue.