


A. Site Energy Production Summary

	Energy Production (kWh)				
	Site		By Turbine		
	P50 (Expected Production)	Actual Production	W1	W2	W3
Jan-18	1,306,000	1,214,611	405,820	399,594	409,197
Feb-18	1,137,000	881,991	301,494	285,462	295,035
Mar-18	1,134,000	1,184,135	407,384	386,300	390,451
Apr-18	1,176,000	996,362	345,950	318,571	331,841
May-18	927,000	759,639	251,931	248,291	259,417
Jun-18	634,000	418,217	145,680	129,185	143,352
Jul-18	527,000	333,148	111,051	106,463	115,634
Aug-18	449,000	397,006	132,087	128,358	136,562
Sep-18	610,000	436,562	146,398	140,120	150,044
Oct-18	990,000	742,865	258,249	240,231	244,385
Nov-18	1,123,000	835,265	299,643	268,523	267,099
Dec-18	1,153,000	990,824	341,399	318,787	330,638
Jan-19	1,306,000	1,228,632	427,801	398,420	402,411
Production 2019 (ytd) (kWh)	1,306,000	1,228,632	427,801	398,420	402,411
Total Production (kWh)*	11,166,000	9,204,646	3,169,067	2,968,711	3,066,869
Capacity Factor*	23.35%		*Value calculated over the last 12 months		

B. Site Energy Production Graph

January-2019

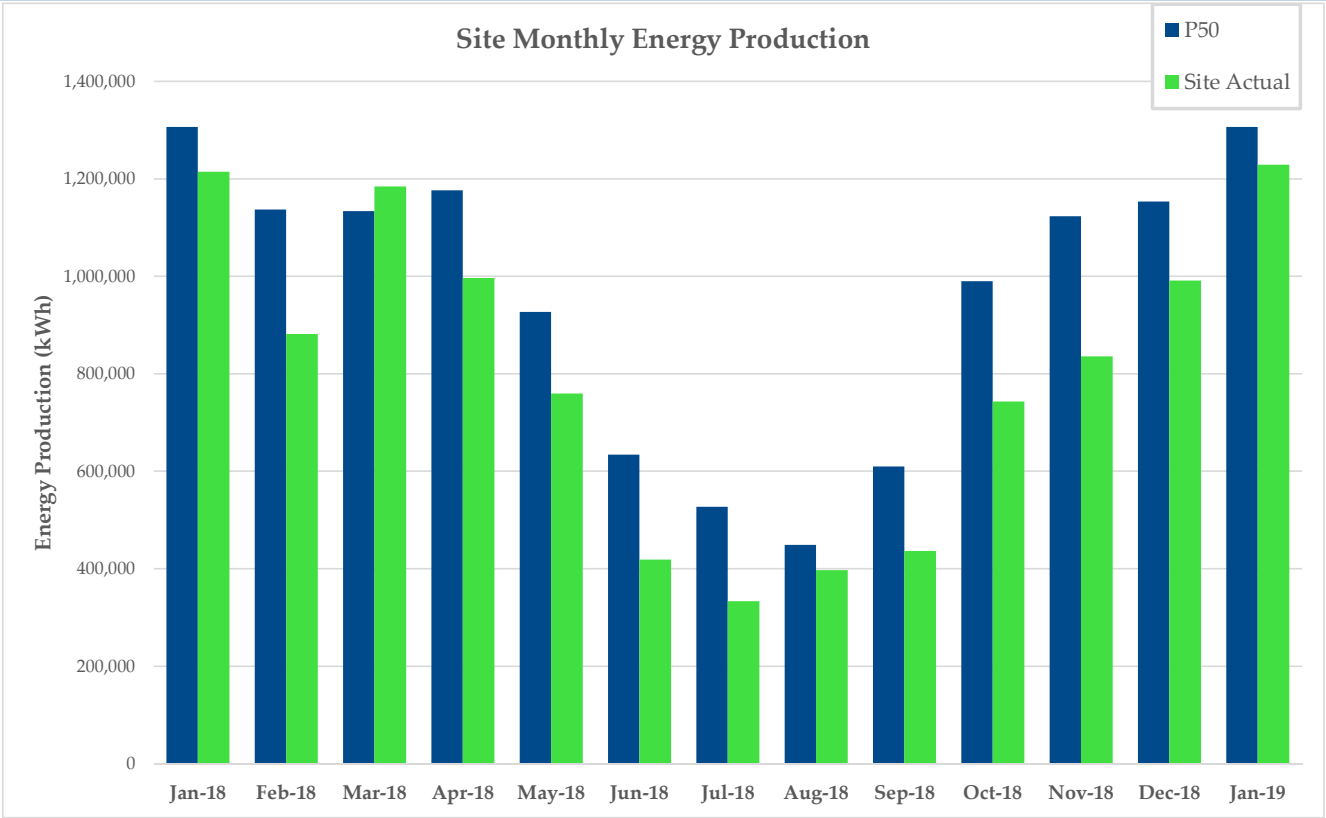

C. Safety Summary

	This Month	Project Cumulative
Recordable Incident(s)	0	0
Near Miss(es)	0	0

D. Planned Maintenance Events

Date	Event	Duration (hr)	Turbine
May-2019	Goldwind 1.5 Year Maintenance	~8	W1
May-2019	Goldwind 1.5 Year Maintenance	~8	W2
May-2019	Goldwind 1.5 Year Maintenance	~8	W3

E. Actual Maintenance Events

Date	Event	Planned/Unplanned	Duration (hrs)	Turbine
1/3/2019	Goldwind 1 Year Maintenance	Planned	1.05	W1,2,3
1/15-16/2019	Icing Event	Unplanned	25.46	W1
1/15-16/2019	Icing Event	Unplanned	32.01	W2
1/15-17/2019	Icing Event	Unplanned	50.26	W3

F. Turbine Availability & Downtime

Availability	This Month	Year To Date
W1	100.00%	100.00%
W2	99.97%	99.97%
W3	100.00%	100.00%
Avg	99.99%	99.99%

Downtime (hr)	This Month	Year To Date
W1	29.41	29.41
W2	36.17	36.17
W3	54.21	54.21
Total	119.79	119.79

G. Billed Data

Meter Reading (Date/Time)	1/20/2019 12:00 AM
Meter To Date Produced	10,799,590 kWh
Meter To Date Consumed	34,526 kWh
Last Reading Produced	9,845,456 kWh
Last Reading Consumed	32,610 kWh
Billed kWh	952,219 kWh
Next Meter Reading	2/20/2019 12:00 AM

H. Report Notes and Comments

***August 2018 production data includes three days read from meter due to SCADA issue.