



BALL CORPORATION - ZEPHYR WIND PROJECT

North Findlay Wind Campus, Findlay, OH




A. Site Energy Production Summary*

	Energy Production (kWh)				
	Site		By Turbine		
	P50 (Expected Production)	Actual Production	Z1	Z2	Z3
Apr-18	1,453,000	1,062,956	353,238	350,019	359,699
May-18	924,000	881,519	299,414	291,873	290,232
Jun-18	645,000	582,026	202,282	189,017	190,727
Jul-18	586,000	427,049	144,281	141,401	141,367
Aug-18	614,000	497,290	178,457	162,111	156,722
Sep-18	515,000	561,865	196,611	183,795	181,459
Oct-18	966,000	1,026,498	357,069	338,941	330,488
Nov-18	1,262,000	931,705	303,735	310,115	317,855
Dec-18	1,524,000	1,090,402	371,241	361,728	357,433
Jan-19	1,291,000	1,404,829	478,894	461,547	464,388
Feb-19	1,355,000	990,378	351,191	338,149	301,038
Mar-19	1,197,000	1,205,738	426,173	396,015	383,550
Apr-19	1,415,000	1,258,163	431,314	415,843	411,006
Production 2019 (ytd) (kWh)	5,258,000	4,859,108	1,687,572	1,611,554	1,559,982
Total Production (kWh)*	12,294,000	10,857,462	3,740,662	3,590,535	3,526,265
Capacity Factor*	27.54%		*Value calculated over the last 12 months		

B. Site Energy Production Graph

April-2019

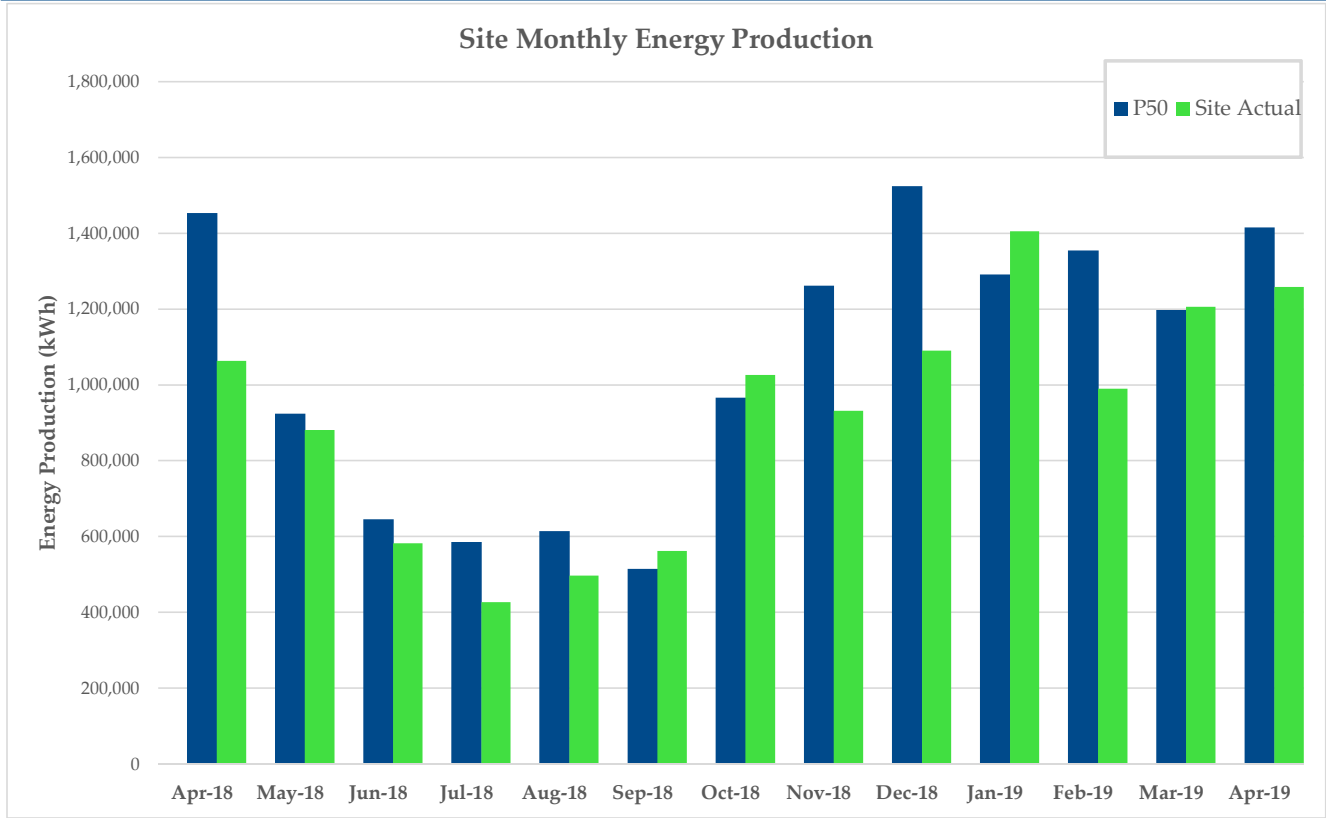

Monthly Report
April-2019

C. Safety Summary

	This Month	Project Cumulative
Recordable Incident(s)	0	0
Near Miss(es)	0	0

D. Planned Maintenance Events

Date	Event	Duration (hr)	Turbine
October-2019	Goldwind 3.5 Year Maintenance	~8	Z1
October-2019	Goldwind 3.5 Year Maintenance	~8	Z2
October-2019	Goldwind 3.5 Year Maintenance	~8	Z3

E. Actual Maintenance Events

Date	Event	Planned/Unplanned	Duration (hrs)	Turbine
4/1/2019	Goldwind 3 Year Maintenance	Planned	6.97	Z1
4/2/2019	Goldwind 3 Year Maintenance	Planned	7.26	Z2
4/3/2019	Goldwind 3 Year Maintenance	Planned	4.31	Z1, Z2, Z3
4/4/2019	Goldwind 3 Year Maintenance	Planned	9.04	Z3

F. Turbine Availability & Downtime

Availability	This Month	Year To Date
Z1	100.00%	99.99%
Z2	100.00%	99.96%
Z3	100.00%	97.63%
Avg	100.00%	99.19%

Downtime (hr)	This Month	Year To Date
Z1	12.08	120.09
Z2	12.37	124.79
Z3	14.15	186.74
Total	38.60	431.62

G. Billed Data

Meter Reading (Date/Time)	4/18/2019 12:00 AM
Meter To Date Produced	36,703,103 kWh
Meter To Date Consumed	45,128 kWh
Last Reading Produced	35,549,311 kWh
Last Reading Consumed	44,522 kWh
Billed kWh	1,153,186 kWh
Next Meter Reading	5/18/2019 12:00 AM

H. Report Notes and Comments

*Change to P50 Expected Production due to Material Change in Circumstance.