


A. Site Energy Production Summary

	Energy Production (kWh)				
	Site		By Turbine		
	P50 (Expected Production)	Actual Production	W1	W2	W3
Jun-18	634,000	418,217	145,680	129,185	143,352
Jul-18	527,000	333,148	111,051	106,463	115,634
Aug-18	449,000	397,006	132,087	128,358	136,562
Sep-18	610,000	436,562	146,398	140,120	150,044
Oct-18	990,000	742,865	258,249	240,231	244,385
Nov-18	1,123,000	835,265	299,643	268,523	267,099
Dec-18	1,153,000	990,824	341,399	318,787	330,638
Jan-19	1,306,000	1,228,632	427,801	398,420	402,411
Feb-19	1,137,000	898,559	307,088	293,895	297,576
Mar-19	1,134,000	1,123,196	385,735	362,764	374,697
Apr-19	1,176,000	1,017,622	347,943	331,201	338,478
May-19	927,000	753,487	261,344	247,282	244,861
Jun-19	634,000	653,072	224,916	205,888	222,268
Production 2019 (ytd) (kWh)	6,314,000	5,674,568	1,954,827	1,839,450	1,880,291
Total Production (kWh)*	11,166,000	9,410,238	3,243,654	3,041,932	3,124,653
Capacity Factor*	23.87%		*Value calculated over the last 12 months		

B. Site Energy Production Graph

June-2019

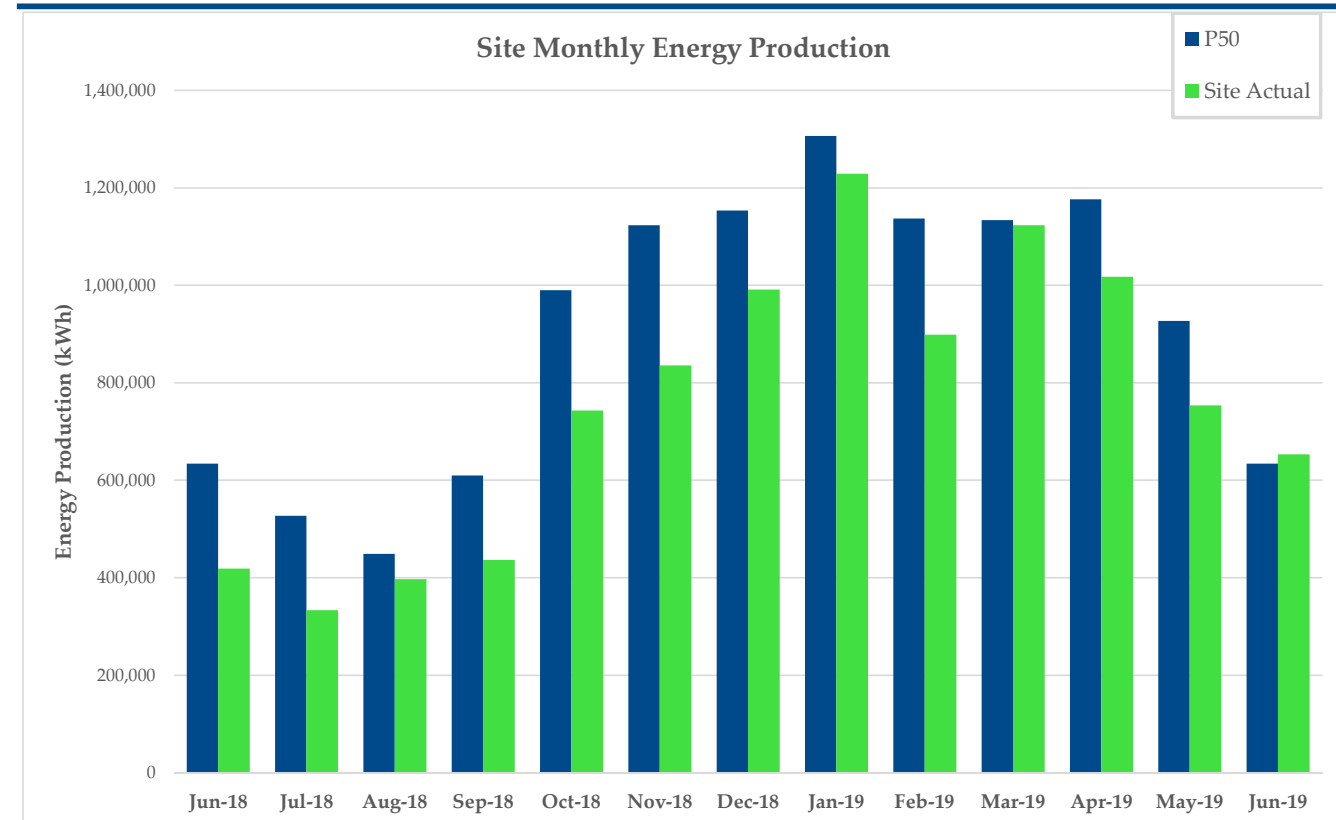

C. Safety Summary

	This Month	Project Cumulative
Recordable Incident(s)	0	0
Near Miss(es)	0	0

D. Planned Maintenance Events

Date	Event	Duration (hr)	Turbine
November-2019	Goldwind 2 Year Maintenance	~15	W1
November-2019	Goldwind 2 Year Maintenance	~15	W2
November-2019	Goldwind 2 Year Maintenance	~15	W3

E. Actual Maintenance Events

Date	Event	Planned/Unplanned	Duration (hrs)	Turbine
6/5/2019	Pitch Inductive Sensor Error	Unplanned	6.77	W3
6/6/2019	Pitch Inductive Sensor Error	Unplanned	10.63	W3
6/18/2019	Brake Maintenance	Planned	3.40	W3

F. Turbine Availability & Downtime

Availability	This Month	Year To Date
W1	100.00%	99.73%
W2	99.11%	99.79%
W3	97.58%	99.44%
Avg	98.90%	99.66%

Downtime (hr)	This Month	Year To Date
W1	8.32	144.17
W2	14.73	146.10
W3	22.35	211.74
Total	45.40	502.01

G. Billed Data

Meter Reading (Date/Time)	6/21/2019 12:00 AM
Meter To Date Produced	15,613,347 kWh
Meter To Date Consumed	43,782 kWh
Last Reading Produced	14,909,698 kWh
Last Reading Consumed	41,531 kWh
Billed kWh	701,398 kWh
Next Meter Reading	7/21/2019 12:00 AM

H. Report Notes and Comments

***August 2018 production data includes three days read from meter due to SCADA issue.