



Monthly Report
August-2019



A. Site Energy Production Summary*

	Energy Production (kWh)			
	Site		By Turbine	
	P50 (Expected Production)	Actual Production	W1	W2
Aug-18	404,000	365,718	185,127	180,591
Sep-18	346,000	399,326	202,515	196,811
Oct-18	649,000	709,011	359,965	349,046
Nov-18	846,000	616,294	307,095	309,199
Dec-18	1,022,000	737,042	376,399	360,643
Jan-19	867,000	942,829	486,578	456,251
Feb-19	908,000	707,729	356,127	351,602
Mar-19	803,000	848,505	435,774	412,731
Apr-19	949,000	852,957	427,080	425,877
May-19	603,000	615,463	306,237	309,226
Jun-19	422,000	474,817	240,372	234,445
Jul-19	383,000	338,373	171,861	166,512
Aug-19	402,000	355,979	180,172	175,807
Production 2019 (ytd) (kWh)	5,337,000	5,136,652	2,604,201	2,532,451
Total Production (kWh)*	8,200,000	7,598,325	3,850,175	3,748,150
Capacity Factor*	28.91%		*Value calculated over the last 12 months	

C. Safety Summary

	This Month	Project Cumulative
Recordable Incident(s)	0	0
Near Miss(es)	0	0

D. Planned Maintenance Events


Date	Event	Duration (hr)	Turbine
December-2019	Goldwind 4 Year Maintenance	~15	W1
December-2019	Goldwind 4 Year Maintenance	~15	W2

E. Actual Maintenance Events

Date	Event	Planned/Unplanned	Duration (hr)	Turbine
------	-------	-------------------	---------------	---------

B. Site Energy Production Graph

August-2019

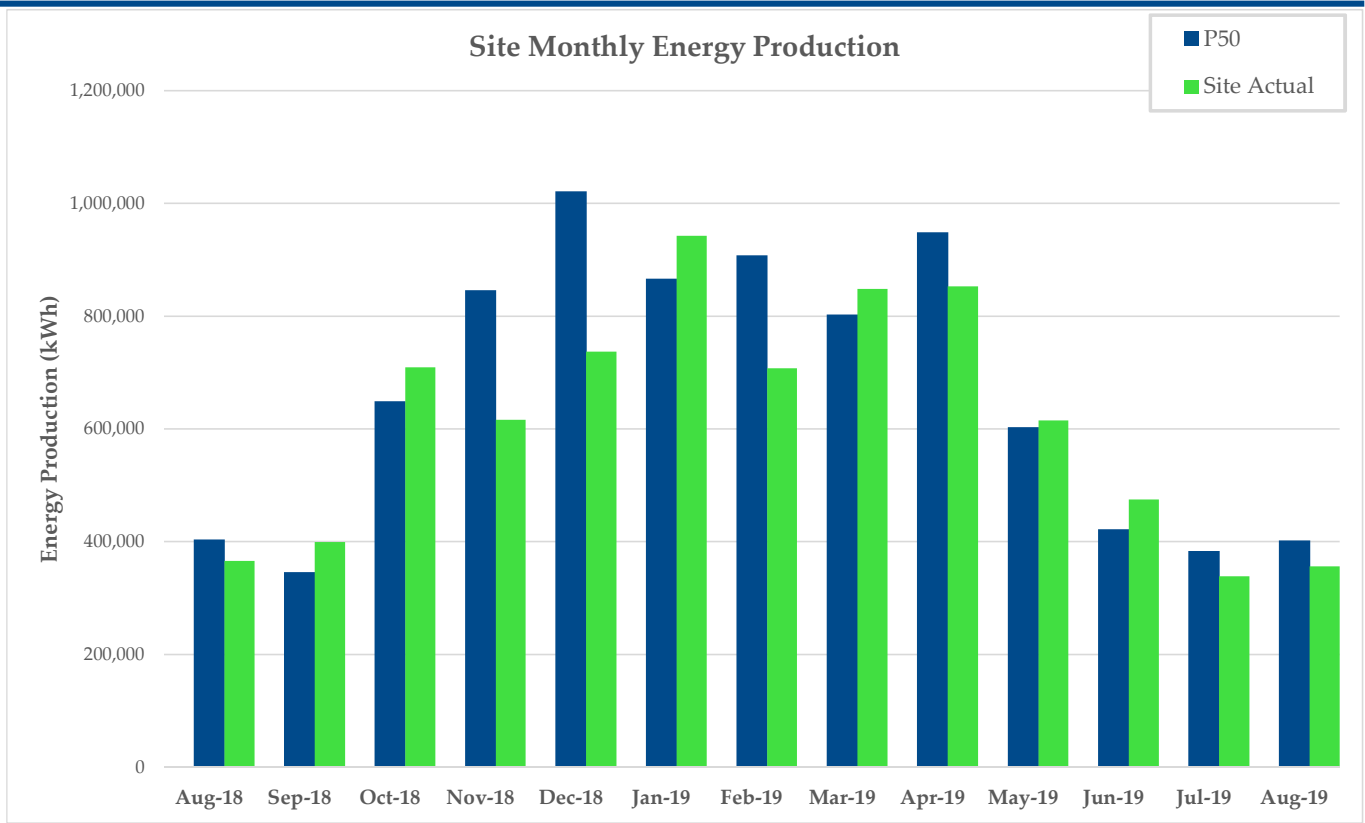

F. Turbine Availability & Downtime

Availability	This Month	Annual To Date
W1	100.00%	99.75%
W2	99.97%	99.50%
Avg	99.98%	99.63%
Downtime (hr)	This Month	Annual To Date
W1	4.30	206.12
W2	3.06	201.1
Total	7.36	407.22

G. Billed Data

Meter Reading (Date/Time)	8/29/2019 12:00 AM
Meter To Date Produced	27,861,780 kWh
Meter To Date Consumed	57,623 kWh
Last Reading Produced	27,534,407 kWh
Last Reading Consumed	56,076 kWh
Billed kWh	325,825 kWh
Next Meter Reading	9/29/2019 12:00 AM

H. Report Notes and Comments

*Change to P50 Expected Production due to Material Change in Circumstance.