


A. Site Energy Production Summary

	Energy Production (kWh)					***
	Site		By Turbine			
	P50 (Expected Production)	Actual Production	W1	W2	W3	
Aug-18	449,000	397,006	132,087	128,358	136,562	
Sep-18	610,000	436,562	146,398	140,120	150,044	
Oct-18	990,000	742,865	258,249	240,231	244,385	
Nov-18	1,123,000	835,265	299,643	268,523	267,099	
Dec-18	1,153,000	990,824	341,399	318,787	330,638	
Jan-19	1,306,000	1,228,632	427,801	398,420	402,411	
Feb-19	1,137,000	898,559	307,088	293,895	297,576	
Mar-19	1,134,000	1,123,196	385,735	362,764	374,697	
Apr-19	1,176,000	1,017,622	347,943	331,201	338,478	
May-19	927,000	753,487	261,344	247,282	244,861	
Jun-19	634,000	653,072	224,916	205,888	222,268	
Jul-19	527,000	357,677	119,328	116,242	122,107	
Aug-19	449,000	423,670	145,657	134,069	143,944	
Production 2019 (ytd) (kWh)	7,290,000	6,455,915	2,219,812	2,089,761	2,146,342	
Total Production (kWh)*	11,166,000	9,461,431	3,265,501	3,057,422	3,138,508	
Capacity Factor*	24.00%		*Value calculated over the last 12 months			

B. Site Energy Production Graph

August-2019

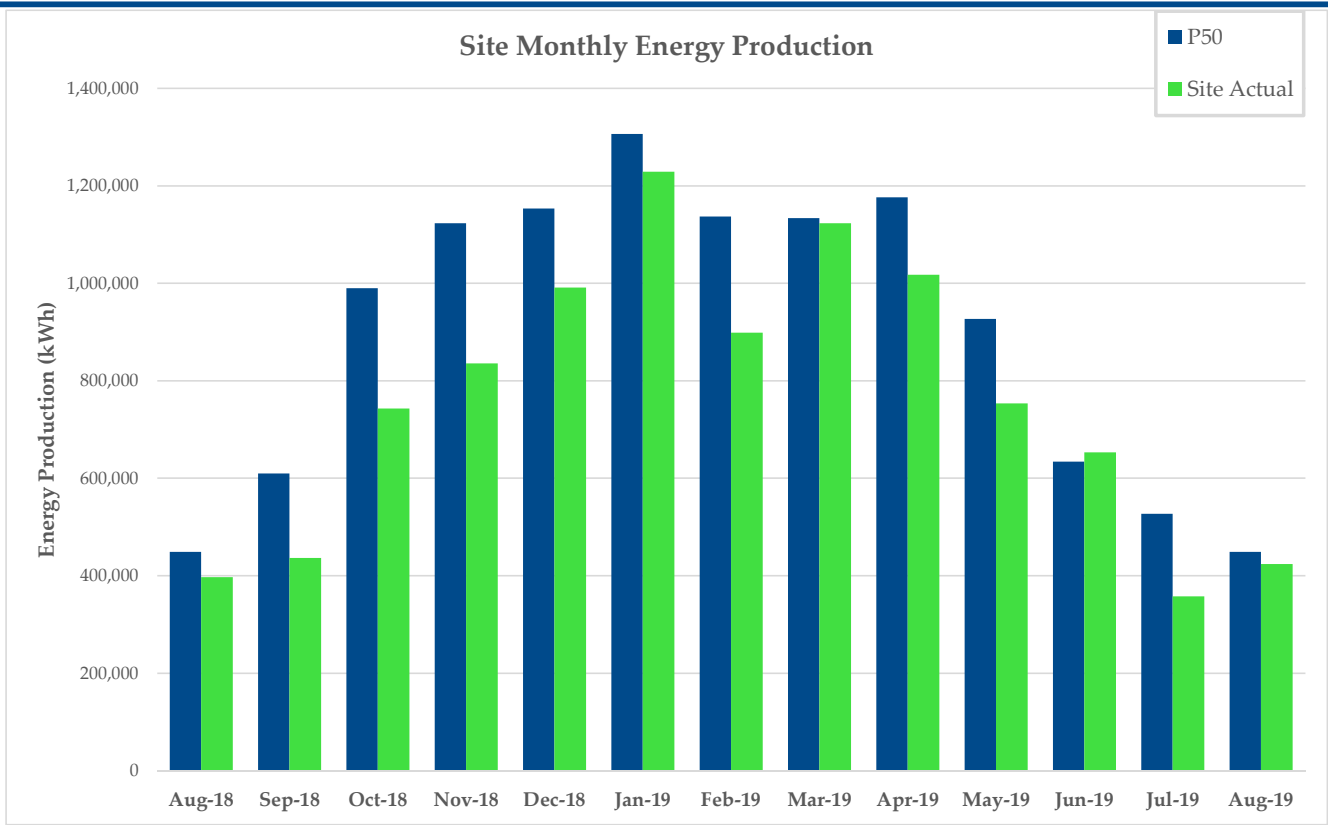

C. Safety Summary

	This Month	Project Cumulative
Recordable Incident(s)	0	0
Near Miss(es)	0	0

D. Planned Maintenance Events

Date	Event	Duration (hr)	Turbine
November-2019	Goldwind 2 Year Maintenance	~15	W1
November-2019	Goldwind 2 Year Maintenance	~15	W2
November-2019	Goldwind 2 Year Maintenance	~15	W3

E. Actual Maintenance Events

Date	Event	Planned/Unplanned	Duration (hrs)	Turbine
------	-------	-------------------	----------------	---------

F. Turbine Availability & Downtime

Availability	This Month	Year To Date
W1	100.00%	99.80%
W2	100.00%	99.85%
W3	100.00%	99.58%
Avg	100.00%	99.74%

Downtime (hr)	This Month	Year To Date
W1	1.64	146.94
W2	1.64	148.65
W3	1.64	214.29
Total	4.92	509.88

G. Billed Data

Meter Reading (Date/Time)	8/21/2019 12:00 AM
Meter To Date Produced	16,293,816 kWh
Meter To Date Consumed	51,567 kWh
Last Reading Produced	15,962,623 kWh
Last Reading Consumed	47,612 kWh
Billed kWh	327,237 kWh
Next Meter Reading	9/21/2019 12:00 AM

H. Report Notes and Comments

***August 2018 production data includes three days read from meter due to SCADA issue.