


A. Site Energy Production Summary

	Energy Production (kWh)				
	Site		By Turbine		
	P50 (Expected Production)	Actual Production	WG1	WG2	WG3
Oct-18	1,051,000	679,703	238,340	226,535	214,828
Nov-18	1,224,000	816,424	287,961	268,275	260,188
Dec-18	1,217,000	1,053,069	363,815	347,442	341,812
Jan-19	1,343,000	952,287	325,224	314,810	312,253
Feb-19	1,133,000	935,828	324,947	304,407	306,474
Mar-19	1,312,000	1,099,016	403,803	310,433	384,780
Apr-19	1,272,000	1,210,371	406,808	400,071	403,492
May-19	974,000	805,247	272,374	265,063	267,810
Jun-19	714,000	750,094	254,695	247,674	247,725
Jul-19	566,000	437,042	130,830	155,812	150,400
Aug-19	514,000	482,340	171,490	156,018	154,832
Sep-19	716,000	597,745	203,475	201,926	192,344
Oct-19	1,051,000	-	-	-	-
Production 2019 (ytd) (kWh)	8,544,000	7,269,970	2,493,646	2,356,214	2,420,110
Total Production (kWh)*	12,036,000	9,819,166	3,383,762	3,198,466	3,236,938
Capacity Factor*	24.91%		*Value calculated over the last 12 months		

B. Site Energy Production Graph

September-2019

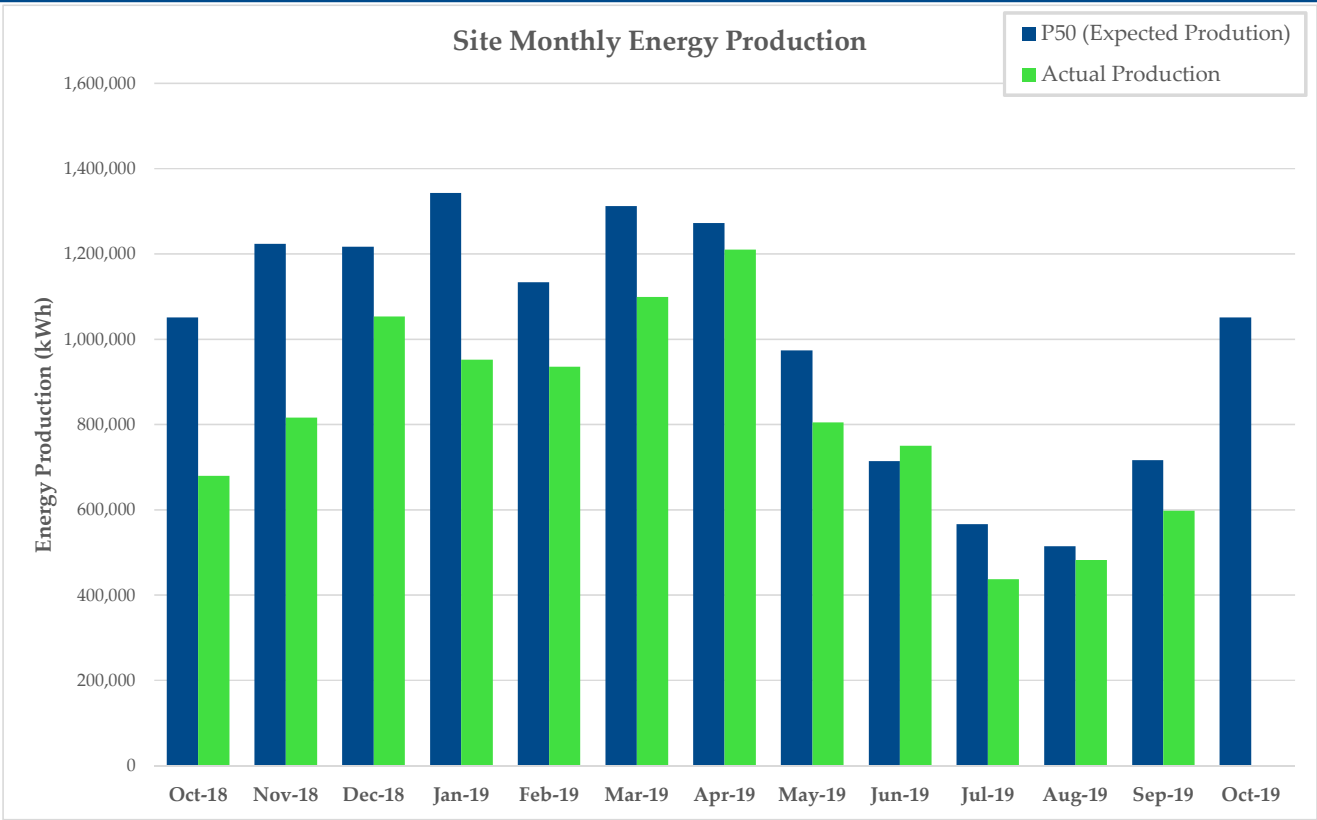

C. Safety Summary

	This Month	Project Cumulative
Recordable Incident(s)	0	0
Near Miss(es)	0	0

D. Planned Maintenance Events*

Date	Event	Duration (hr)	Turbine
October-2019	Goldwind 6 Month Maintenance	~8	WG 1
October-2019	Goldwind 6 Month Maintenance	~8	WG 2
October-2019	Goldwind 6 Month Maintenance	~8	WG 3

E. Actual Maintenance Events

Date	Event	Planned/ Unplanned	Duration (hrs)	Turbine
9/3/2019	Generator Temperature Comparing Error	Unplanned	6.46	WG 3
9/4/2019	Generator Temperature Comparing Error	Unplanned	4.81	WG 3
9/8-9/2019	Grid Event	Unplanned	23.00	WG 1, WG 2, WG 3
9/30/2019	Owner/Operator Maintenance	Unplanned	4.68	WG 3

F. Turbine Availability & Downtime**

Availability	This Month	Year To Date
WG1	99.80%	97.35%
WG2	99.82%	99.63%
WG3	98.29%	99.79%
Avg	99.30%	98.92%

Downtime (hr)	This Month	Year To Date
WG1	24.44	480.91
WG2	24.30	548.55
WG3	39.98	311.52
Total	88.72	1340.98

G. Billed Data

Meter Reading (Date/Time)	9/29/2019 12:00 AM
Meter To Date Produced	9,544,450 kWh
Meter To Date Consumed	41,416 kWh
Last Reading Produced	8,922,370 kWh
Last Reading Consumed	38,485 kWh
Billed kWh	619,149 kWh
Next Meter Reading	10/29/2019 12:00 AM

H. Report Notes and Comments

*Goldwind Maintenance moved to October.
**Goldwind Availability and Downtime under dispute.