


A. Site Energy Production Summary

	Energy Production (kWh)				
	Site		By Turbine		
	P50 (Expected Production)	Actual Production	W1	W2	W3
Sep-18	610,000	436,562	146,398	140,120	150,044
Oct-18	990,000	742,865	258,249	240,231	244,385
Nov-18	1,123,000	835,265	299,643	268,523	267,099
Dec-18	1,153,000	990,824	341,399	318,787	330,638
Jan-19	1,306,000	1,228,632	427,801	398,420	402,411
Feb-19	1,137,000	898,559	307,088	293,895	297,576
Mar-19	1,134,000	1,123,196	385,735	362,764	374,697
Apr-19	1,176,000	1,017,622	347,943	331,201	338,478
May-19	927,000	753,487	261,344	247,282	244,861
Jun-19	634,000	653,072	224,916	205,888	222,268
Jul-19	527,000	357,677	119,328	116,242	122,107
Aug-19	449,000	423,670	145,657	134,069	143,944
Sep-19	610,000	414,660	141,275	131,797	141,588
Production 2019 (ytd) (kWh)	7,900,000	6,870,575	2,361,087	2,221,558	2,287,930
Total Production (kWh)*	11,166,000	9,439,529	3,260,378	3,049,099	3,130,052
Capacity Factor*	23.95%		*Value calculated over the last 12 months		

B. Site Energy Production Graph

September-2019

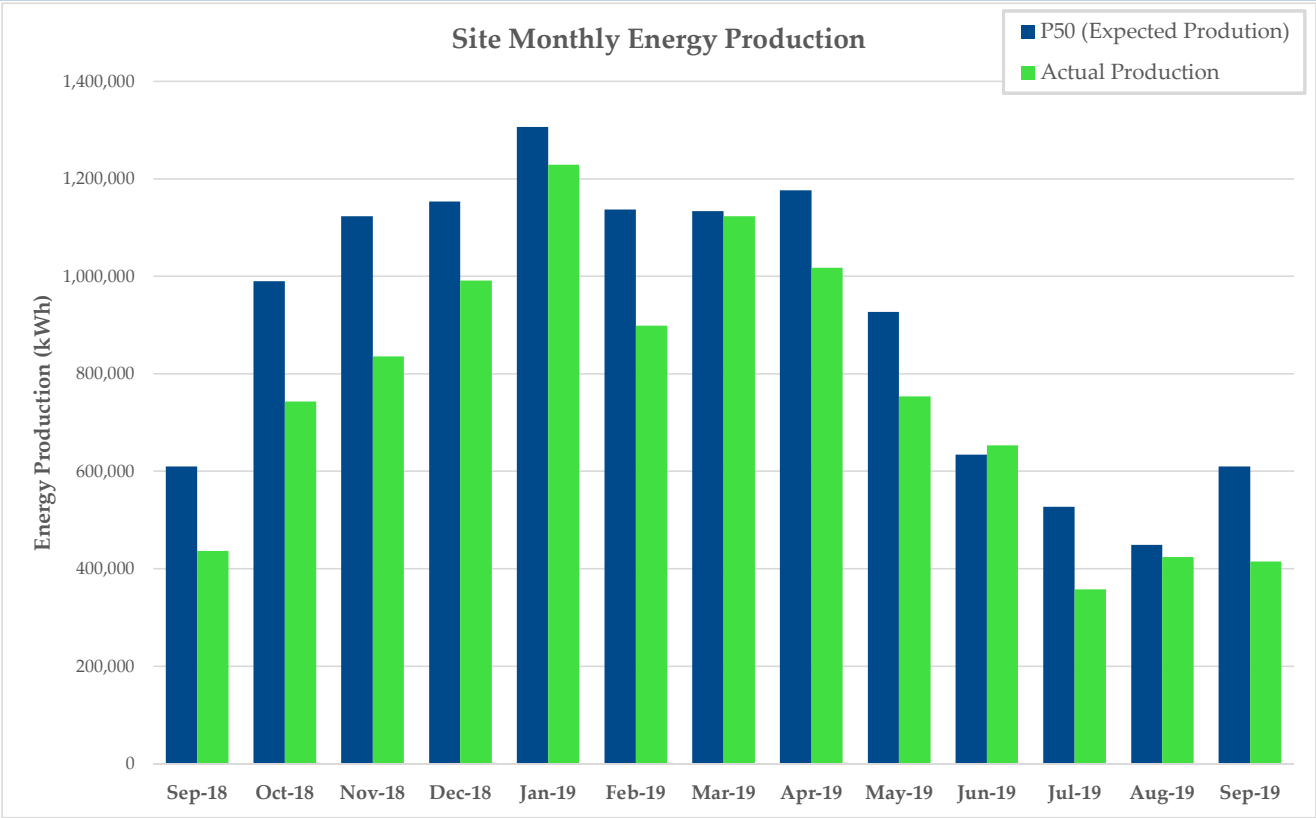

C. Safety Summary

	This Month	Project Cumulative
Recordable Incident(s)	0	0
Near Miss(es)	0	0

D. Planned Maintenance Events*

Date	Event	Duration (hr)	Turbine
October-2019	Goldwind 2 Year Maintenance	~15	W1
October-2019	Goldwind 2 Year Maintenance	~15	W2
October-2019	Goldwind 2 Year Maintenance	~15	W3

E. Actual Maintenance Events

Date	Event	Planned/Unplanned	Duration (hrs)	Turbine
9/1/2019	Safety Chain Error - Weather Alert Delay	Unplanned	10.32	W3
9/2/2019	Safety Chain Error	Unplanned	9.30	W3
9/18/2019	Hydraulic Motor Feedback Error	Unplanned	5.19	W2
9/20/2019	Hydraulic Motor Feedback Error	Unplanned	5.13	W2
9/27/2019	Goldwind 2 Year Maintenance	Planned	3.35	W1, W2, W3
9/27/2019	Grid Event	Unplanned	11.50	W1, W2, W3
9/28/2019	Grid Event	Unplanned	8.21	W1, W2, W3
9/30/2019	Grid Event	Unplanned	8.23	W1, W2, W3

F. Turbine Availability & Downtime

Availability	This Month	Year To Date
W1	100.00%	99.82%
W2	98.06%	99.65%
W3	98.50%	99.46%
Avg	98.85%	99.64%

Downtime (hr)	This Month	Year To Date
W1	33.18	180.12
W2	47.14	195.79
W3	54.30	268.59
Total	134.62	644.50

G. Billed Data

Meter Reading (Date/Time)	9/21/2019 12:00 AM
Meter To Date Produced	16,725,893 kWh
Meter To Date Consumed	53,775 kWh
Last Reading Produced	16,293,816 kWh
Last Reading Consumed	51,567 kWh
Billed kWh	429,870 kWh
Next Meter Reading	10/21/2019 12:00 AM

H. Report Notes and Comments

*Goldwind 2 Year Maintenance to continue in October.