


A. Site Energy Production Summary

	Energy Production (kWh)				
	Site		By Turbine		
	P50 (Expected Production)	Actual Production	W1	W2	W3
Oct-18	990,000	742,865	258,249	240,231	244,385
Nov-18	1,123,000	835,265	299,643	268,523	267,099
Dec-18	1,153,000	990,824	341,399	318,787	330,638
Jan-19	1,306,000	1,228,632	427,801	398,420	402,411
Feb-19	1,137,000	898,559	307,088	293,895	297,576
Mar-19	1,134,000	1,123,196	385,735	362,764	374,697
Apr-19	1,176,000	1,017,622	347,943	331,201	338,478
May-19	927,000	753,487	261,344	247,282	244,861
Jun-19	634,000	653,072	224,916	205,888	222,268
Jul-19	527,000	357,677	119,328	116,242	122,107
Aug-19	449,000	423,670	145,657	134,069	143,944
Sep-19	610,000	414,660	141,275	131,797	141,588
Oct-19	990,000	916,038	308,623	294,939	312,476
Production 2019 (ytd) (kWh)	8,890,000	7,786,613	2,669,710	2,516,497	2,600,406
Total Production (kWh)*	11,166,000	9,612,702	3,310,752	3,103,807	3,198,143
Capacity Factor*	24.39%		*Value calculated over the last 12 months		

B. Site Energy Production Graph

October-2019

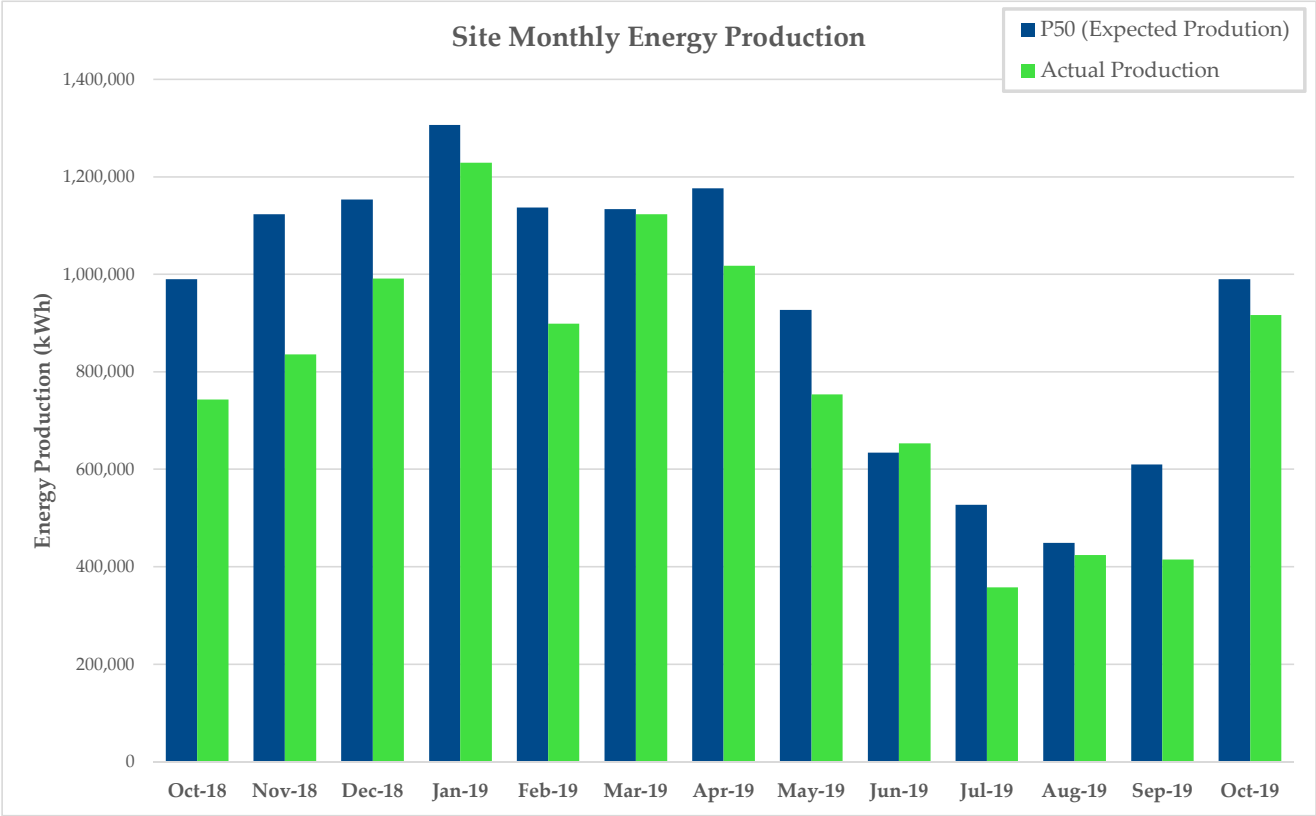

C. Safety Summary

	This Month	Project Cumulative
Recordable Incident(s)	0	0
Near Miss(es)	0	0

D. Planned Maintenance Events*

Date	Event	Duration (hr)	Turbine
November-2019	Goldwind 2 Year Maintenance	~15	W1
November-2019	Goldwind 2 Year Maintenance	~15	W2
November-2019	Goldwind 2 Year Maintenance	~15	W3

E. Actual Maintenance Events

Date	Event	Planned/Unplanned	Duration (hrs)	Turbine
10/3/2019	Hydraulic Motor Error	Unplanned	5.15	W2
10/5/2019	Hydraulic Motor Error	Unplanned	4.23	W2
10/8/2019	Goldwind 2 Year Maintenance	Planned	6.33	W3
10/9/2019	Goldwind 2 Year Maintenance	Planned	6.01	W2

F. Turbine Availability & Downtime

Availability	This Month	Year To Date
W1	100.00%	99.83%
W2	98.67%	99.55%
W3	100.00%	99.52%
Avg	99.56%	99.63%

Downtime (hr)	This Month	Year To Date
W1	4.57	184.69
W2	20.54	216.33
W3	10.60	279.19
Total	35.71	680.21

G. Billed Data

Meter Reading (Date/Time)	10/21/2019 12:00 AM
Meter To Date Produced	17,399,984 kWh
Meter To Date Consumed	55,341 kWh
Last Reading Produced	16,725,893 kWh
Last Reading Consumed	53,775 kWh
Billed kWh	672,525 kWh
Next Meter Reading	11/21/2019 12:00 AM

H. Report Notes and Comments

*Goldwind 2 Year Maintenance to continue in November.