


A. Site Energy Production Summary

	Energy Production (kWh)				
	Site		By Turbine		
	P50 (Expected Production)	Actual Production	W1	W2	W3
Nov-18	1,123,000	835,265	299,643	268,523	267,099
Dec-18	1,153,000	990,824	341,399	318,787	330,638
Jan-19	1,306,000	1,228,632	427,801	398,420	402,411
Feb-19	1,137,000	898,559	307,088	293,895	297,576
Mar-19	1,134,000	1,123,196	385,735	362,764	374,697
Apr-19	1,176,000	1,017,622	347,943	331,201	338,478
May-19	927,000	753,487	261,344	247,282	244,861
Jun-19	634,000	653,072	224,916	205,888	222,268
Jul-19	527,000	357,677	119,328	116,242	122,107
Aug-19	449,000	423,670	145,657	134,069	143,944
Sep-19	610,000	414,660	141,275	131,797	141,588
Oct-19	990,000	916,038	308,623	294,939	312,476
Nov-19	1,123,000	846,849	291,098	273,259	282,492
Production 2019 (ytd) (kWh)	10,013,000	8,633,462	2,960,808	2,789,756	2,882,898
Total Production (kWh)*	11,166,000	9,624,286	3,302,207	3,108,543	3,213,536
Capacity Factor*	24.41%		*Value calculated over the last 12 months		

B. Site Energy Production Graph

November-2019

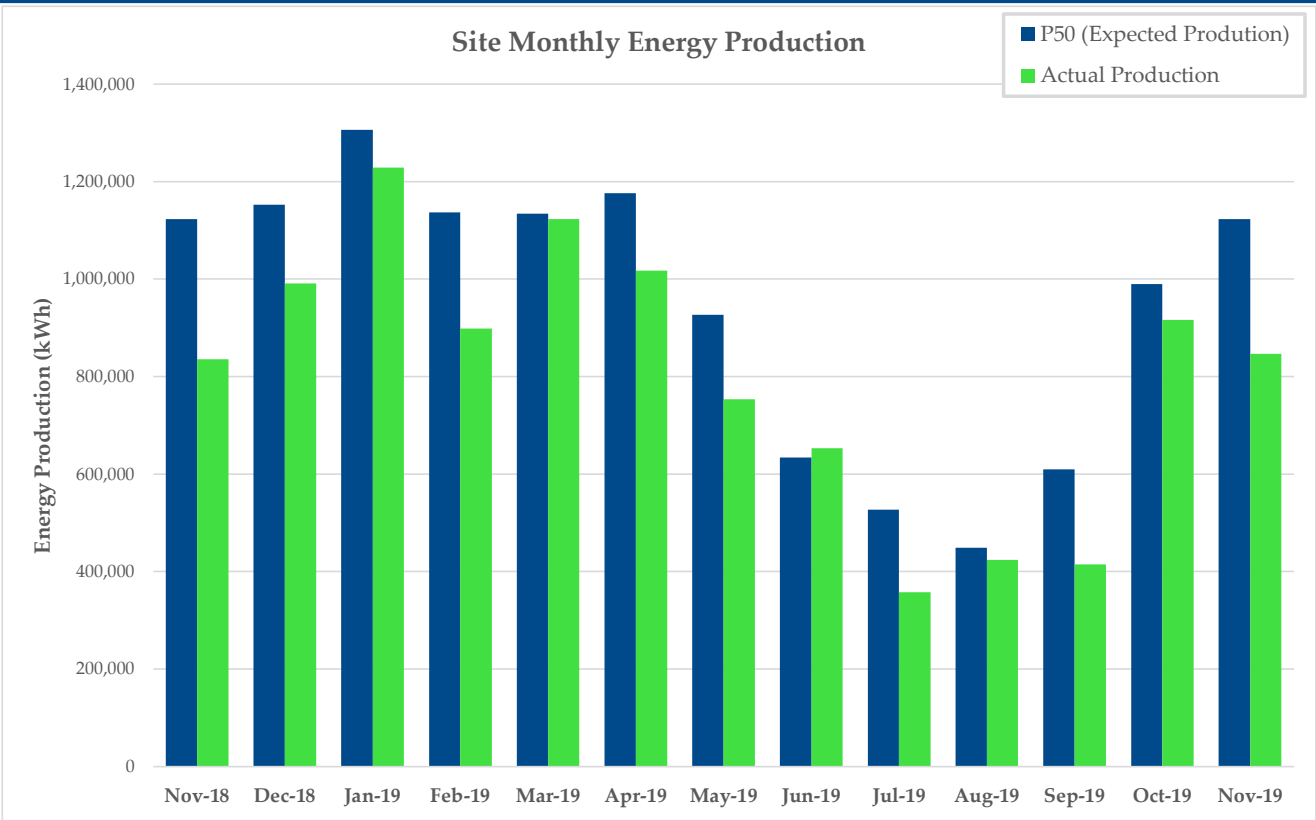

C. Safety Summary

	This Month	Project Cumulative
Recordable Incident(s)	0	0
Near Miss(es)	0	0

D. Planned Maintenance Events*

Date	Event	Duration (hr)	Turbine
December-2019	Goldwind 2 Year Maintenance	~15	W1
December-2019	Goldwind 2 Year Maintenance	~15	W2
December-2019	Goldwind 2 Year Maintenance	~15	W3

E. Actual Maintenance Events

Date	Event	Planned/Unplanned	Duration (hrs)	Turbine
11/27/2019	High Wind Event	Unplanned	8.79	W1, W2, W3

F. Turbine Availability & Downtime

Availability	This Month	Year To Date
W1	100.00%	99.85%
W2	100.00%	99.59%
W3	100.00%	99.56%
Avg	100.00%	99.67%

Downtime (hr)	This Month	Year To Date
W1	8.79	193.48
W2	8.79	225.12
W3	8.79	287.98
Total	26.37	706.58

G. Billed Data

Meter Reading (Date/Time)	11/21/2019 12:00 AM
Meter To Date Produced	18,247,757 kWh
Meter To Date Consumed	57,110 kWh
Last Reading Produced	17,399,984 kWh
Last Reading Consumed	55,341 kWh
Billed kWh	846,004 kWh
Next Meter Reading	12/21/2019 12:00 AM

H. Report Notes and Comments

*Goldwind 2 Year Maintenance to continue in December.