


A. Site Energy Production Summary

	Energy Production (kWh)				
	Site		By Turbine		
	P50 (Expected Production)	Actual Production	W1	W2	W3
Jan-19	1,306,000	1,228,632	427,801	398,420	402,411
Feb-19	1,137,000	898,559	307,088	293,895	297,576
Mar-19	1,134,000	1,123,196	385,735	362,764	374,697
Apr-19	1,176,000	1,017,622	347,943	331,201	338,478
May-19	927,000	753,487	261,344	247,282	244,861
Jun-19	634,000	653,072	224,916	205,888	222,268
Jul-19	527,000	357,677	119,328	116,242	122,107
Aug-19	449,000	423,670	145,657	134,069	143,944
Sep-19	610,000	414,660	141,275	131,797	141,588
Oct-19	990,000	916,038	308,623	294,939	312,476
Nov-19	1,123,000	846,849	291,098	273,259	282,492
Dec-19	1,153,000	1,139,609	398,017	365,419	376,173
Jan-20	1,306,000	1,063,984	370,096	346,270	347,618
Production 2020 (ytd) (kWh)	1,306,000	1,063,984	370,096	346,270	347,618
Total Production (kWh)*	11,166,000	9,608,423	3,301,120	3,103,025	3,204,278
Capacity Factor*	24.37%		*Value calculated over the last 12 months		

B. Site Energy Production Graph

January-2020

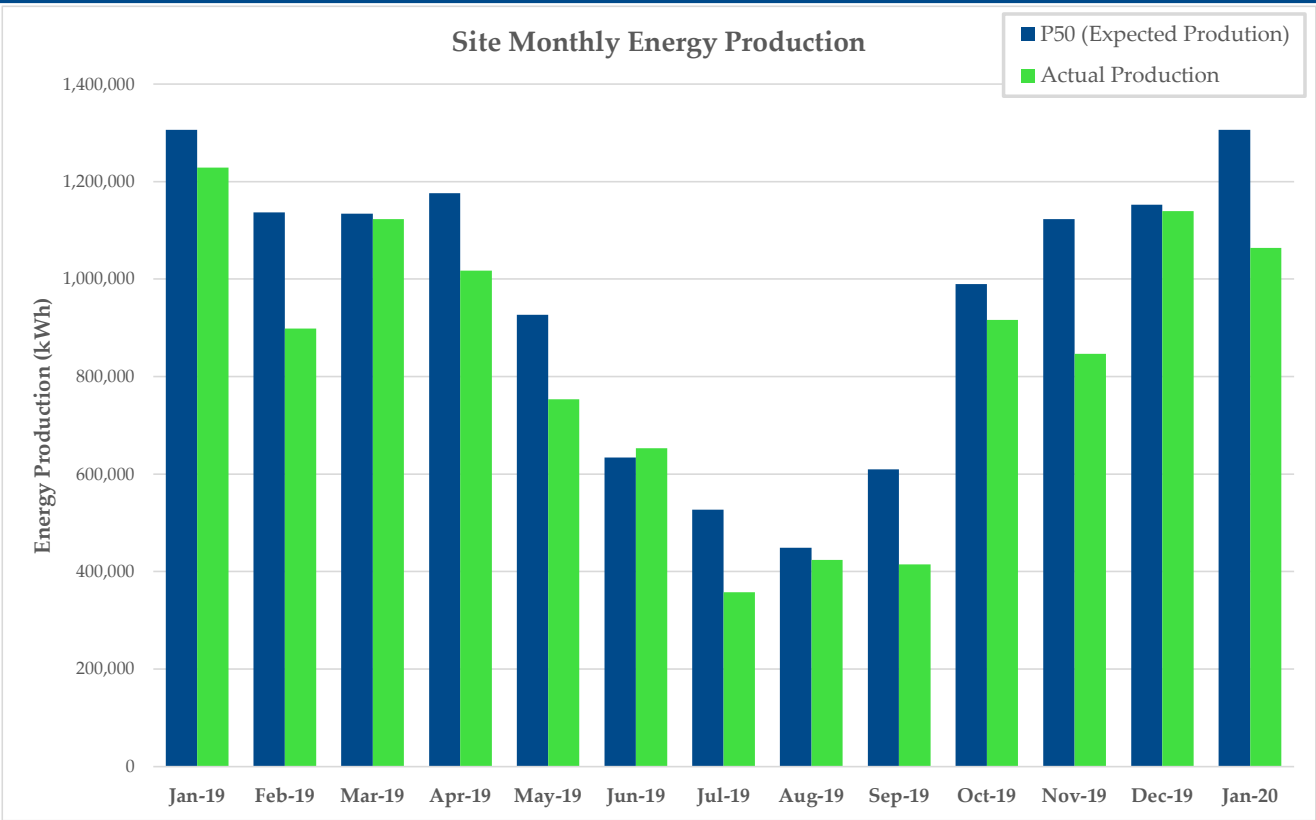

C. Safety Summary

	This Month	Project Cumulative
Recordable Incident(s)	0	0
Near Miss(es)	0	0

D. Planned Maintenance Events*

Date	Event	Duration (hr)	Turbine
March-2020	Goldwind 2.5 Year Maintenance	~8	W1
March-2020	Goldwind 2.5 Year Maintenance	~8	W2
March-2020	Goldwind 2.5 Year Maintenance	~8	W3

E. Actual Maintenance Events

Date	Event	Planned/Unplanned	Duration (hrs)	Turbine
1/1/2020	Icing Event	Unplanned	9.25	W1
1/1/2020	Icing Event	Unplanned	9.26	W2
1/1/2020	Icing Event	Unplanned	14.11	W3
1/11-12/2020	High Wind Event	Unplanned	4.42	W 1, 2, 3
1/18/2020	Icing Event	Unplanned	5.02	W1
1/18/2020	Icing Event	Unplanned	5.09	W2
1/18/2020	Icing Event	Unplanned	5.41	W3
1/21/2020	Yaw Warning Investigation	Unplanned	5.38	W2

F. Turbine Availability & Downtime

Availability	This Month	Year To Date
W1	99.84%	99.84%
W2	99.23%	99.23%
W3	100.00%	100.00%
Avg	99.69%	99.69%

Downtime (hr)	This Month	Year To Date
W1	21.25	21.25
W2	25.12	25.12
W3	24.73	24.73
Total	71.10	71.10

G. Billed Data

Meter Reading (Date/Time)	1/21/2020 12:00 AM
Meter To Date Produced	20,572,269 kWh
Meter To Date Consumed	60,519 kWh
Last Reading Produced	19,353,475 kWh
Last Reading Consumed	58,643 kWh
Billed kWh	1,216,918 kWh
Next Meter Reading	2/21/2020 12:00 AM

H. Report Notes and Comments

*Goldwind 2 Year Maintenance was completed in October; SCADA issue led to maintenance completion not being correctly logged.