


A. Site Energy Production Summary

	Energy Production (kWh)				
	Site		By Turbine		
	P50 (Expected Production)	Actual Production	W1	W2	W3
Mar-19	1,134,000	1,123,196	385,735	362,764	374,697
Apr-19	1,176,000	1,017,622	347,943	331,201	338,478
May-19	927,000	753,487	261,344	247,282	244,861
Jun-19	634,000	653,072	224,916	205,888	222,268
Jul-19	527,000	357,677	119,328	116,242	122,107
Aug-19	449,000	423,670	145,657	134,069	143,944
Sep-19	610,000	414,660	141,275	131,797	141,588
Oct-19	990,000	916,038	308,623	294,939	312,476
Nov-19	1,123,000	846,849	291,098	273,259	282,492
Dec-19	1,153,000	1,139,609	398,017	365,419	376,173
Jan-20	1,306,000	1,063,984	370,096	346,270	347,618
Feb-20	1,137,000	767,713	286,395	246,834	234,484
Mar-20	1,134,000	1,101,462	378,775	354,544	368,143
Production 2020 (ytd) (kWh)	3,577,000	2,933,159	1,035,266	947,648	950,245
Total Production (kWh)*	11,166,000	9,455,843	3,273,467	3,047,744	3,134,632
Capacity Factor*	23.92%		*Value calculated over the last 12 months		

B. Site Energy Production Graph

March-2020

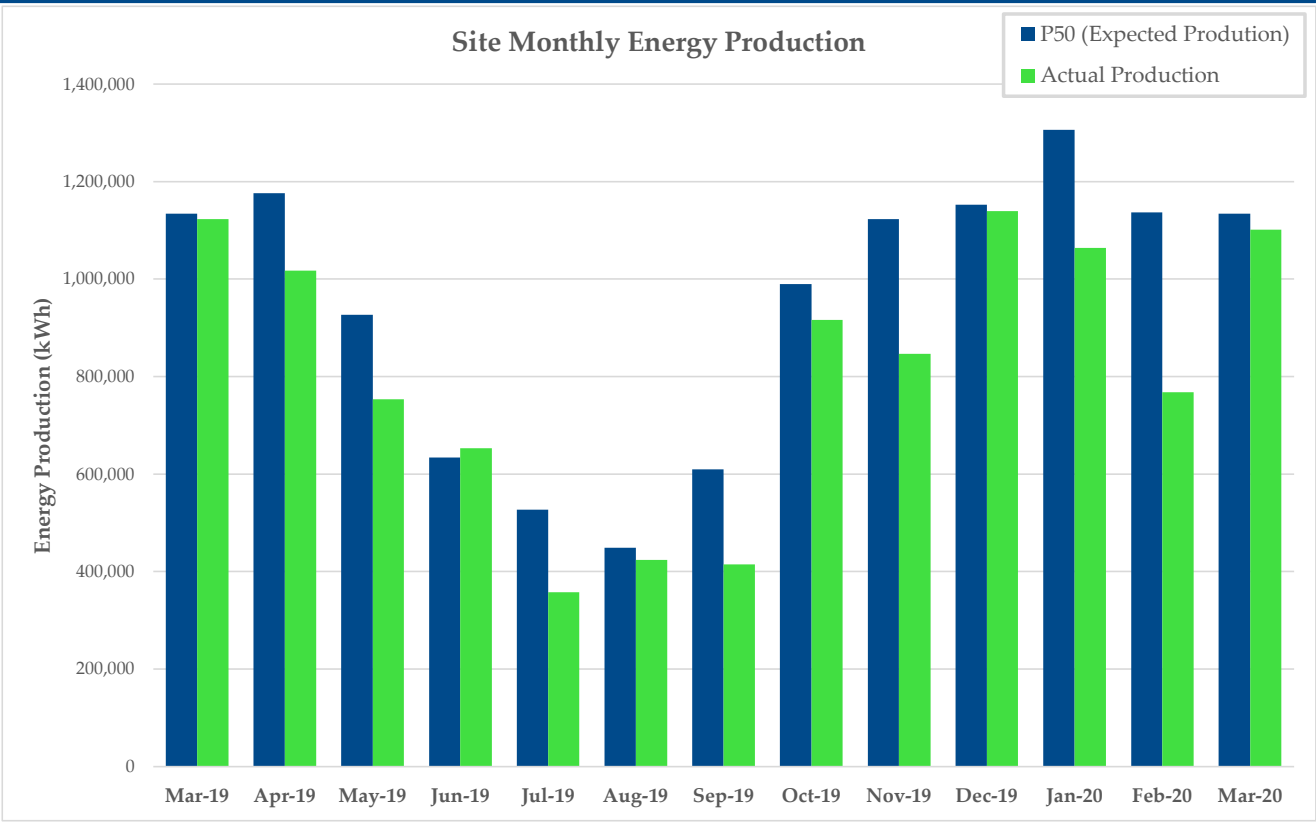

C. Safety Summary

	This Month	Project Cumulative
Recordable Incident(s)	0	0
Near Miss(es)	0	0

D. Planned Maintenance Events8

Date	Event	Duration (hr)	Turbine
April-2020	Goldwind 2.5 Year Maintenance	~8	W1
April-2020	Goldwind 2.5 Year Maintenance	~8	W2
April-2020	Goldwind 2.5 Year Maintenance	~8	W3

E. Actual Maintenance Events

Date	Event	Planned/Unplanned	Duration (hrs)	Turbine
3/6/2020	Yaw System Troubleshooting	Unplanned	4.50	W2

F. Turbine Availability & Downtime

Availability	This Month	Year To Date
W1	99.91%	99.92%
W2	99.34%	99.52%
W3	99.94%	99.98%
Avg	99.73%	99.81%

Downtime (hr)	This Month	Year To Date
W1	2.74	98.85
W2	7.35	138.41
W3	2.35	191.25
Total	12.44	428.51

G. Billed Data

Meter Reading (Date/Time)	3/21/2020 12:00 AM
Meter To Date Produced	22,296,661 kWh
Meter To Date Consumed	64,975 kWh
Last Reading Produced	21,204,867 kWh
Last Reading Consumed	63,488 kWh
Billed kWh	1,090,307 kWh
Next Meter Reading	4/21/2020 12:00 AM

H. Report Notes and Comments

*Goldwind 2.5 Year Maintenance moved to April.