



BALL CORPORATION - ZEPHYR WIND PROJECT


North Findlay Wind Campus, Findlay, OH

A. Site Energy Production Summary

	Energy Production (kWh)				
	Site		By Turbine		
	P50 (Expected Production)	Actual Production	Z1	Z2	Z3
Apr-19	1,415,000	1,258,163	431,314	415,843	411,006
May-19	900,000	674,985	237,304	222,891	214,790
Jun-19	628,000	682,994	232,437	224,872	225,685
Jul-19	571,000	469,744	167,832	151,963	149,949
Aug-19	598,000	513,686	177,673	167,452	168,561
Sep-19	515,000	585,768	205,203	193,838	186,727
Oct-19	966,000	1,039,656	350,721	348,791	340,144
Nov-19	1,262,000	889,667	312,289	296,145	281,233
Dec-19	1,524,000	1,392,651	483,293	460,120	449,238
Jan-20	1,291,000	1,187,158	410,228	396,206	380,724
Feb-20	1,355,000	963,876	349,562	308,005	306,309
Mar-20	1,197,000	1,162,213	396,502	388,972	376,739
Apr-20	1,415,000	1,077,278	363,770	357,740	355,768
Production 2020 (ytd) (kWh)	5,258,000	4,390,525	1,520,062	1,450,923	1,419,540
Total Production (kWh)*	12,222,000	10,639,676	3,686,814	3,516,995	3,435,867
Capacity Factor*	26.92%		*Value calculated over the last 12 months		

B. Site Energy Production Graph

April-2020

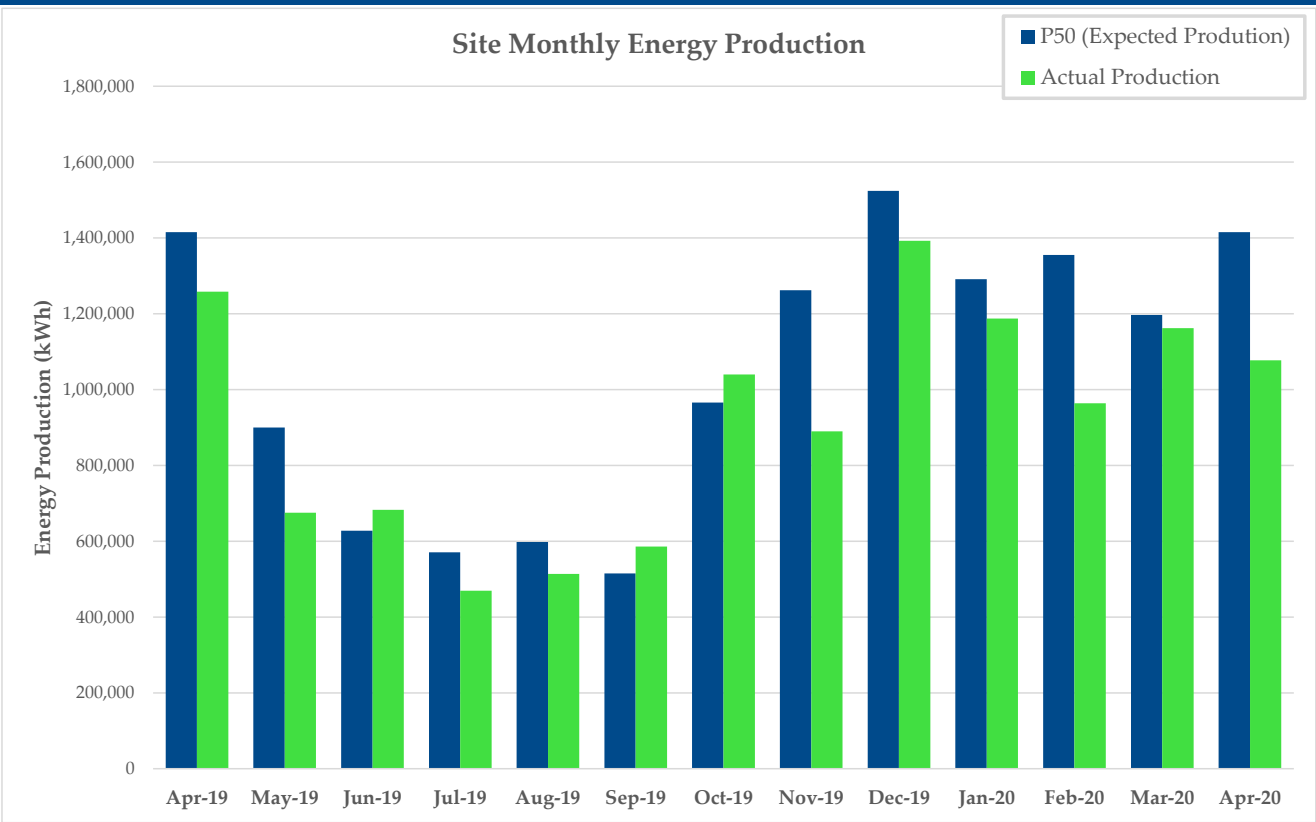

Monthly Report

April-2020



C. Safety Summary

	This Month	Project Cumulative
Recordable Incident(s)	0	0
Near Miss(es)	0	0

D. Planned Maintenance Events

Date	Event	Duration (hr)	Turbine
October-2020	Goldwind 4.5 Year Maintenance	~8	Z1
October-2020	Goldwind 4.5 Year Maintenance	~8	Z2
October-2020	Goldwind 4.5 Year Maintenance	~8	Z3

E. Actual Maintenance Events

Date	Event	Planned/Unplanned	Duration (hrs)	Turbine
4/1/2020	Goldwind 4 Year Maintenance	Planned	4.46	Z2
4/2/2020	Goldwind 4 Year Maintenance	Planned	4.40	Z3
4/15/2020	Goldwind 4 Year Maintenance	Planned	1.99	Z1, Z2, Z3

F. Turbine Availability & Downtime

Availability	This Month	Year To Date
Z1	100.00%	99.76%
Z2	100.00%	99.99%
Z3	100.00%	100.00%
Avg	100.00%	99.92%

Downtime (hr)	This Month	Year To Date
Z1	1.99	70.95
Z2	6.45	115.96
Z3	6.39	98.98
Total	14.83	285.89

G. Billed Data

Meter Reading (Date/Time)	4/18/2020 12:00 AM
Meter To Date Produced	47,070,605 kWh
Meter To Date Consumed	58,876 kWh
Last Reading Produced	46,107,022 kWh
Last Reading Consumed	57,953 kWh
Billed kWh	962,661 kWh
Next Meter Reading	5/19/2020 12:00 AM

H. Report Notes and Comments

*Z3 production total for May and June 2019 is an estimate due to loss of communications.