


A. Site Energy Production Summary

	Energy Production (kWh)	
	Site	
	P50 (Expected Production)	Actual Production
Apr-19	499,000	450,366
May-19	318,000	335,596
Jun-19	222,000	276,978
Jul-19	201,000	166,408
Aug-19	211,000	188,300
Sep-19	182,000	205,853
Oct-19	341,000	395,663
Nov-19	445,000	329,892
Dec-19	537,000	480,035
Jan-20	455,000	427,899
Feb-20	478,000	353,172
Mar-20	422,000	413,290
Apr-20	499,000	397,381
Production 2020 (ytd) (kWh)	1,854,000	1,591,742
Total Production (kWh)*	4,311,000	3,970,467
Capacity Factor*	30.13%	

*Value calculated over the last 12 months

B. Site Energy Production Graph

April-2020

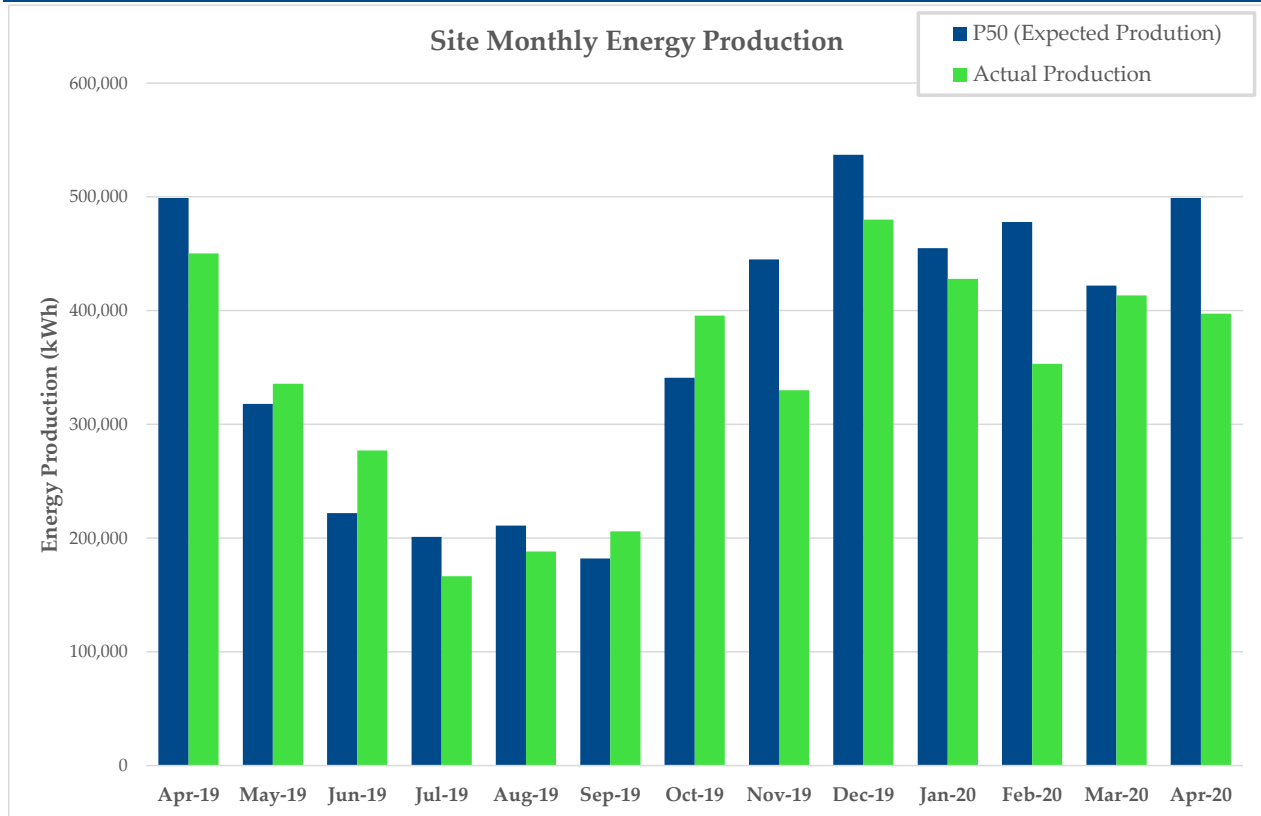

Monthly Report

April-2020

C. Safety Summary

	This Month	Project Cumulative
Recordable Incident(s)	0	0
Near Miss(es)	0	0

D. Planned Maintenance Events

Date	Event	Duration (hr)	Turbine
October-2020	Goldwind 2.5 Year Maintenance	~8	W1

E. Actual Maintenance Events

Date	Event	Planned/Unplanned	Duration (hrs)	Turbine
4/4-5/2020	Blade Pitch Error	Unplanned	15.54	W1
4/16/2020	Goldwind 2 Year Maintenance	Planned	1.75	W1

F. Turbine Availability & Downtime*

Availability	This Month	Year To Date
W1	97.84%	99.45%

Downtime (hr)	This Month	Year To Date
W1	17.29	116.13

G. Billed Data

Meter Reading (Date/Time)	5/1/2020 12:00 AM
Meter To Date Produced	8,893,292 kWh
Meter To Date Consumed	44,013 kWh
Last Reading Produced	8,501,442 kWh
Last Reading Consumed	42,919 kWh
Billed kWh	390,755 kWh
Next Meter Reading	6/1/2020 12:00 AM

H. Report Notes and Comments

*An additional 3 hours of Goldwind 2 Year Maintenance was performed in March, for a total of 11.19 hours of downtime for the month. This was not previously listed due to an error in SCADA reporting.