


A. Site Energy Production Summary

	Energy Production (kWh)			
	Site		By Turbine	
	P50 (Expected Production)	Actual Production	V1	V2
May-19	574,000	605,674	299,620	306,054
Jun-19	429,000	479,262	235,381	243,881
Jul-19	357,000	307,376	145,001	162,375
Aug-19	314,000	369,367	181,572	187,795
Sep-19	449,000	392,366	197,834	194,532
Oct-19	688,000	676,972	338,413	338,559
Nov-19	804,000	631,219	315,003	316,216
Dec-19	822,000	904,108	456,015	448,093
Jan-20	924,000	772,641	385,505	387,136
Feb-20	736,000	640,848	302,976	337,872
Mar-20	794,000	758,754	383,099	375,655
Apr-20	734,000	726,579	367,253	359,326
May-20	574,000	632,754	315,995	316,759
Production 2020 (ytd) (kWh)	3,762,000	3,531,576	1,754,828	1,776,748
Total Production (kWh)*	7,625,000	7,292,246	3,624,047	3,668,199
Capacity Factor*	27.67%		*Value calculated over the last 12 months	

B. Site Energy Production Graph

May-2020

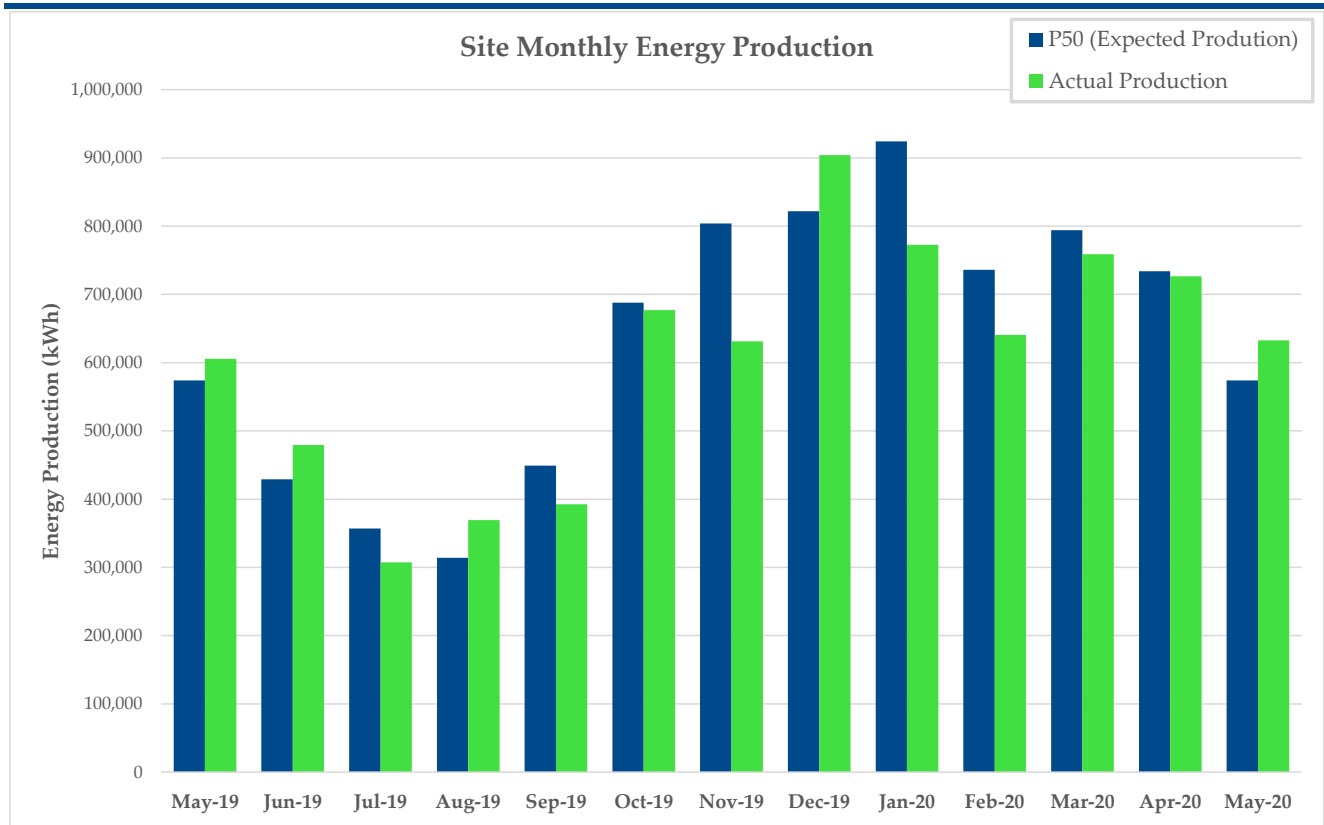

Monthly Report

May-2020

C. Safety Summary

	This Month	Project Cumulative
Recordable Incident(s)	0	0
Near Miss(es)	0	0

D. Planned Maintenance Events*

Date	Event	Duration (hr)	Turbine
June-20	Goldwind 6 Month Maintenance	~8	V1
June-20	Goldwind 6 Month Maintenance	~8	V2

E. Actual Maintenance Events

Date	Event	Planned/Unplanned	Duration (hrs)	Turbine
5/11/2020	Owner/Operator Preventive Maintenance	Planned	4.96	V2
5/12/2020	Owner/Operator Preventive Maintenance	Planned	4.71	V1

F. Turbine Availability & Downtime

Availability	This Month	Year To Date
V1	100.00%	100.00%
V2	100.00%	99.99%
Avg	100.00%	100.00%

Downtime (hr)	This Month	Year To Date
V1	7.72	136.69
V2	9.65	148.99
Total	17.37	285.68

G. Billed Data

Meter Reading (Date/Time)	6/1/2020 12:00 AM
Meter To Date Produced	12,896,880 kWh
Meter To Date Consumed	30,651 kWh
Last Reading Produced	12,279,671 kWh
Last Reading Consumed	29,305 kWh
Billed kWh	615,863 kWh
Next Meter Reading	7/1/2020 12:00 AM

H. Report Notes and Comments

*Goldwind Maintenance moved to June.