



BALL CORPORATION - ZEPHYR WIND PROJECT 1.0 & 2.0
North Findlay Wind Campus, Findlay, Ohio


A. Site Energy Production Summary*

	Energy Production (kWh)							
	Site		By Turbine					
	P50 (Expected Production)	Actual Production	Z1	Z2	Z3	Z4	Z5	Z6
Aug-19	598,000	513,686	177,673	167,452	168,561			
Sep-19	515,000	585,768	205,203	193,838	186,727			
Oct-19	966,000	1,039,656	350,721	348,791	340,144			
Nov-19	1,262,000	889,667	312,289	296,145	281,233			
Dec-19	1,524,000	1,392,651	483,293	460,120	449,238			
Jan-20	1,291,000	1,187,158	410,228	396,206	380,724			
Feb-20	1,355,000	963,876	349,562	308,005	306,309			
Mar-20	1,197,000	1,162,213	396,502	388,972	376,739			
Apr-20	1,415,000	1,077,278	363,770	357,740	355,768			
May-20	900,000	924,506	311,078	306,313	307,115			
Jun-20	628,000	745,225	255,090	244,089	246,046			
Jul-20	571,000	463,808	161,712	150,497	151,599			
Aug-20	1,007,000	828,321	150,588	137,019	128,249	141,347	122,472	148,646
Production 2020 (ytd) (kWh)	8,364,000	7,352,385	2,398,530	2,288,841	2,252,549	141,347	122,472	148,646
Total Production (kWh)*	12,631,000	11,260,127	3,750,036	3,587,735	3,509,891	141,347	122,472	148,646
Capacity Factor*	Site: N/A		Zephyr 1.0:	27.44%		Zephyr 2.0:	N/A	

*Value calculated over the last 12 months

B. Site Energy Production Graph

August-2020

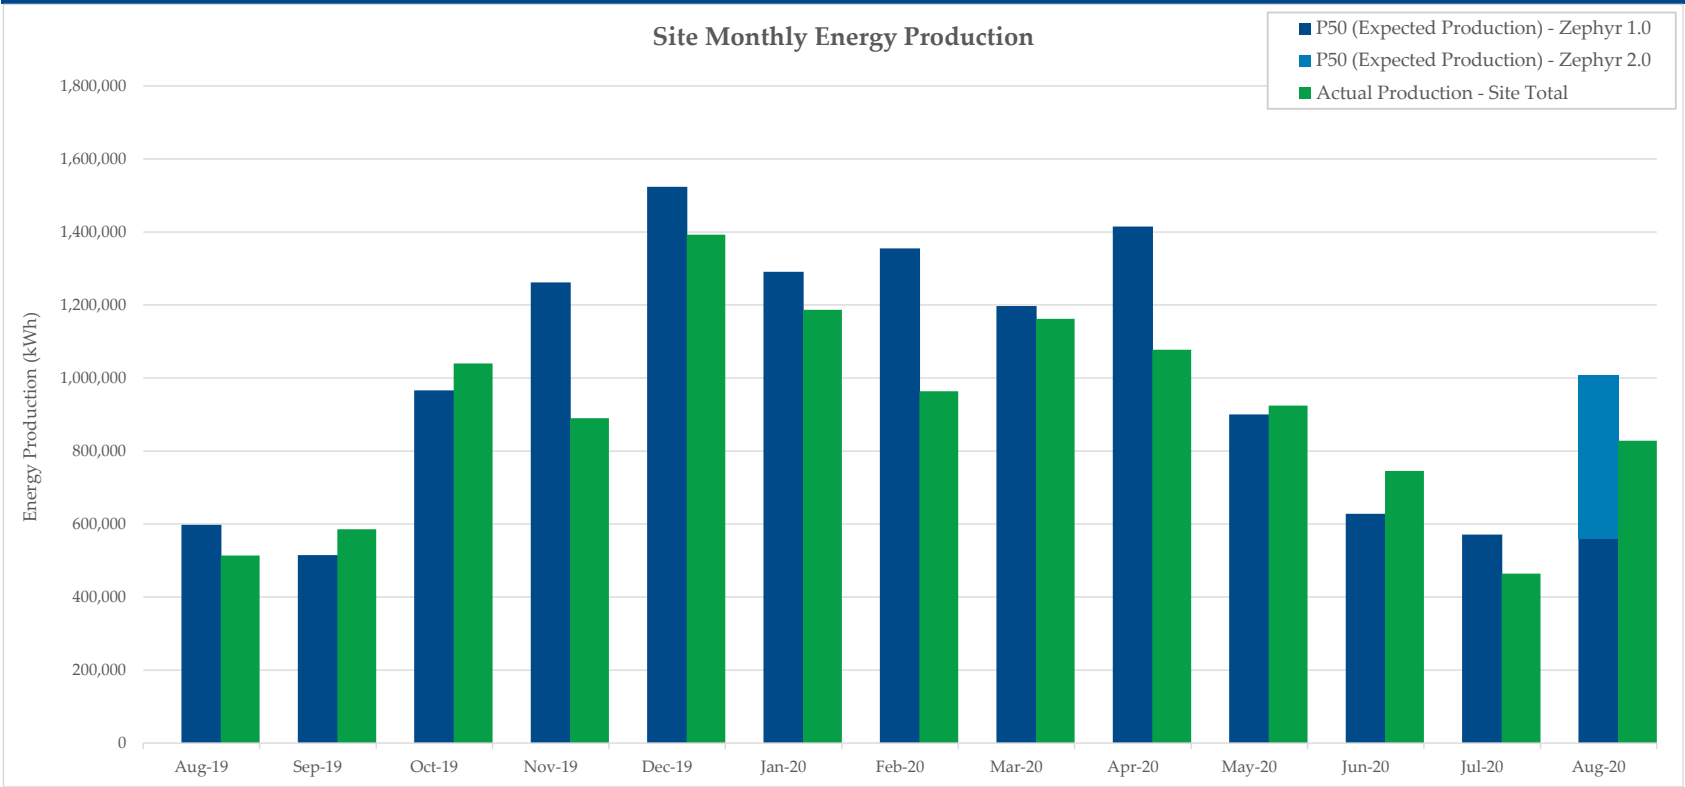

Monthly Report
August-2020



C. Safety Summary

	This Month	Project Cumulative
Recordable Incident(s)	0	0
Near Miss(es)	0	0

D. Planned Maintenance Events

Date	Event	Duration (hr)	Turbine
October-2020	Goldwind 4.5 Year Maintenance	~8	Z1
October-2020	Goldwind 4.5 Year Maintenance	~8	Z2
October-2020	Goldwind 4.5 Year Maintenance	~8	Z3
January-2021	Goldwind 6 Month Maintenance	~8	Z4
January-2021	Goldwind 6 Month Maintenance	~8	Z5
January-2021	Goldwind 6 Month Maintenance	~8	Z6

E. Actual Maintenance Events

Date	Event	Planned/Unplanned	Duration (hrs)	Turbine
8/13/2020	Pitch Code Error	Unplanned	7.05	Z3

F. Turbine Availability & Downtime**

Availability	This Month	Year To Date
Z1	100.00%	99.88%
Z2	100.00%	99.98%
Z3	99.01%	99.88%
Z4		
Z5		
Z6		
Avg	99.67%	99.91%

Downtime (hr)	This Month	Year To Date
Z1	4.83	104.24
Z2	4.92	138.18
Z3	12.77	126.62
Z4		
Z5		
Z6		
Total	22.52	369.04

G. Billed Data - Site Total

Meter Reading (Date/Time)	8/18/2020 12:00 AM
Meter To Date Produced	50,101,821 kWh
Meter To Date Consumed	65,998 kWh
Last Reading Produced	49,422,093 kWh
Last Reading Consumed	62,576 kWh
Billed kWh	676,306 kWh
Next Meter Reading	9/17/2020 12:00 AM

H. Report Notes and Comments

*Site and Zephyr 2.0 capacity factor to be included once full year of data is available. Change in production estimate due to Material Change in Circumstance.

**Availability and Downtime for Zephyr 2.0 to be included beginning September 2020.