


A. Site Energy Production Summary*

	Energy Production (kWh)			
	Site		By Turbine	
	P50 (Expected Production)	Actual Production	W1	W2
Aug-19	402,000	355,979	180,172	175,807
Sep-19	346,000	403,384	203,853	199,531
Oct-19	649,000	709,389	354,865	354,524
Nov-19	846,000	669,872	338,584	331,288
Dec-19	1,022,000	943,766	481,616	462,150
Jan-20	867,000	820,679	407,059	413,620
Feb-20	908,000	670,274	317,389	352,885
Mar-20	803,000	795,295	400,369	394,926
Apr-20	949,000	706,174	357,900	348,274
May-20	603,000	633,162	322,304	310,858
Jun-20	422,000	512,907	257,351	255,556
Jul-20	383,000	317,320	159,723	157,597
Aug-20	399,000	300,935	157,115	143,820
Production 2020 (ytd) (kWh)	5,334,000	4,756,746	2,379,210	2,377,536
Total Production (kWh)*	8,197,000	7,483,157	3,758,128	3,725,029
Capacity Factor*	28.40%		*Value calculated over the last 12 months	

B. Site Energy Production Graph

August-2020

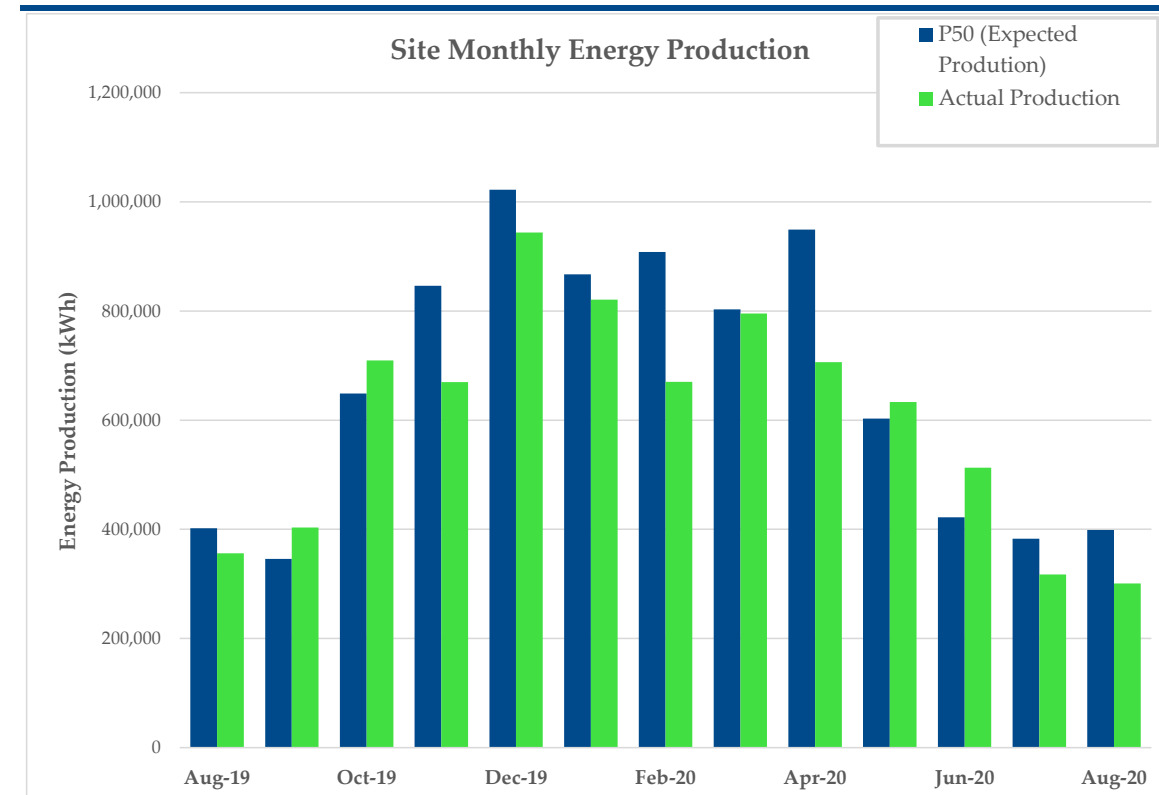

Monthly Report

August-2020

C. Safety Summary

	This Month	Project Cumulative
Recordable Incident(s)	0	0
Near Miss(es)	0	0

D. Planned Maintenance Events

Date	Event	Duration (hr)	Turbine
October-2020	Goldwind 5 Year Maintenance	~15	W1
October-2020	Goldwind 5 Year Maintenance	~15	W2

E. Actual Maintenance Events

Date	Event	Planned/Unplanned	Duration (hrs)	Turbine
8/14/2020	Grid Fault	Unplanned	4.83	W1, W2
8/22-24/2020	Profibus Error	Unplanned	37.91	W2

F. Turbine Availability & Downtime

Availability	This Month	Year To Date
W1	100.00%	99.96%
W2	94.90%	99.31%
Avg	97.45%	99.63%

Downtime (hr)	This Month	Year To Date
W1	8.37	194.24
W2	46.28	120.90
Total	54.65	315.14

G. Billed Data

Meter Reading (Date/Time)	8/29/2020 12:00 AM
Meter To Date Produced	35,273,711 kWh
Meter To Date Consumed	72,803 kWh
Last Reading Produced	34,975,170 kWh
Last Reading Consumed	71,101 kWh
Billed kWh	296,839 kWh
Next Meter Reading	9/29/2020 12:00 AM

H. Report Notes and Comments

*Change in production estimate due to Material Change of Circumstance. The production estimate for July 2020 was changed incorrectly in the previous report. This has been corrected.