


A. Site Energy Production Summary*

	Energy Production (kWh)			
	Site		By Turbine	
	P50 (Expected Production)	Actual Production	V1	V2
Sep-19	449,000	392,366	197,834	194,532
Oct-19	688,000	676,972	338,413	338,559
Nov-19	804,000	631,219	315,003	316,216
Dec-19	822,000	904,108	456,015	448,093
Jan-20	924,000	772,641	385,505	387,136
Feb-20	736,000	640,848	302,976	337,872
Mar-20	794,000	758,754	383,099	375,655
Apr-20	734,000	726,579	367,253	359,326
May-20	574,000	632,754	315,995	316,759
Jun-20	429,000	501,469	246,974	254,495
Jul-20	357,000	314,450	154,487	159,963
Aug-20	303,000	306,534	150,783	155,751
Sep-20	431,000	462,340	229,259	233,081
Production 2020 (ytd) (kWh)	5,282,000	5,116,369	2,536,331	2,580,038
Total Production (kWh)*	7,596,000	7,328,668	3,645,762	3,682,906
Capacity Factor*	27.81%		*Value calculated over the last 12 months	

B. Site Energy Production Graph

September-2020

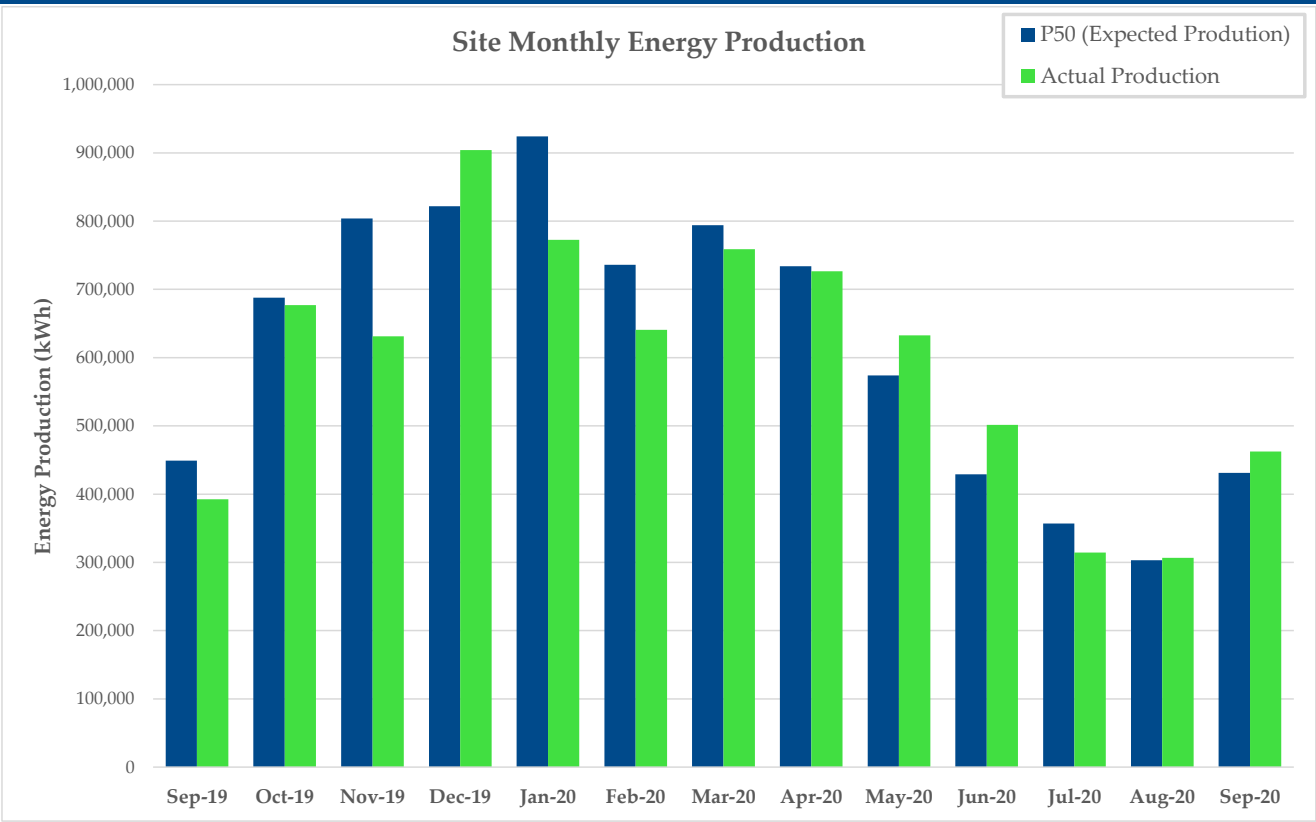

C. Safety Summary

	This Month	Project Cumulative
Recordable Incident(s)	0	0
Near Miss(es)	0	0

D. Planned Maintenance Events**

Date	Event	Duration (hr)	Turbine
October-20	Goldwind 2 Year Maintenance	~15	V1
October-20	Goldwind 2 Year Maintenance	~15	V2

E. Actual Maintenance Events

Date	Event	Planned/Unplanned	Duration (hrs)	Turbine
------	-------	-------------------	----------------	---------

F. Turbine Availability & Downtime

Availability	This Month	Year To Date
V1	100.00%	100.00%
V2	99.86%	99.96%
Avg	99.93%	99.98%

Downtime (hr)	This Month	Year To Date
V1	3.82	211.40
V2	4.40	162.77
Total	8.22	374.17

G. Billed Data

Meter Reading (Date/Time)	10/1/2020 12:00 AM
Meter To Date Produced	14,431,391 kWh
Meter To Date Consumed	38,687 kWh
Last Reading Produced	13,983,850 kWh
Last Reading Consumed	37,302 kWh
Billed kWh	446,156 kWh
Next Meter Reading	11/1/2020 12:00 AM

H. Report Notes and Comments

*Change in production estimate due to Material Change of Circumstance.