




BALL CORPORATION - ZEPHYR WIND PROJECT 2.0
North Findlay Wind Campus, Findlay, Ohio

A. Site Energy Production Summary*

	Energy Production (kWh)				
	Site		By Turbine		
	P50 (Expected Production)	Actual Production	Z4	Z5	Z6
Aug-20	448,000	412,465	141,347	122,472	148,646
Sep-20	617,000	710,596	228,314	239,356	242,926
Oct-20	956,000	850,601	284,918	272,587	293,096
Nov-20	1,107,000	1,330,282	442,746	426,184	461,352
Dec-20	1,098,000	1,263,339	421,761	411,065	430,513
Jan-21	1,251,000	798,530	263,091	267,336	268,103
Feb-21	1,044,000	1,137,529	368,454	371,784	397,291
Mar-21	1,119,000	1,351,254	441,435	433,777	476,042
Apr-21	1,116,000	941,559	301,517	305,193	334,849
May-21	876,000				
Jun-21	637,000				
Jul-21	518,000				
Aug-21	448,000				
Production 2021 (ytd) (kWh)	4,530,000	4,228,872	1,374,497	1,378,090	1,476,285
Total Production (kWh)*	-	-	-	-	-
Capacity Factor*	- *Value calculated over the last 12 months				

B. Site Energy Production Graph

April-2021

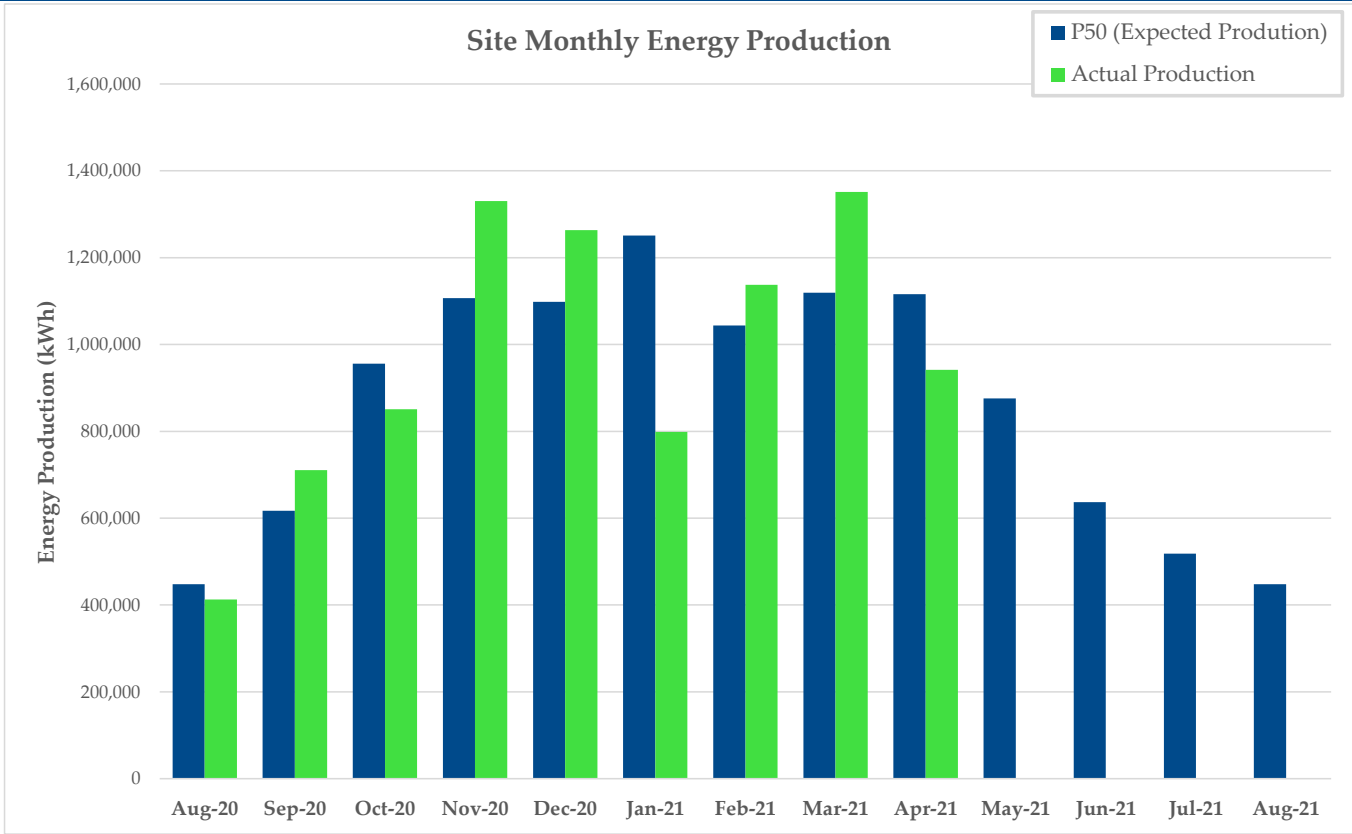

Monthly Report
April-2021



C. Safety Summary

	This Month	Project Cumulative
Recordable Incident(s)	0	0
First Aid	0	1

D. Planned Maintenance Events

Date	Event	Duration (hr)	Turbine
August-2021	Goldwind 1 Year Maintenance	~15	Z4
August-2021	Goldwind 1 Year Maintenance	~15	Z5
August-2021	Goldwind 1 Year Maintenance	~15	Z6

E. Actual Maintenance Events

Date	Event	Planned/Unplanned	Duration (hrs)	Turbine
4/5/2021	Owner/Operator Maintenance	Unplanned	2.70	Z5
4/5/2021	Owner/Operator Maintenance	Unplanned	2.01	Z6
4/15/2021	Owner/Operator Maintenance	Unplanned	2.66	Z4, Z5, Z6

F. Turbine Availability & Downtime**

Availability	This Month	Year To Date
Z4	100.00%	99.78%
Z5	100.00%	99.83%
Z6	100.00%	99.69%
Avg	100.00%	99.77%

Downtime (hr)	This Month	Year To Date
Z4	2.66	77.17
Z5	5.36	57.14
Z6	4.67	71.74
Total	12.69	206.05

G. Billed Data

Meter Reading (Date/Time)	4/20/2021 12:00 AM
Ball 2.0 Production (This Period)	1,134,001 kWh
Ball 2.0 Consumption (This Period)	1,650 kWh
Billed kWh	1,132,351 kWh
Next Meter Reading	5/19/2021 12:00 AM

H. Report Notes and Comments

*Capacity factor to be included once full year of data is available.
**March downtime and availability under further review.