


A. Site Energy Production Summary*

	Energy Production (kWh)				
	Site		By Turbine		
	P50 (Expected Production)	Actual Production	L1	L2	L3
Aug-20	534,000	251,447	74,850	95,169	81,428
Sep-20	736,000	700,759	241,924	248,089	210,746
Oct-20	1,131,000	977,504	330,212	329,167	318,125
Nov-20	1,281,000	1,381,160	464,646	463,381	453,133
Dec-20	1,263,000	1,378,483	457,368	459,037	462,078
Jan-21	1,433,000	897,220	303,778	298,866	294,576
Feb-21	1,213,000	1,067,166	373,080	349,858	344,228
Mar-21	1,339,000	1,506,920	494,282	505,088	507,550
Apr-21	1,327,000	1,060,276	357,749	359,028	343,499
May-21	1,052,000				
Jun-21	751,000				
Jul-21	609,000				
Aug-21	534,000				
Production 2021 (ytd) (kWh)	5,312,000	4,531,582	1,528,889	1,512,840	1,489,853
Total Production (kWh)*	-	-	-	-	-
Capacity Factor*	- *Value calculated over the last 12 months				

B. Site Energy Production Graph

April-2021

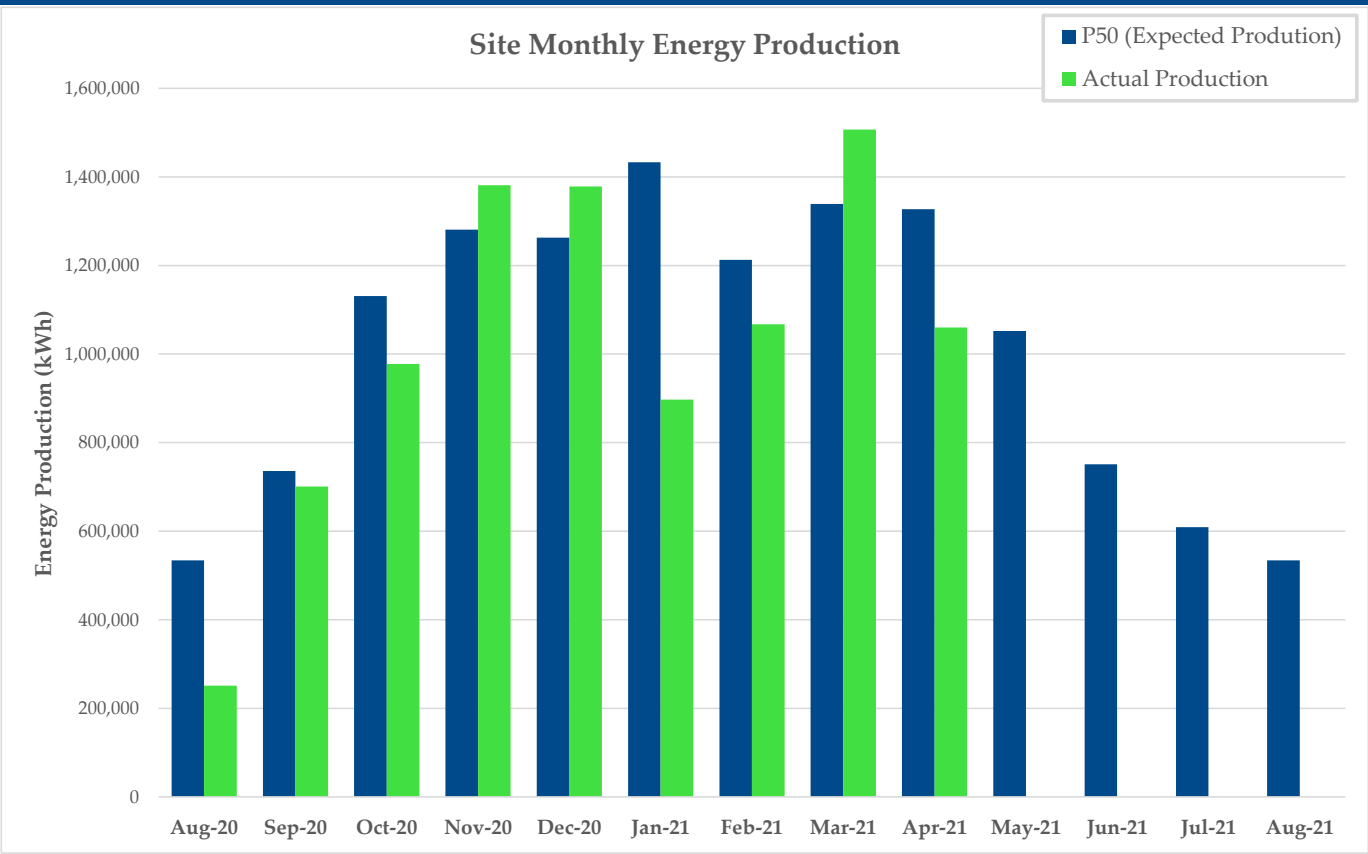

Monthly Report

April-2021

C. Safety Summary

	This Month	Project Cumulative
Recordable Incident(s)	0	0
First Aid	0	0

D. Planned Maintenance Events

Date	Event	Duration	Turbine
		(hr)	
September-2021	Goldwind 1 Year Maintenance	~15	L1
September-2021	Goldwind 1 Year Maintenance	~15	L2
September-2021	Goldwind 1 Year Maintenance	~15	L3

E. Actual Maintenance Events

Date	Event	Planned/Unplanned	Duration	Turbine
			(hrs)	
4/7/2021	Owner/Operator Maintenance	Unplanned	2.34	L1
4/7/2021	Owner/Operator Maintenance	Unplanned	2.73	L2
4/7/2021	Owner/Operator Maintenance	Unplanned	1.88	L3

F. Turbine Availability & Downtime

Availability	This Month	Year To Date
L1	100.00%	99.98%
L2	100.00%	99.54%
L3	99.99%	100.00%
Avg	100.00%	99.84%

Downtime (hr)	This Month	Year To Date
L1	2.34	92.40
L2	2.73	123.17
L3	1.92	116.66
Total	6.99	332.23

G. Billed Data

Meter Reading (Date/Time)	4/27/2021 12:00 AM
Meter To Date Produced	8,912,763 kWh
Meter To Date Consumed	24,209 kWh
Last Reading Produced	7,779,637 kWh
Last Reading Consumed	21,557 kWh
Billed kWh	1,130,474 kWh
Next Meter Reading	5/26/2021 12:00 AM

H. Report Notes and Comments

*Capacity factor to be included once full year of data is available.