


A. Site Energy Production Summary

	Energy Production (kWh)				
	Site		By Turbine		
	P50 (Expected Production)	Actual Production	W1	W2	W3
Apr-20	1,176,000	1,028,204	354,270	335,252	338,682
May-20	927,000	863,616	293,660	275,555	294,401
Jun-20	634,000	542,111	193,735	179,058	169,318
Jul-20	527,000	307,801	107,383	97,517	102,901
Aug-20	449,000	319,596	107,014	102,774	109,808
Sep-20	610,000	609,440	202,193	196,981	210,266
Oct-20	990,000	736,506	247,147	240,678	248,681
Nov-20	1,123,000	1,223,830	413,579	402,713	407,538
Dec-20	1,153,000	857,603	285,868	285,868	285,868
Jan-21	1,306,000	661,923	220,641	220,641	220,641
Feb-21	1,137,000	896,420	308,413	291,691	296,316
Mar-21	1,134,000	1,290,867	437,185	424,582	429,100
Apr-21	1,176,000	752,920	257,397	246,019	249,504
Production 2021 (ytd) (kWh)	4,753,000	3,602,130	1,223,636	1,182,933	1,195,561
Total Production (kWh)*	11,166,000	9,062,634	3,074,215	2,964,077	3,024,342
Capacity Factor*	22.99%		*Value calculated over the last 12 months		

B. Site Energy Production Graph

April-2021

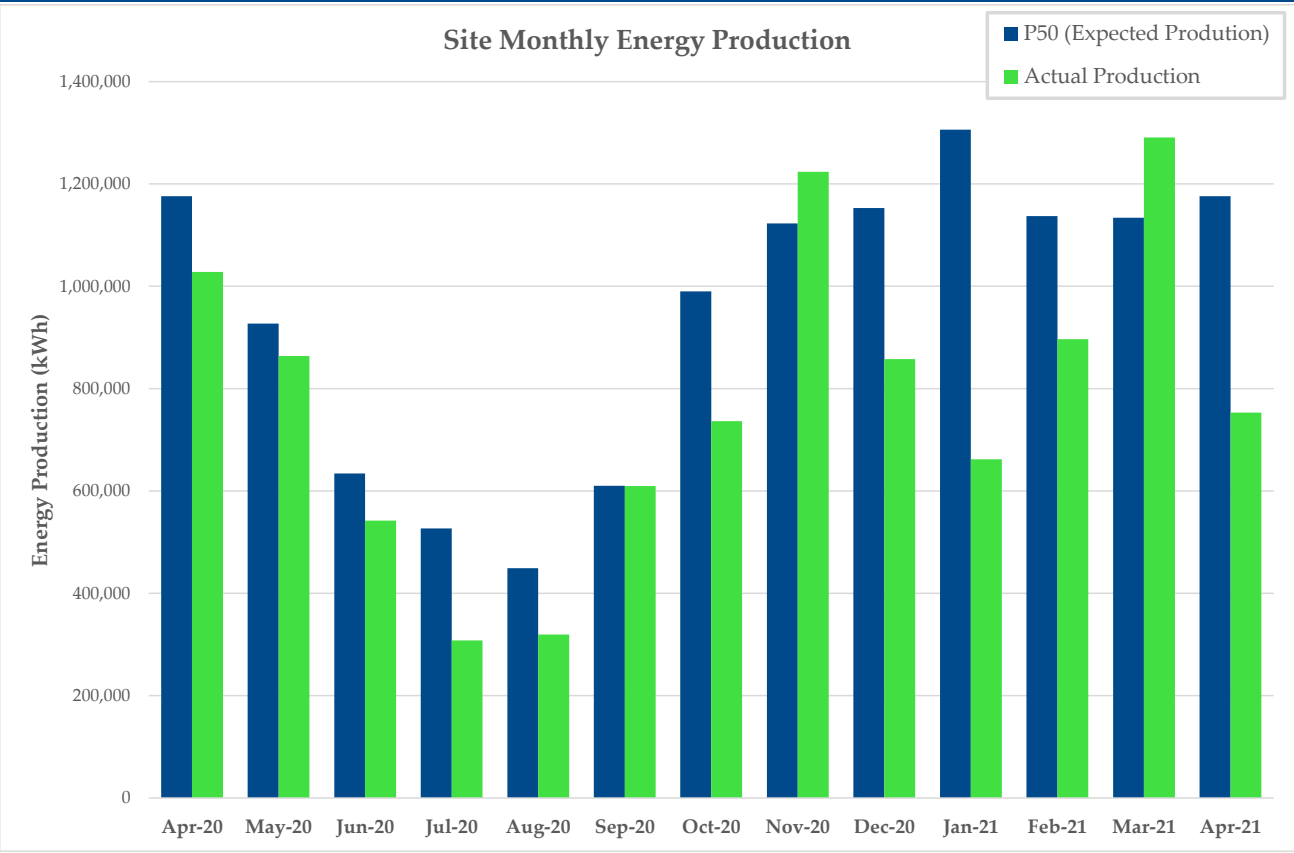

Monthly Report
April-2021

C. Safety Summary

	This Month	Project Cumulative
Recordable Incident(s)	0	0
First Aid	0	1

D. Planned Maintenance Events

Date	Event	Duration (hr)	Turbine
October-2021	Goldwind 4 Year Maintenance	~15	W1
October-2021	Goldwind 4 Year Maintenance	~15	W2
October-2021	Goldwind 4 Year Maintenance	~15	W3

E. Actual Maintenance Events

Date	Event	Planned/Unplanned	Duration (hrs)	Turbine
4/2-4/6/2021	Plant Shutdown; Equipment Replacement	Unplanned	105.28	W2
4/2-4/6/2021	Plant Shutdown; Equipment Replacement	Unplanned	105.26	W3
4/2-4/7/2021	Plant Shutdown; Equipment Replacement	Unplanned	122.03	W1
4/9-4/10/2021	Grid Outage	Unplanned	15.36	W1,W3
4/9-4/10/2021	Grid Outage	Unplanned	15.35	W2
4/12/2021	Owner/Operator Maintenance	Unplanned	1.59	W1
4/12/2021	Owner/Operator Maintenance	Unplanned	2.49	W2
4/12/2021	Owner/Operator Maintenance	Unplanned	1.82	W3
4/12/2021	One Energy Testing	Unplanned	3.47	W1,W2,W3
4/15/2021	Goldwind 3.5 Year Maintenance	Planned	3.04	W1
4/15/2021	Goldwind 3.5 Year Maintenance	Planned	2.01	W2
4/16/2021	Goldwind 3.5 Year Maintenance	Planned	2.40	W3
4/25/2021	Plant Shutdown	Unplanned	25.88	W1,W2,W3

F. Turbine Availability & Downtime****

Availability	This Month	Year To Date
W1	97.70%	99.16%
W2	99.64%	99.87%
W3	99.04%	99.58%
Avg	98.79%	99.54%

Downtime (hr)	This Month	Year To Date
W1	174.36	209.07
W2	160.09	195.55
W3	165.29	201.96
Total	499.74	606.58

G. Billed Data

Meter Reading (Date/Time)	4/21/2021 12:00 AM
Meter To Date Produced	32,329,071 kWh
Meter To Date Consumed	94,274 kWh
Last Reading Produced	31,418,710 kWh
Last Reading Consumed	92,664 kWh
Billed kWh	908,751 kWh
Next Meter Reading	5/21/2021 12:00 AM

H. Report Notes and Comments

**December 2020 and January 2021 Production read from the meter due to communication issues and will be updated if SCADA data becomes available. Total metered production divided to estimate per turbine total.
***February 2021 Production is estimate due to communication issues.
****Year to date does not include January 2021 due to communication issue. April downtime and availability under further review.