




BALL CORPORATION - ZEPHYR WIND PROJECT 2.0
North Findlay Wind Campus, Findlay, Ohio

A. Site Energy Production Summary

	Energy Production (kWh)				
	Site		By Turbine		
	P50 (Expected Production)	Actual Production	Z4	Z5	Z6
Aug-20	448,000	412,465	141,347	122,472	148,646
Sep-20	617,000	710,596	228,314	239,356	242,926
Oct-20	956,000	850,601	284,918	272,587	293,096
Nov-20	1,107,000	1,330,282	442,746	426,184	461,352
Dec-20	1,098,000	1,263,339	421,761	411,065	430,513
Jan-21	1,251,000	798,530	263,091	267,336	268,103
Feb-21	1,044,000	1,137,529	368,454	371,784	397,291
Mar-21	1,119,000	1,351,254	441,435	433,777	476,042
Apr-21	1,116,000	941,559	301,517	305,193	334,849
May-21	876,000	755,823	246,357	249,062	260,404
Jun-21	637,000	667,180	226,175	213,521	227,484
Jul-21	518,000	423,089	144,295	141,912	136,882
Aug-21	448,000				
Production 2021 (ytd) (kWh)	6,561,000	6,074,964	1,991,324	1,982,585	2,101,055
Total Production (kWh)*	10,787,000	10,642,247	3,510,410	3,454,249	3,677,588
Capacity Factor*	27.00% *Value calculated over the last 12 months				

B. Site Energy Production Graph

July-2021

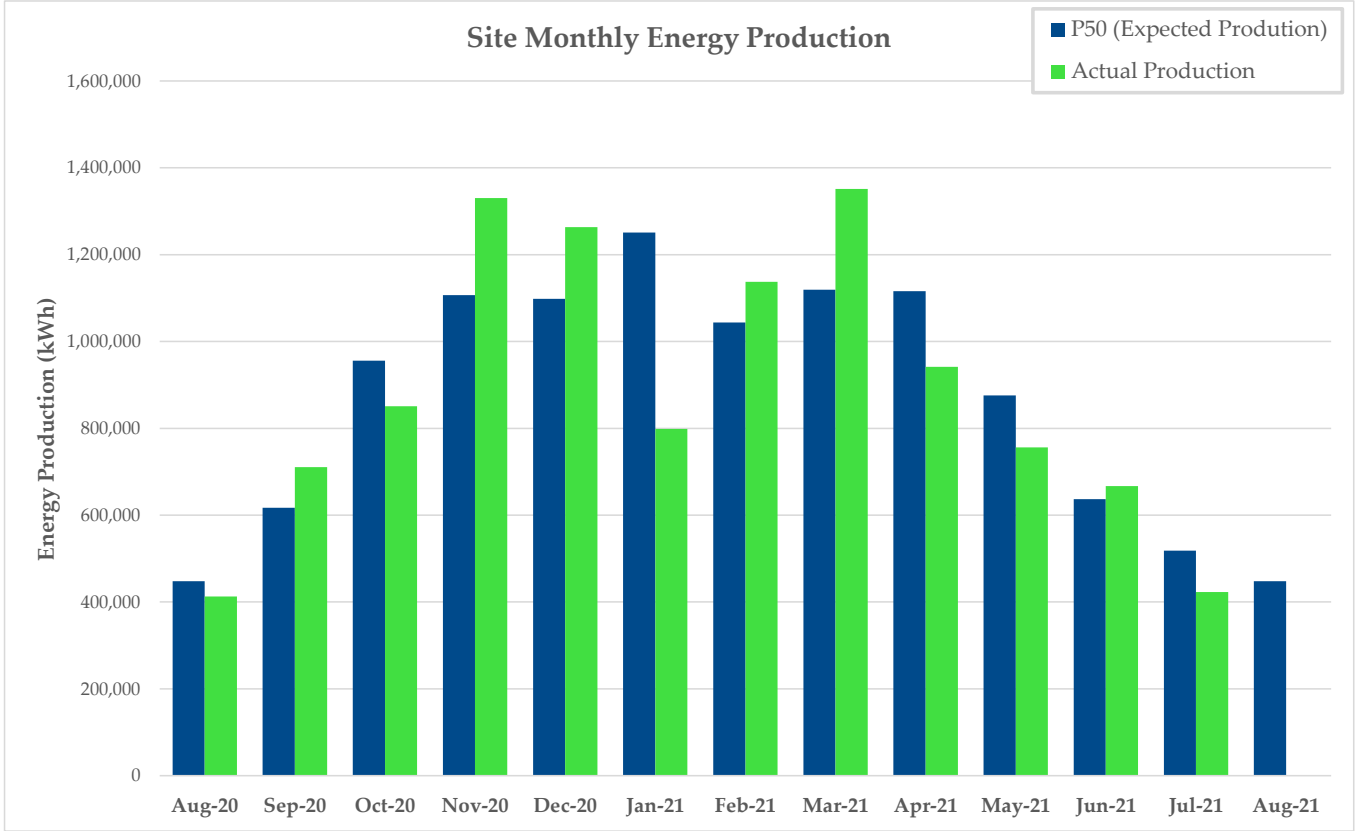

Monthly Report
July-2021



C. Safety Summary

	This Month	Project Cumulative
Recordable Incident(s)	0	0
First Aid	0	1

D. Planned Maintenance Events

Date	Event	Duration (hr)	Turbine
August-2021	Goldwind 1 Year Maintenance	~15	Z4
August-2021	Goldwind 1 Year Maintenance	~15	Z5
August-2021	Goldwind 1 Year Maintenance	~15	Z6

E. Actual Maintenance Events

Date	Event	Planned/Unplanned	Duration (hrs)	Turbine
7/4/2021-7/5/2021	Turbine Converter Fault	Unplanned	19.06	Z6

F. Turbine Availability & Downtime*

Availability	This Month	Year To Date
Z4	100.00%	99.87%
Z5	100.00%	99.90%
Z6	97.44%	99.46%
Avg	99.15%	99.74%

Downtime (hr)	This Month	Year To Date
Z4	1.69	82.07
Z5	0.67	59.40
Z6	19.73	92.85
Total	22.09	234.32

G. Billed Data

Meter Reading (Date/Time)	7/19/2021 12:00 AM
Ball 2.0 Production (This Period)	713,581 kWh
Ball 2.0 Consumption (This Period)	2,392 kWh
Billed kWh	711,189 kWh
Next Meter Reading	8/18/2021 12:00 AM

H. Report Notes and Comments

*March downtime and availability under further review.