


A. Site Energy Production Summary

	Energy Production (kWh)				
	Site		By Turbine		
	P50 (Expected Production)	Actual Production	Z4	Z5	Z6
Nov-20	1,107,000	1,330,282	442,746	426,184	461,352
Dec-20	1,098,000	1,263,339	421,761	411,065	430,513
Jan-21	1,251,000	798,530	263,091	267,336	268,103
Feb-21	1,044,000	1,137,529	368,454	371,784	397,291
Mar-21	1,119,000	1,351,254	441,435	433,777	476,042
Apr-21	1,116,000	941,559	301,517	305,193	334,849
May-21	876,000	755,823	246,357	249,062	260,404
Jun-21	637,000	667,180	226,175	213,521	227,484
Jul-21	518,000	423,089	144,295	141,912	136,882
Aug-21	448,000	407,609	139,023	132,947	135,639
Sep-21	617,000	957,074	321,730	316,478	318,866
Oct-21	956,000	739,181	243,855	238,641	256,685
Nov-21	1,107,000	1,150,429	384,301	366,844	399,284
Production 2021 (ytd) (kWh)	9,689,000	9,329,257	3,080,233	3,037,495	3,211,529
Total Production (kWh) (LTM)	10,787,000	10,592,596	3,501,994	3,448,560	3,642,042
Capacity Factor (LTM)	26.87%				

B. Site Energy Production Graph

November-2021

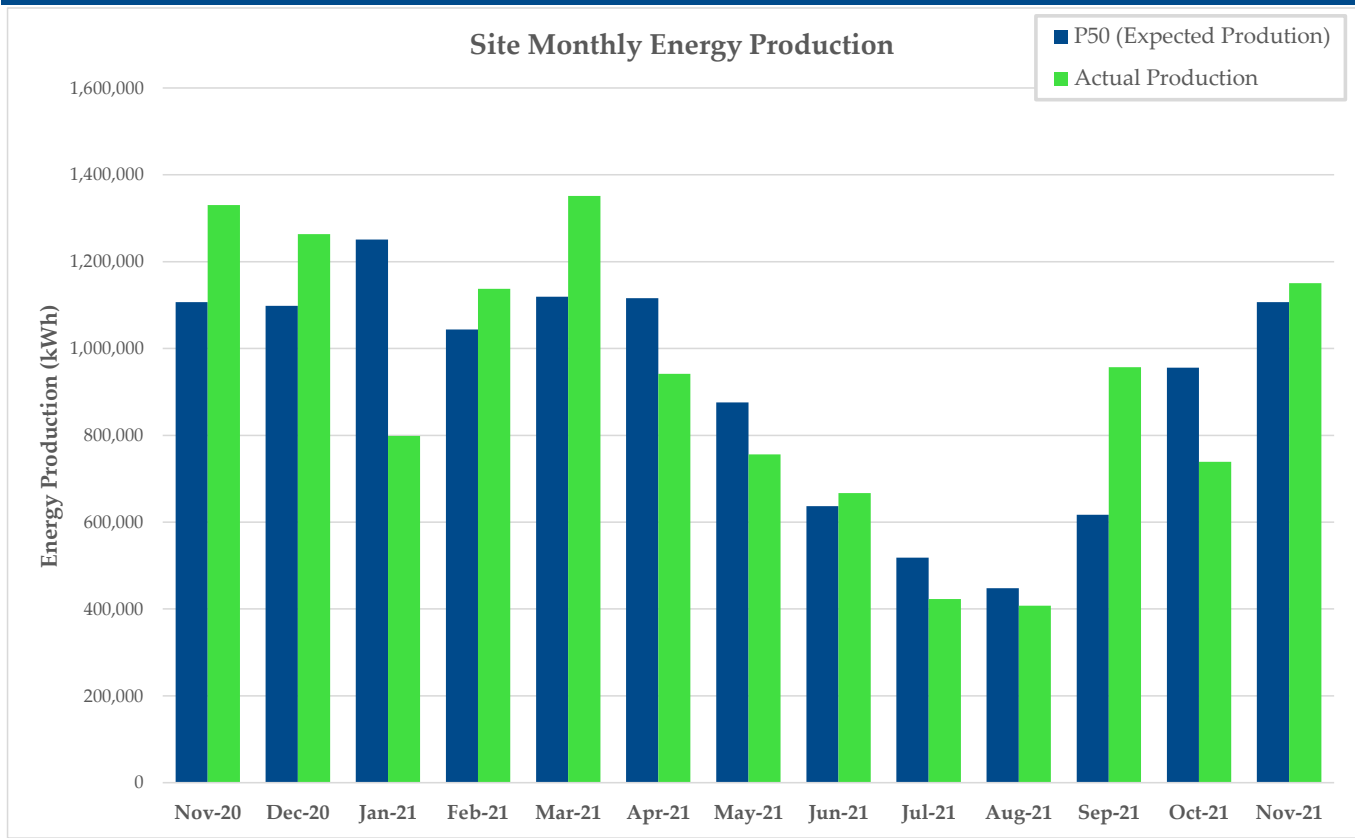

Monthly Report
November-2021

C. Safety Summary

	This Month	Project Cumulative
Recordable Incident(s)	0	0
First Aid	0	1

D. Planned Maintenance Events

Date	Event	Duration (hr)	Turbine
March-2022	Goldwind 1.5 Year Maintenance	~8	Z4
March-2022	Goldwind 1.5 Year Maintenance	~8	Z5
March-2022	Goldwind 1.5 Year Maintenance	~8	Z6

E. Actual Maintenance Events

Date	Event	Planned/Unplanned	Duration (hrs)	Turbine
11/11/2021-11/12/2021	Turbine Noise Inspection	Unplanned	19.56	Z5

F. Turbine Availability & Downtime*

Availability	This Month	Year To Date
Z4	100.00%	99.92%
Z5	100.00%	99.87%
Z6	100.00%	99.65%
Avg	100.00%	99.81%

Downtime (hr)	This Month	Year To Date
Z4	0	108.44
Z5	19.56	100.22
Z6	0	108.72
Total	19.56	317.38

G. Billed Data

Meter Reading (Date/Time)	11/16/2021 12:00 AM
Ball 2.0 Production (This Period)	947,458 kWh
Ball 2.0 Consumption (This Period)	2,453 kWh
Billed kWh	945,005 kWh
Next Meter Reading	12/17/2021 12:00 AM

H. Report Notes and Comments

*March downtime and availability under further review.