




Cooper Farms' Wind VW
Van Wert, OH

A. Site Energy Production Summary

	Energy Production (kWh)				
	Site		By Turbine		
	Expected Production	Actual Production	WTG 1	WTG 2	WTG 3
Mar-21	1,227,217	1,490,469	490,288	498,026	502,155
Apr-21	1,438,497	1,251,068	419,058	407,202	424,808
May-21	980,450	893,080	302,659	292,214	298,207
Jun-21	649,158	861,377	289,298	277,290	294,789
Jul-21	618,687	498,535	168,876	158,185	171,474
Aug-21	559,508	485,548	159,184	160,241	166,123
Sep-21	603,085	1,099,035	372,447	353,027	373,561
Oct-21	967,926	918,473	308,929	305,665	303,879
Nov-21	1,362,692	1,409,993	478,180	445,587	486,226
Dec-21	1,254,397	1,331,608	397,271	459,909	474,428
Jan-22	1,290,968	1,353,578	462,516	440,464	450,598
Feb-22	1,170,349	1,604,544	545,081	532,075	527,388
Mar-22	1,227,217	1,638,719	558,009	535,925	544,785
Production 2022 (ytd) (kWh)	3,688,534	4,596,841	1,565,606	1,508,464	1,522,771
Total Production (LTM) (kWh)	12,122,935	13,345,558	4,461,508	4,367,784	4,516,266
Capacity Factor (LTM)	33.85%				

B. Site Energy Production Graph

March-2022

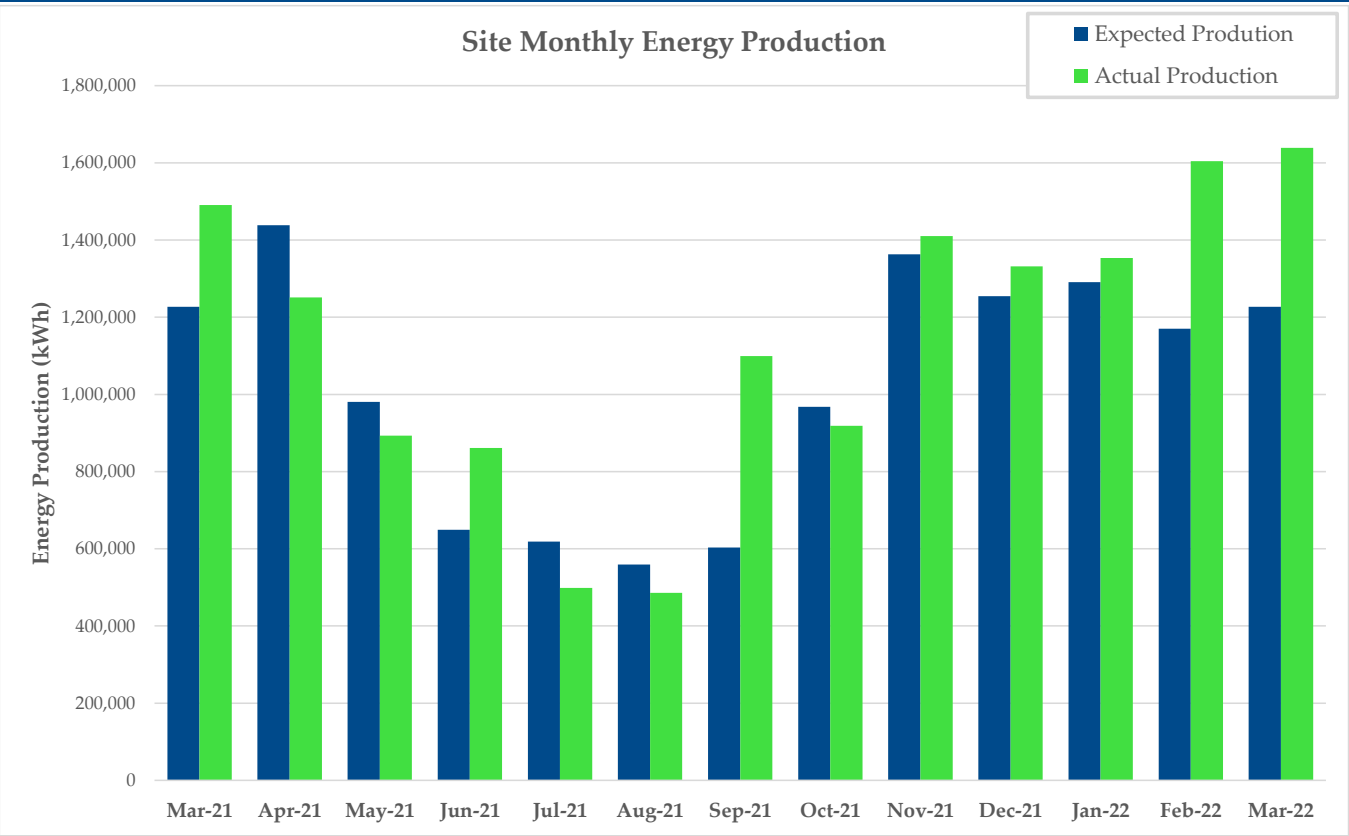

Monthly Report
March-2022



C. Safety Summary

	This Month	Project Cumulative
Recordable Incident(s)	0	0
Near Miss(es)	0	0

D. Planned Maintenance Events

Date	Event	Duration (hr)	Turbine
September-2022	Goldwind 10 Year Maintenance	~15	WTG 1
September-2022	Goldwind 10 Year Maintenance	~15	WTG 2
September-2022	Goldwind 10 Year Maintenance	~15	WTG 3

E. Actual Maintenance Events

Date	Event	Planned/Unplanned	Duration (hrs)	Turbine
3/17/2022-3/18/2022	Goldwind 9.5 Year Maintenance	Planned	4.96	WTG 1
3/17/2022-3/18/2022	Goldwind 9.5 Year Maintenance	Planned	6.75	WTG 2
3/18/2022	Goldwind 9.5 Year Maintenance	Planned	3.30	WTG 3

F. Turbine Availability & Downtime

Availability	This Month	Year To Date
WTG 1	100.00%	99.72%
WTG 2	100.00%	100.00%
WTG 3	100.00%	100.00%
Avg	100.00%	99.91%

Downtime (hr)	This Month	Year To Date
WTG 1	7.17	61.63
WTG 2	8.96	70.42
WTG 3	5.51	56.72
Total	21.64	188.77

G. Wind Speed & Capacity Factor

Wind Speed (mph)	This Month	2022 Annual
WTG 1	15.23	15.13
WTG 2	14.93	14.87
WTG 3	15.18	15.08
Estimated	14.92	13.39

Capacity Factor (%)	This Month	2022 Annual
WTG 1	50.00%	48.32%
WTG 2	48.02%	46.56%
WTG 3	48.82%	47.00%
Low Estimate	35.10%	28.72%

H. Report Notes and Comments