

A. Site Energy Production Summary

	Energy Production (kWh)				
	Site		By Turbine		
	P50 (Expected Production)	Actual Production	WG1	WG2	WG3
Jun-21	714,000	707,606	237,423	237,814	232,369
Jul-21	566,000	393,393	134,849	129,596	128,948
Aug-21	514,000	411,193	140,054	135,185	135,954
Sep-21	716,000	957,296	328,228	316,256	312,812
Oct-21	1,051,000	805,356	280,398	266,167	258,791
Nov-21	1,224,000	1,149,191	399,017	380,196	369,978
Dec-21	1,217,000	1,256,121	428,605	416,086	411,430
Jan-22	1,343,000	1,090,541	289,562	405,135	395,844
Feb-22	1,133,000	1,172,040	402,121	396,163	373,756
Mar-22	1,312,000	1,490,987	504,716	495,732	490,539
Apr-22	1,272,000	1,288,755	442,083	425,015	421,657
May-22	974,000	967,486	331,022	319,660	316,804
Jun-22	714,000	591,297	204,680	194,977	191,640
Production 2022 (ytd) (kWh)	6,748,000	6,601,106	2,174,184	2,236,682	2,190,240
Total Production (kWh) (LTM)	12,036,000	11,573,656	3,885,335	3,880,168	3,808,153
Capacity Factor (LTM)	29.36%				

C. Safety Summary

	This Month	Project Cumulative
Recordable Incident(s)	0	0
First Aid	0	0

D. Planned Maintenance Events


Date	Event	Duration (hr)	Turbine
November-2022	Goldwind 4 Year Maintenance	~15	WG 1
November-2022	Goldwind 4 Year Maintenance	~15	WG 2
November-2022	Goldwind 4 Year Maintenance	~15	WG 3

E. Actual Maintenance Events

Date	Event	Planned/Unplanned	Duration (hrs)	Turbine
------	-------	-------------------	----------------	---------

B. Site Energy Production Graph

June-2022

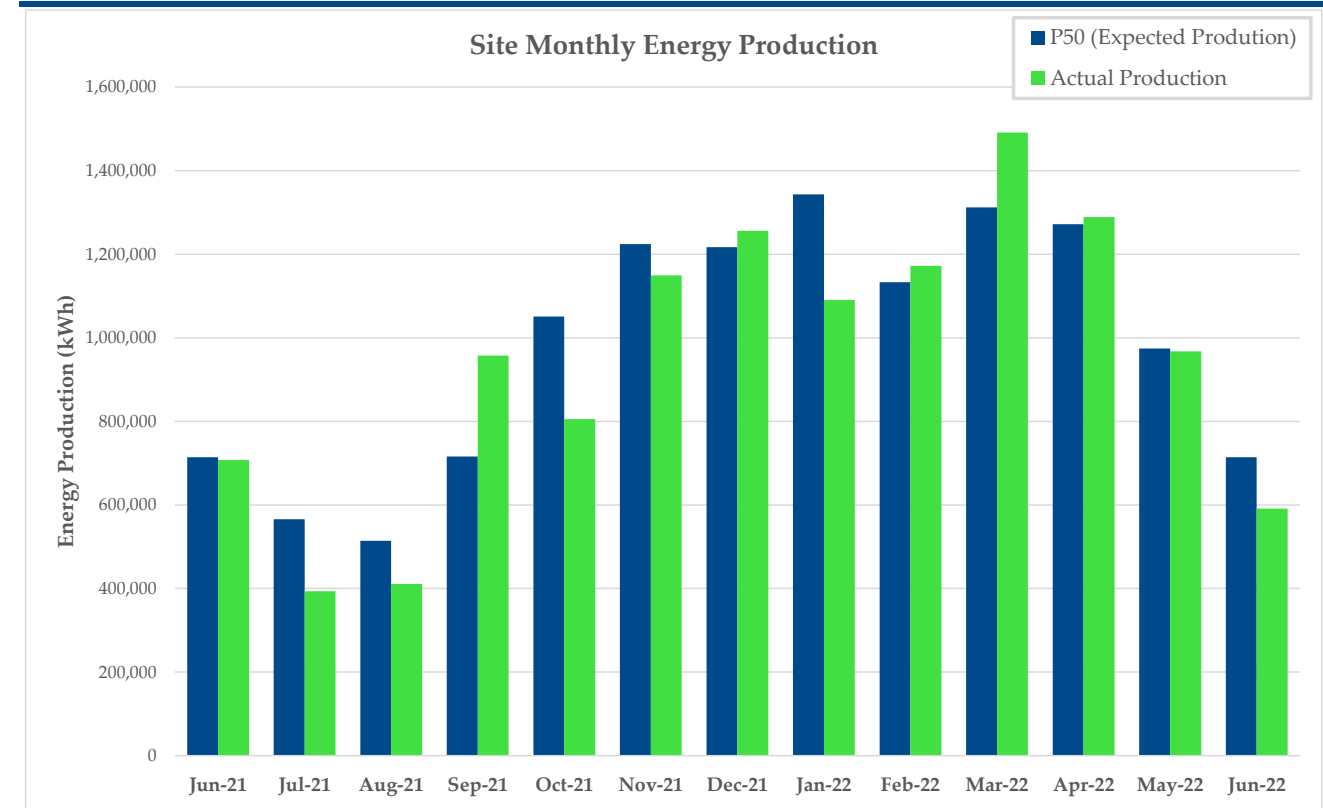

F. Turbine Availability & Downtime

Availability	This Month	Year To Date
WG1	100.00%	98.29%
WG2	100.00%	100.00%
WG3	100.00%	99.72%
Avg	100.00%	99.34%

Downtime (hr)	This Month	Year To Date
WG1	8.92	233.81
WG2	8.92	109.11
WG3	8.92	130.85
Total	26.76	473.77

G. Billed Data

Meter Reading (Date/Time)	6/29/2022 12:00 AM
Meter To Date Produced	40,355,631 kWh
Meter To Date Consumed	145,748 kWh
Last Reading Produced	39,710,520 kWh
Last Reading Consumed	142,686 kWh
Billed kWh	642,049 kWh
Next Meter Reading	7/29/2022 12:00 AM

H. Report Notes and Comments