


A. Site Energy Production Summary

	Energy Production (kWh)				
	Site		By Turbine		
	P50 (Expected Production)	Actual Production	Z4	Z5	Z6
Jul-21	518,000	423,089	144,295	141,912	136,882
Aug-21	448,000	407,609	139,023	132,947	135,639
Sep-21	617,000	957,074	321,730	316,478	318,866
Oct-21	956,000	739,181	243,855	238,641	256,685
Nov-21	1,107,000	1,150,429	384,301	366,844	399,284
Dec-21	1,098,000	1,141,220	374,435	374,888	391,897
Jan-22	1,251,000	1,253,751	420,362	406,883	426,506
Feb-22	1,044,000	1,306,639	438,679	422,217	445,743
Mar-22	1,119,000	1,335,480	443,031	438,839	453,610
Apr-22	1,116,000	1,145,744	373,811	368,393	403,540
May-22	876,000	984,712	298,460	333,446	352,806
Jun-22	637,000	601,888	194,009	193,281	214,598
Jul-22	518,000	586,264	192,973	189,924	203,367
Production 2022 (ytd) (kWh)	6,561,000	7,214,478	2,361,325	2,352,983	2,500,170
Total Production (kWh) (LTM)	10,787,000	11,609,991	3,824,669	3,782,781	4,002,541
Capacity Factor (LTM)	29.45%				

B. Site Energy Production Graph

July-2022

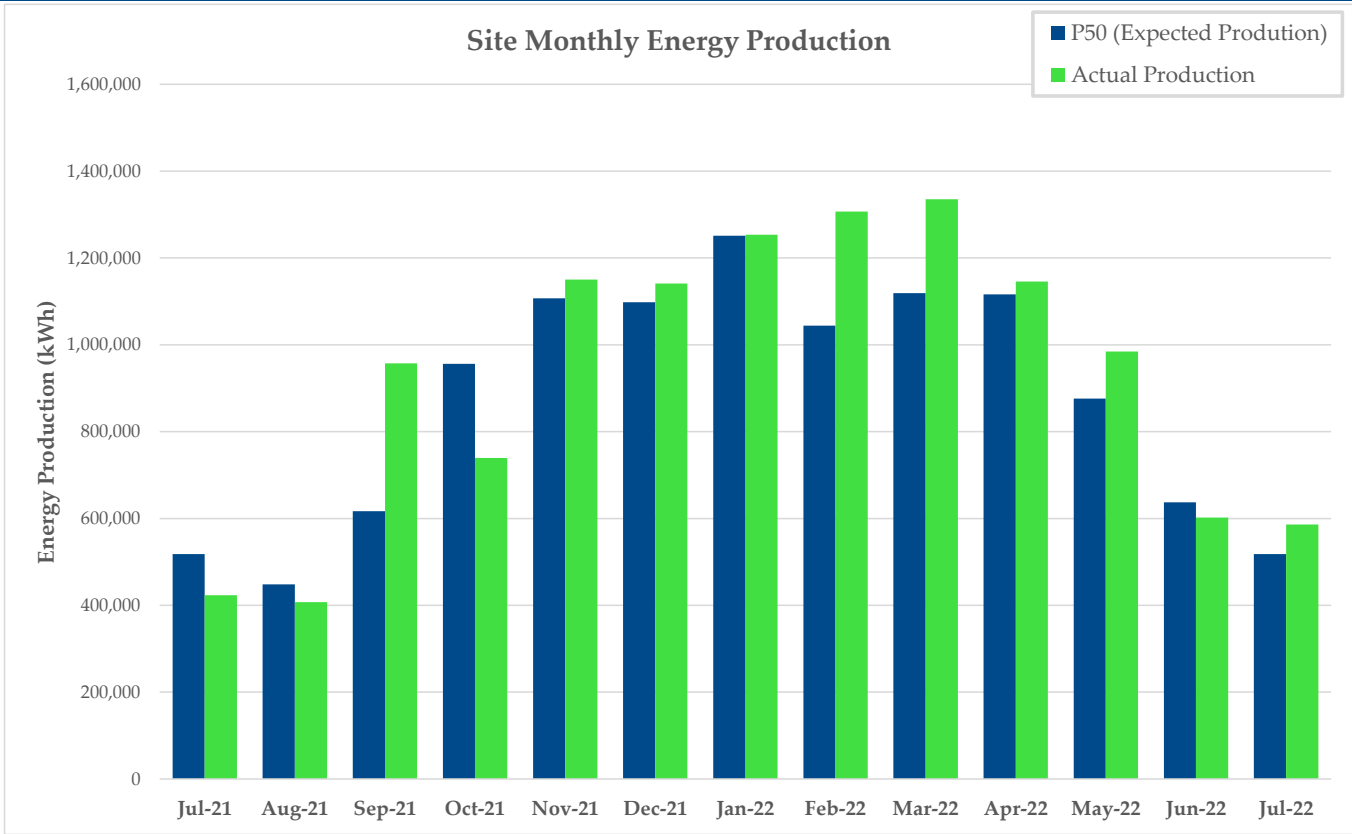

Monthly Report

July-2022

C. Safety Summary

	This Month	Project Cumulative
Recordable Incident(s)	0	0
First Aid	0	1

D. Planned Maintenance Events

Date	Event	Duration (hr)	Turbine
September-2022	Goldwind 2 Year Maintenance	~15	Z4
September-2022	Goldwind 2 Year Maintenance	~15	Z5
September-2022	Goldwind 2 Year Maintenance	~15	Z6

E. Actual Maintenance Events

Date	Event	Planned/Unplanned	Duration (hrs)	Turbine
7/20/2022-7/21/2022	Turbine Fault	Unplanned	14.15	Z5

F. Turbine Availability & Downtime

Availability	This Month	Year To Date
Z4	100.00%	99.99%
Z5	98.10%	98.09%
Z6	100.00%	99.87%
Avg	99.37%	99.32%

Downtime (hr)	This Month	Year To Date
Z4	0.62	142.69
Z5	14.77	225.46
Z6	0.62	157.60
Total	16.01	525.75

G. Billed Data

Meter Reading (Date/Time)	7/20/2022 12:00 AM
Ball 2.0 Production (This Period)	558,243 kWh
Ball 2.0 Consumption (This Period)	3,744 kWh
Billed kWh	554,498 kWh
Next Meter Reading	8/18/2022 12:00 AM

H. Report Notes and Comments

*March 2022 production includes estimates due to a SCADA server error.