


A. Site Energy Production Summary

	Energy Production (kWh)				
	Site		By Turbine		
	Expected Production	Actual Production	WTG 1	WTG 2	WTG 3
Oct-21	967,926	918,473	308,929	305,665	303,879
Nov-21	1,362,692	1,409,993	478,180	445,587	486,226
Dec-21	1,254,397	1,331,608	397,271	459,909	474,428
Jan-22	1,290,968	1,353,578	462,516	440,464	450,598
Feb-22	1,170,349	1,604,544	545,081	532,075	527,388
Mar-22	1,227,217	1,638,719	558,009	535,925	544,785
Apr-22	1,438,497	1,509,431	506,692	498,089	504,650
May-22	980,450	1,209,327	409,133	403,329	396,865
Jun-22	649,158	765,507	272,227	239,819	253,461
Jul-22	618,687	617,049	214,843	198,590	203,616
Aug-22	559,508	531,092	179,942	168,860	182,290
Sep-22	603,085	395,973	133,364	128,586	134,023
Oct-22	967,926	1,373,420	466,421	429,871	477,128
Production 2022 (ytd) (kWh)	9,505,846	10,998,640	3,748,228	3,575,608	3,674,804
Total Production (LTM) (kWh)	12,122,935	13,740,241	4,623,679	4,481,104	4,635,458
Capacity Factor (LTM)	34.86%				

B. Site Energy Production GraphOctober-2022

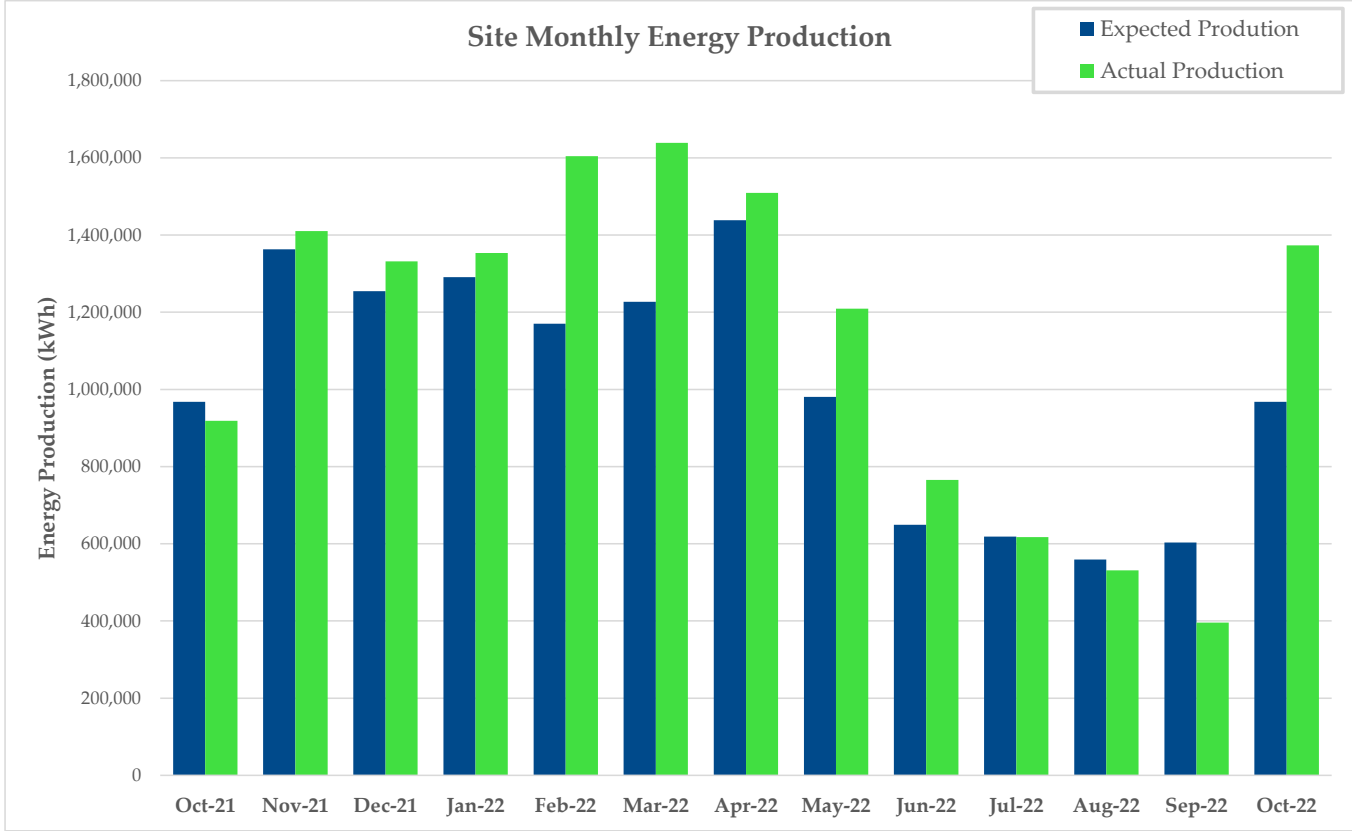

Monthly ReportOctober-2022

C. Safety Summary

	This Month	Project Cumulative
Recordable Incident(s)	0	0
Near Miss(es)	0	0

D. Planned Maintenance Events

Date	Event	Duration (hr)	Turbine
April-2023	Goldwind 10.5 Year Maintenance	~8	WTG 1
April-2023	Goldwind 10.5 Year Maintenance	~8	WTG 2
April-2023	Goldwind 10.5 Year Maintenance	~8	WTG 3

E. Actual Maintenance Events

Date	Event	Planned/Unplanned	Duration (hrs)	Turbine
10/6/2022	Customer Blade Inspection	Unplanned	4.49	WTG 1
10/6/2022-10/7/2022	Customer Blade Inspection	Unplanned	24.12	WTG 2
10/11/2022	Goldwind 10 Year Maintenance	Planned	5.58	WTG 1
10/11/2022	Goldwind 10 Year Maintenance	Planned	2.41	WTG 2
10/11/2022	Goldwind 10 Year Maintenance	Planned	2.05	WTG 3
10/13/2022	Goldwind 10 Year Maintenance	Planned	4.47	WTG 3
10/18/2022-10/19/2022	Grid Fault	Unplanned	17.81	WTG 1
10/18/2022-10/19/2022	Grid Fault	Unplanned	17.40	WTG 2
10/18/2022-10/19/2022	Grid Fault	Unplanned	17.68	WTG 3

F. Turbine Availability & Downtime

Availability	This Month	Year To Date
WTG 1	100.00%	99.95%
WTG 2	99.73%	99.59%
WTG 3	100.00%	99.65%
Avg	99.91%	99.73%

Downtime (hr)	This Month	Year To Date
WTG 1	27.88	184.55
WTG 2	45.92	226.10
WTG 3	25.26	195.19
Total	99.06	605.84

G. Wind Speed & Capacity Factor

Wind Speed (mph)	This Month	2022 Annual
WTG 1	14.36	13.05
WTG 2	14.20	12.86
WTG 3	14.66	13.17
Estimated	13.89	13.39

Capacity Factor (%)	This Month	2022 Annual
WTG 1	41.79%	34.25%
WTG 2	38.52%	32.78%
WTG 3	42.75%	33.58%
Low Estimate	25.82%	28.72%

H. Report Notes and Comments

* September 2022 production is lower than actual due to SCADA commuication issues.