




A. Site Energy Production Summary

	Energy Production (kWh)					
	Site		By Turbine			
	Expected Production	Actual Production	WTG A	WTG B	WTG C	
Oct-21	1,003,602	902,727	300,909	300,909	300,909	*
Nov-21	1,395,914	1,321,032	440,344	440,344	440,344	*
Dec-21	1,278,858	1,140,578	380,193	380,193	380,193	*
Jan-22	1,332,437	1,208,008	402,669	402,669	402,669	*
Feb-22	1,157,019	1,484,937	494,979	494,979	494,979	*
Mar-22	1,242,761	1,521,120	507,040	507,040	507,040	*
Apr-22	1,447,248	1,416,441	472,147	472,147	472,147	*
May-22	1,010,966	1,163,565	387,855	387,855	387,855	*
Jun-22	668,411	700,770	233,590	233,590	233,590	*
Jul-22	638,097	555,748	233,590	233,590	233,590	*
Aug-22	577,992	280,279	55,330	81,647	143,302	**
Sep-22	631,697	677,002	239,176	217,343	220,483	
Oct-22	1,003,602	1,496,092	512,714	497,365	486,013	
Production 2022 (ytd) (kWh)	9,710,228	10,503,963	3,539,091	3,528,226	3,581,669	
Total Production (kWh) (LTM)	12,384,999	12,965,573	4,359,627	4,348,762	4,402,205	
Capacity Factor (LTM)	32.89%					

B. Site Energy Production Graph

October-2022

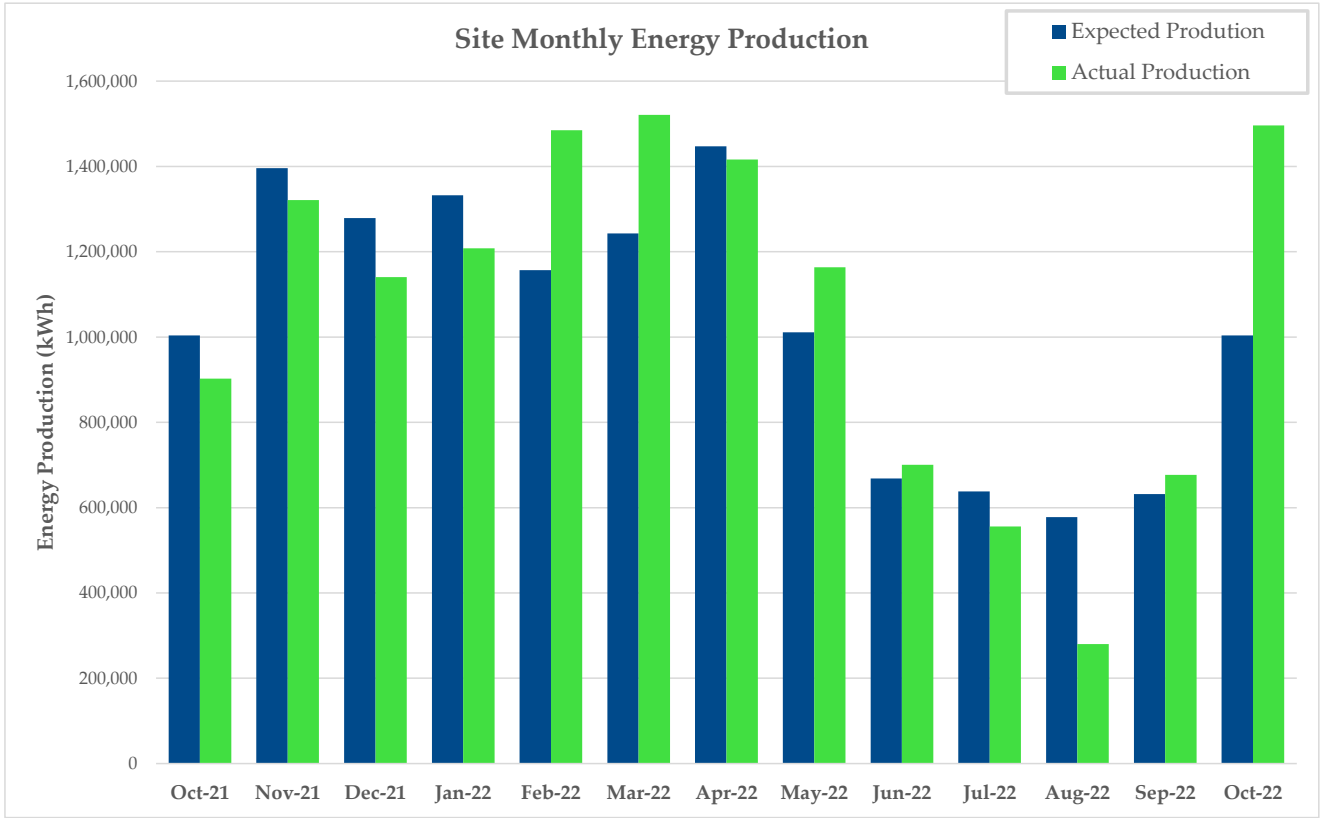

Monthly Report
October-2022

C. Safety Summary

	This Month	Project Cumulative
Recordable Incident(s)	0	0
Near Miss(es)	0	0

D. Planned Maintenance Events

Date	Event	Duration (hr)	Turbine
April-2023	Goldwind 10.5 Year Maintenance	~8	WTG A
April-2023	Goldwind 10.5 Year Maintenance	~8	WTG B
April-2023	Goldwind 10.5 Year Maintenance	~8	WTG C

E. Actual Maintenance Events

Date	Event	Planned/Unplanned	Duration (hrs)	Turbine
10/3/2022	Goldwind Generator Maintenance	Unplanned	3.07	WTGC
10/4/2022-10/5/2022	Turbine Fault	Unplanned	9.33	WTGC
10/29/2022-10/30/22	Turbine Fault	Unplanned	12.38	WTGC

F. Turbine Availability & Downtime

Availability	This Month	Year To Date
WTG A	100.00%	99.78%
WTG B	100.00%	99.14%
WTG C	97.08%	98.18%
Avg	99.03%	99.04%

Downtime (hr)	This Month	Year To Date
WTG A	0	11.63
WTG B	0	30.09
WTG C	24.78	122.13
Total	24.78	163.85

G. Wind Speed & Capacity Factor

Wind Speed (mph)	This Month	2022 Annual
WTG A	13.99	11.01
WTG B	13.73	10.60
WTG C	14.34	11.41
Estimated	13.89	13.39

Capacity Factor (%)	This Month	2022 Annual
WTG A	45.94%	24.37%
WTG B	44.57%	24.04%
WTG C	43.55%	25.66%
Low Estimate	25.82%	28.72%

H. Report Notes and Comments

*Production read from the meter due to communication issues and will be updated if SCADA data becomes available. Total metered production divided to estimate per turbine total.

** August 2022 production is lower than actual due to SCADA communication issues.