


A. Site Energy Production Summary

	Energy Production (kWh)				
	Site		By Turbine		
	P50 (Expected Production)	Actual Production	W1	W2	W3
Oct-21	990,000	693,360	241,616	219,829	231,915
Nov-21	1,123,000	976,482	349,225	311,053	316,204
Dec-21	1,153,000	1,088,213	372,080	354,578	361,555
Jan-22	1,306,000	845,320	315,868	177,718	351,734
Feb-22	1,137,000	1,182,964	407,437	382,881	392,646
Mar-22	1,134,000	1,341,048	444,624	443,527	452,897
Apr-22	1,176,000	1,079,664	374,895	351,597	353,172
May-22	927,000	861,830	293,507	271,102	297,221
Jun-22	634,000	512,159	167,043	167,623	177,493
Jul-22	527,000	418,863	139,334	134,326	145,203
Aug-22	449,000	347,940	115,055	112,651	120,234
Sep-22	610,000	457,923	158,634	147,583	151,706
Oct-22	990,000	1,055,135	352,633	347,490	355,012
Production 2022 (ytd) (kWh)	8,890,000	8,102,846	2,769,030	2,536,498	2,797,318
Total Production (kWh) (LTM)	11,166,000	10,167,541	3,490,335	3,202,129	3,475,077
Capacity Factor (LTM)	25.79%				

B. Site Energy Production Graph

October-2022

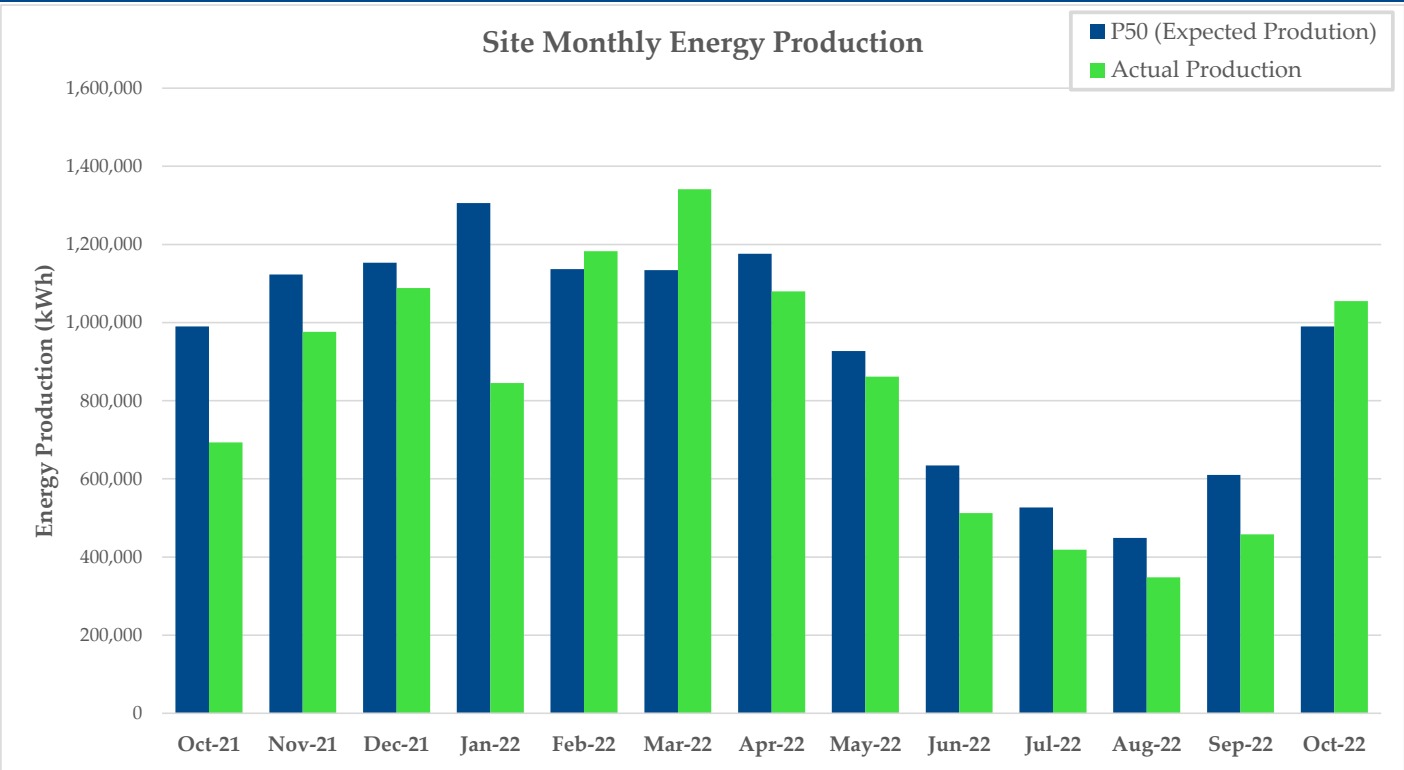

Monthly Report
October-2022

C. Safety Summary

	This Month	Project Cumulative
Recordable Incident(s)	0	0
First Aid	0	1

D. Planned Maintenance Events

Date	Event	Duration (hr)	Turbine
April-2023	Goldwind 5.5 Year Maintenance	~8	W1
April-2023	Goldwind 5.5 Year Maintenance	~8	W2
April-2023	Goldwind 5.5 Year Maintenance	~8	W3

E. Actual Maintenance Events

Date	Event	Planned/Unplanned	Duration (hrs)	Turbine
10/19/2022	Turbine Fault	Unplanned	5.85	W1
10/26/2022-10/27/2022	Goldwind 5 Year Maintenance	Planned	5.43	W1
10/27/2022	Goldwind 5 Year Maintenance	Planned	5.26	W2
10/27/2022	Goldwind 5 Year Maintenance	Planned	4.91	W3

F. Turbine Availability & Downtime

Availability	This Month	Year To Date
W1	98.35%	99.00%
W2	100.00%	99.77%
W3	100.00%	99.56%
Avg	99.45%	99.44%

Downtime (hr)	This Month	Year To Date
W1	17.73	326.09
W2	5.26	487.64
W3	5.74	288.16
Total	28.73	1101.89

G. Billed Data

Meter Reading (Date/Time)	10/21/2022 12:00 AM
Meter To Date Produced	45,366,592 kWh
Meter To Date Consumed	139,890 kWh
Last Reading Produced	44,431,620 kWh
Last Reading Consumed	138,633 kWh
Billed kWh	933,715 kWh
Next Meter Reading	11/21/2022 12:00 AM

H. Report Notes and Comments