




A. Site Energy Production Summary

	Energy Production (kWh)					
	Site		By Turbine			
	Expected Production	Actual Production	WTG A	WTG B	WTG C	
Dec-21	1,278,858	1,140,578	380,193	380,193	380,193	*
Jan-22	1,332,437	1,208,008	402,669	402,669	402,669	*
Feb-22	1,157,019	1,484,937	494,979	494,979	494,979	*
Mar-22	1,242,761	1,521,120	507,040	507,040	507,040	*
Apr-22	1,447,248	1,416,441	472,147	472,147	472,147	*
May-22	1,010,966	1,163,565	387,855	387,855	387,855	*
Jun-22	668,411	700,770	233,590	233,590	233,590	*
Jul-22	638,097	555,748	185,249	185,249	185,249	*
Aug-22	577,992	280,279	55,330	81,647	143,302	**
Sep-22	631,697	677,002	239,176	217,343	220,483	
Oct-22	1,003,602	1,496,092	512,714	497,365	486,013	
Nov-22	1,395,914	1,515,960	520,077	499,774	496,109	
Dec-22	1,278,858	1,462,265	467,266	514,480	480,519	
Production 2022 (ytd) (kWh)	12,384,999	13,482,188	4,478,093	4,494,139	4,509,956	
Total Production (kWh) (LTM)	12,384,999	13,482,188	4,478,093	4,494,139	4,509,956	
Capacity Factor (LTM)	34.20%					

B. Site Energy Production Graph

December-2022

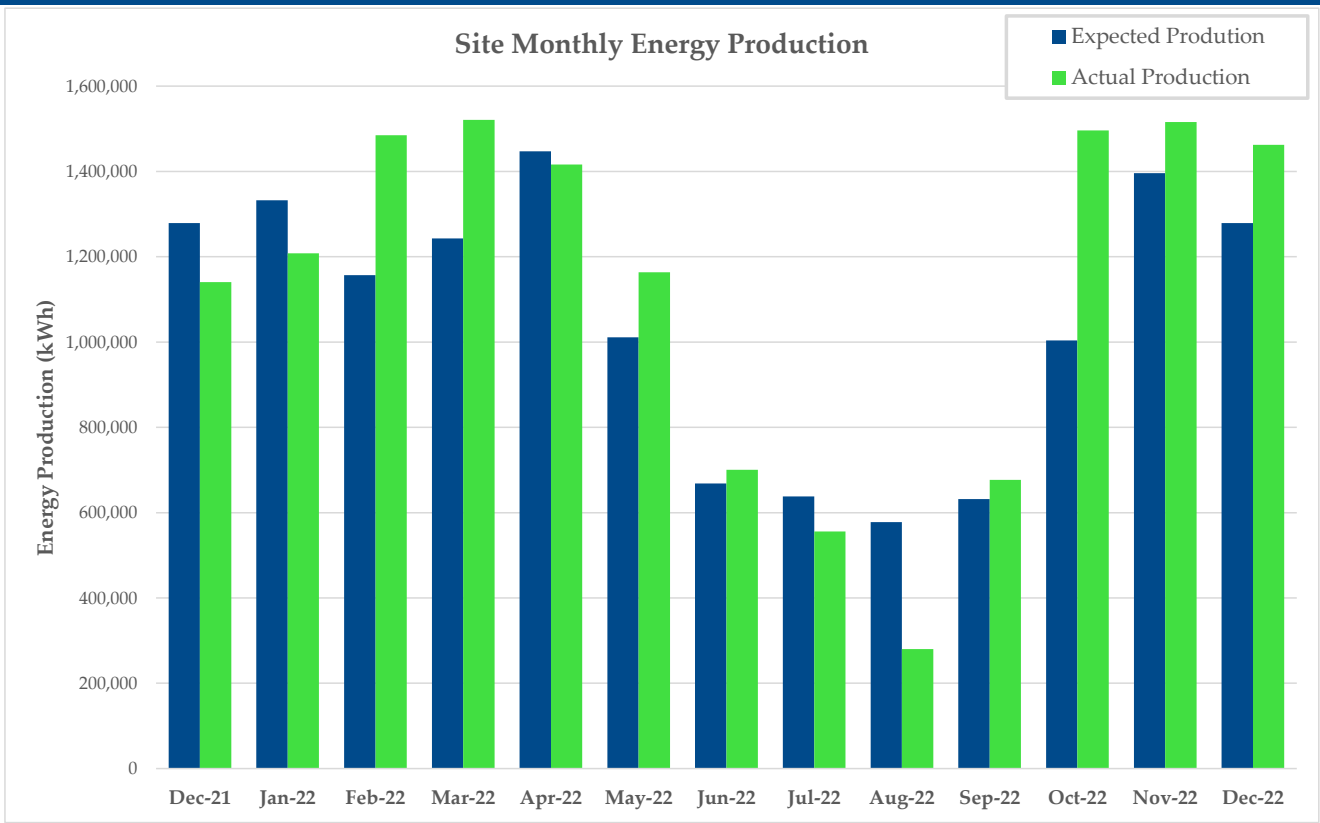

C. Safety Summary

	This Month	Project Cumulative
Recordable Incident(s)	0	0
Near Miss(es)	0	0

D. Planned Maintenance Events

Date	Event	Duration (hr)	Turbine
April-2023	Goldwind 10.5 Year Maintenance	~8	WTG A
April-2023	Goldwind 10.5 Year Maintenance	~8	WTG B
April-2023	Goldwind 10.5 Year Maintenance	~8	WTG C

E. Actual Maintenance Events

Date	Event	Planned/Unplanned	Duration (hrs)	Turbine
12/7/2022	Turbine Fault	Unplanned	4.61	WTG C
12/12/2022	Turbine Maintenance	Unplanned	6.57	WTG C
12/16/2022-12-18/2022	Turbine Fault	Unplanned	52.60	WTG A
12/23/2022	Turbine Fault	Unplanned	9.62	WTG C
12/28/2022-12/29/2022	Turbine Fault	Unplanned	17.70	WTG C

F. Turbine Availability & Downtime

Availability	This Month	Year To Date
WTG A	92.93%	98.12%
WTG B	100.00%	99.57%
WTG C	95.24%	97.49%
Avg	96.06%	98.39%

Downtime (hr)	This Month	Year To Date
WTG A	56.22	67.85
WTG B	0	30.09
WTG C	42	176.07
Total	98.22	274.01

G. Wind Speed & Capacity Factor

Wind Speed (mph)	This Month	2022 Annual
WTG A	14.21	12.43
WTG B	13.96	12.01
WTG C	14.69	12.87
Estimated	14.23	13.39

Capacity Factor (%)	This Month	2022 Annual
WTG A	41.87%	32.58%
WTG B	46.10%	32.87%
WTG C	43.06%	33.16%
Low Estimate	37.80%	28.72%

H. Report Notes and Comments

*Production read from the meter due to communication issues and will be updated if SCADA data becomes available. Total metered production divided to estimate per turbine total.

** August 2022 production is lower than actual due to SCADA communication issues.