


A. Site Energy Production Summary

	Energy Production (kWh)				
	Site		By Turbine		
	Expected Production	Actual Production	WTG 1	WTG 2	WTG 3
Feb-22	1,170,349	1,604,544	545,081	532,075	527,388
Mar-22	1,227,217	1,638,719	558,009	535,925	544,785
Apr-22	1,438,497	1,509,431	506,692	498,089	504,650
May-22	980,450	1,209,327	409,133	403,329	396,865
Jun-22	649,158	765,507	272,227	239,819	253,461
Jul-22	618,687	617,049	214,843	198,590	203,616
Aug-22	559,508	531,092	179,942	168,860	182,290
Sep-22	603,085	395,973	133,364	128,586	134,023
Oct-22	967,926	1,373,420	466,421	429,871	477,128
Nov-22	1,362,692	1,568,093	527,267	521,360	519,466
Dec-22	1,254,397	1,487,190	491,635	498,005	497,550
Jan-23	1,290,968	1,253,314	423,857	413,023	416,434
Feb-23	1,170,349	1,453,948	522,598	439,412	491,938
Production 2023 (ytd) (kWh)	2,461,317	2,707,262	946,455	852,435	908,372
Total Production (LTM) (kWh)	12,122,935	13,803,063	4,705,988	4,474,869	4,622,206
Capacity Factor (LTM)	35.02%				

B. Site Energy Production Graph

February-2023

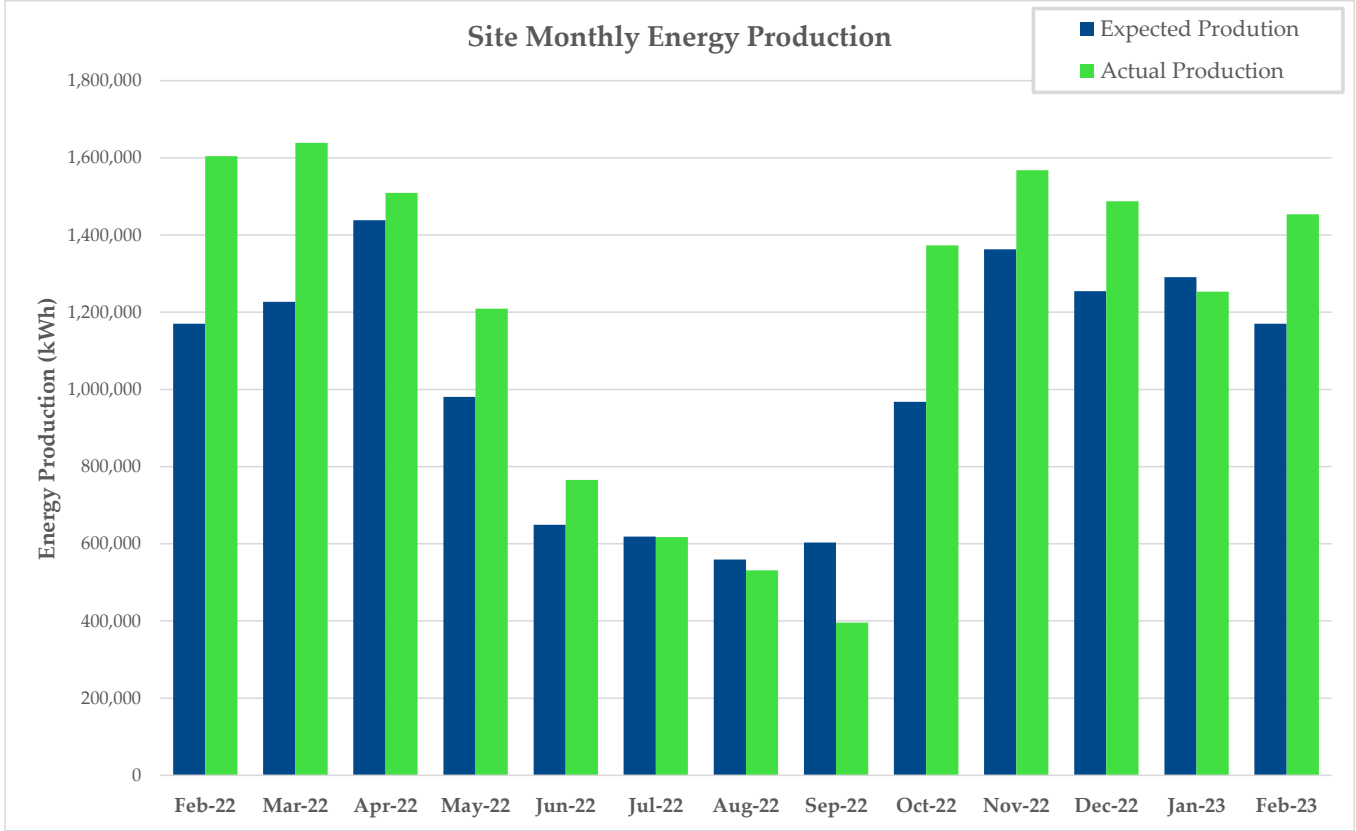

C. Safety Summary

	This Month	Project Cumulative
Recordable Incident(s)	0	0
Near Miss(es)	0	0

D. Planned Maintenance Events

Date	Event	Duration (hr)	Turbine
April-2023	10.5 Year Maintenance	~8	WTG 1
April-2023	10.5 Year Maintenance	~8	WTG 2
April-2023	10.5 Year Maintenance	~8	WTG 3

E. Actual Maintenance Events

Date	Event	Planned/Unplanned	Duration (hrs)	Turbine
2/5/2023-2/8/2023	Turbine Fault	Unplanned	69.73	WTG 2

F. Turbine Availability & Downtime**

Availability	This Month	Year To Date
WTG 1	100.00%	99.99%
WTG 2	100.00%	100.00%
WTG 3	100.00%	99.97%
Avg	100.00%	99.99%

Downtime (hr)	This Month	Year To Date
WTG 1	2.75	11.45
WTG 2	69.73	78.35
WTG 3		8.97
Total	72.48	98.77

G. Wind Speed & Capacity Factor

Wind Speed (mph)	This Month	2022 Annual
WTG 1	15.48	14.13
WTG 2	15.28	14.01
WTG 3	15.52	14.23
Estimated	17.02	13.39

Capacity Factor (%)	This Month	2022 Annual
WTG 1	51.85%	44.56%
WTG 2	43.59%	40.13%
WTG 3	48.80%	42.77%
Low Estimate	29.98%	28.72%

H. Report Notes and Comments

* September 2022 production is lower than actual due to SCADA communication issues.

**Due to expiration of the OEM warranty, turbine availability and downtime reporting will no longer include warranted availability. Downtime will be categorized appropriately. One Energy will update future reports to reflect this change.