


A. Site Energy Production Summary

	Energy Production (kWh)					*
	Site		By Turbine			
	P50 (Expected Production)	Actual Production	Z4	Z5	Z6	
Mar-22	1,119,000	1,335,480	443,031	438,839	453,610	
Apr-22	1,116,000	1,145,744	373,811	368,393	403,540	
May-22	876,000	984,712	298,460	333,446	352,806	
Jun-22	637,000	601,888	194,009	193,281	214,598	
Jul-22	518,000	586,264	192,973	189,924	203,367	
Aug-22	448,000	459,360	146,939	148,700	163,721	
Sep-22	617,000	570,590	183,735	188,215	198,640	
Oct-22	956,000	1,192,941	388,447	392,826	411,668	
Nov-22	1,107,000	1,354,289	454,608	437,415	462,266	
Dec-22	1,098,000	1,315,996	439,576	434,277	442,143	
Jan-23	1,251,000	1,037,565	340,000	345,558	352,007	
Feb-23	1,044,000	1,259,079	420,192	393,112	445,775	
Mar-23	1,119,000	1,327,802	443,370	431,527	452,905	
Production 2022 (ytd) (kWh)	3,414,000	3,624,446	1,203,562	1,170,197	1,250,687	
Total Production (kWh) (LTM)	10,787,000	11,836,230	3,876,120	3,856,674	4,103,436	
Capacity Factor (LTM)	30.03%					

B. Site Energy Production Graph

March-2023

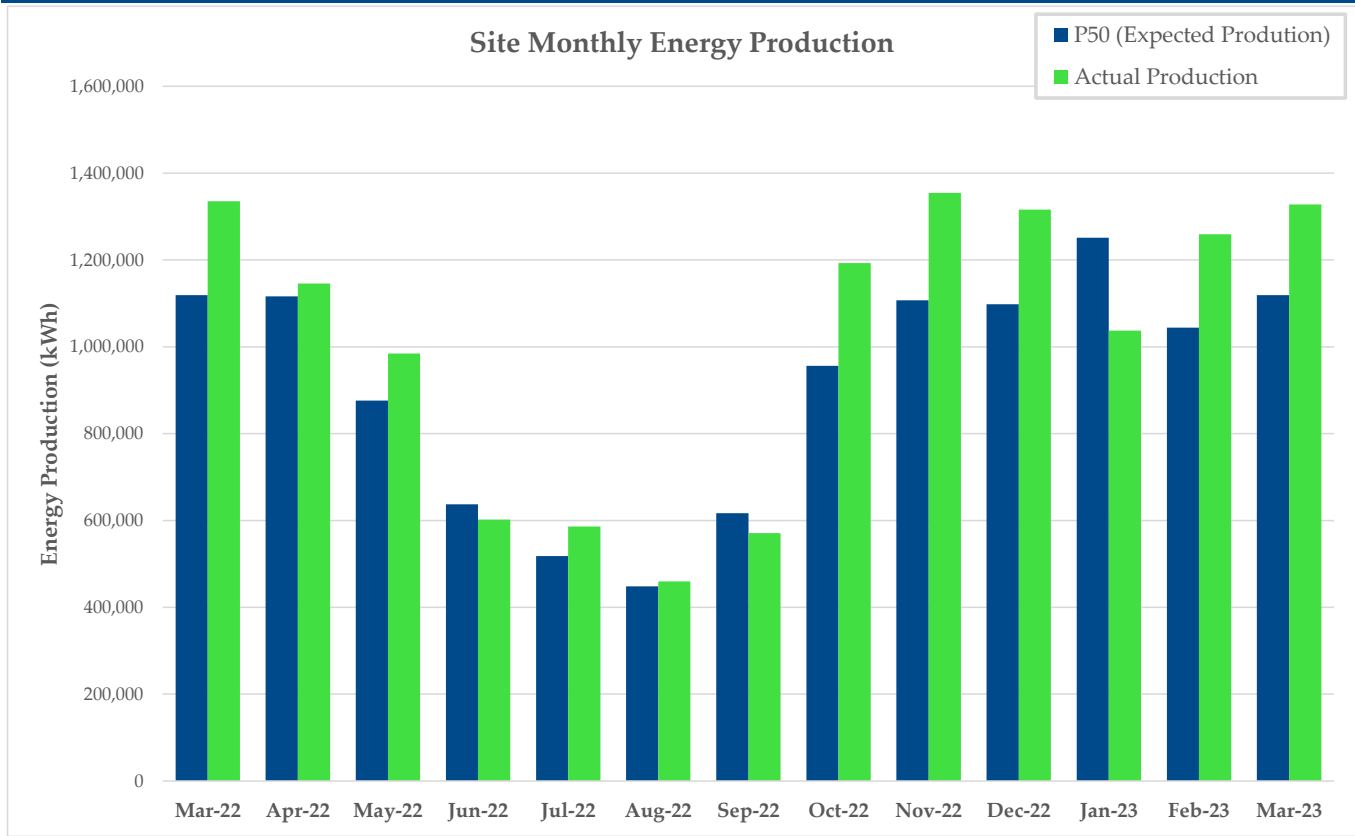

Monthly Report
March-2023



C. Safety Summary

	This Month	Project Cumulative
Recordable Incident(s)	0	0
First Aid	0	1

D. Planned Maintenance Events

Date	Event	Duration (hr)	Turbine
Septemeber-2023	Goldwind 3 Year Maintenance	~15	Z4
Septemeber-2023	Goldwind 3 Year Maintenance	~15	Z5
Septemeber-2023	Goldwind 3 Year Maintenance	~15	Z6

E. Actual Maintenance Events

Date	Event	Planned/Unplanned	Duration (hrs)	Turbine
3/13/2023	Turbine Fault	Unplanned	5.50	Z5
3/26/2023-3/27/2023	Turbine Fault	Unplanned	23.90	Z5
3/14/2023	Goldwind 2.5 Year Maintenance	Planned	2.32	Z4
3/15/2023	Goldwind 2.5 Year Maintenance	Planned	2.97	Z5
3/22/2023	Goldwind 2.5 Year Maintenance	Planned	3.09	Z6

F. Turbine Availability & Downtime

Availability	This Month	Year To Date
Z4	100.00%	100.00%
Z5	96.05%	95.55%
Z6	99.96%	99.99%
Avg	98.67%	98.51%

Downtime (hr)	This Month	Year To Date
Z4	7.05	31.92
Z5	37.11	126.62
Z6	6.44	31.31
Total	50.60	189.85

G. Billed Data

Meter Reading (Date/Time)	3/21/2023 12:00 AM
Ball 2.0 Production (This Period)	1,341,544 kWh
Ball 2.0 Consumption (This Period)	1,864 kWh
Billed kWh	1,339,680 kWh
Next Meter Reading	4/20/2023 12:00 AM

H. Report Notes and Comments

*March 2022 production includes estimates due to a SCADA server error.