


A. Site Energy Production Summary

	Energy Production (kWh)				
	Site		By Turbine		
	P50 (Expected Production)	Actual Production	Z4	Z5	Z6
Jun-22	637,000	601,888	194,009	193,281	214,598
Jul-22	518,000	586,264	192,973	189,924	203,367
Aug-22	448,000	459,360	146,939	148,700	163,721
Sep-22	617,000	570,590	183,735	188,215	198,640
Oct-22	956,000	1,192,941	388,447	392,826	411,668
Nov-22	1,107,000	1,354,289	454,608	437,415	462,266
Dec-22	1,098,000	1,315,996	439,576	434,277	442,143
Jan-23	1,251,000	1,037,565	340,000	345,558	352,007
Feb-23	1,044,000	1,259,079	420,192	393,112	445,775
Mar-23	1,119,000	1,327,802	443,370	431,527	452,905
Apr-23	1,116,000	979,332	324,138	323,000	332,194
May-23	876,000	854,422	270,909	283,285	300,228
Jun-23	637,000	690,482	226,931	231,165	232,387
Production 2022 (ytd) (kWh)	6,043,000	6,148,682	2,025,540	2,007,647	2,115,496
Total Production (kWh) (LTM)	10,787,000	11,628,122	3,831,818	3,799,004	3,997,301
Capacity Factor (LTM)	29.50%				

B. Site Energy Production Graph

June-2023

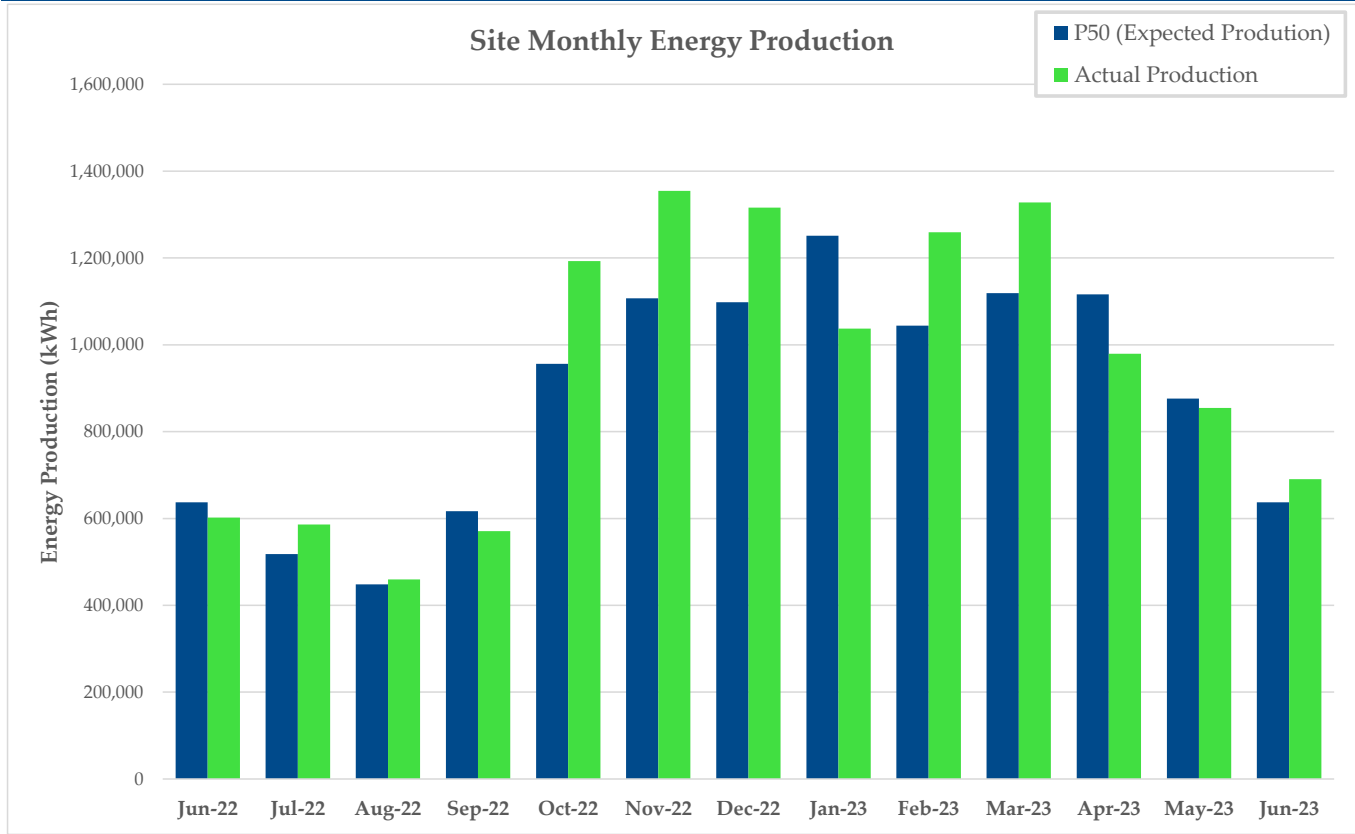

Monthly Report
June-2023

C. Safety Summary

	This Month	Project Cumulative
Recordable Incident(s)	0	0
First Aid	0	1

D. Planned Maintenance Events

Date	Event	Duration (hr)	Turbine
September-2023	Goldwind 3 Year Maintenance	~15	Z4
September-2023	Goldwind 3 Year Maintenance	~15	Z5
September-2023	Goldwind 3 Year Maintenance	~15	Z6

E. Actual Maintenance Events

Date	Event	Planned/Unplanned	Duration (hrs)	Turbine
------	-------	-------------------	----------------	---------

F. Turbine Availability & Downtime

Availability	This Month	Year To Date
Z4	100.00%	100.00%
Z5	99.32%	97.59%
Z6	100.00%	99.99%
Avg	99.77%	99.20%

Downtime (hr)	This Month	Year To Date
Z4	0.46	67.55
Z5	5.39	175.78
Z6	0.46	67.25
Total	6.31	310.58

G. Billed Data

Meter Reading (Date/Time)	6/20/2023 12:00 AM
Ball 2.0 Production (This Period)	719,392 kWh
Ball 2.0 Consumption (This Period)	2,923 kWh
Billed kWh	716,469 kWh
Next Meter Reading	7/20/2023 12:00 AM

H. Report Notes and Comments

*June 23 - June 25 Production is an estimate due to a SCADA server error.