


A. Site Energy Production Summary

	Energy Production (kWh)				
	Site		By Turbine		
	P50 (Expected Production)	Actual Production	Z4	Z5	Z6
Jul-22	518,000	586,264	192,973	189,924	203,367
Aug-22	448,000	459,360	146,939	148,700	163,721
Sep-22	617,000	570,590	183,735	188,215	198,640
Oct-22	956,000	1,192,941	388,447	392,826	411,668
Nov-22	1,107,000	1,354,289	454,608	437,415	462,266
Dec-22	1,098,000	1,315,996	439,576	434,277	442,143
Jan-23	1,251,000	1,037,565	340,000	345,558	352,007
Feb-23	1,044,000	1,259,079	420,192	393,112	445,775
Mar-23	1,119,000	1,327,802	443,370	431,527	452,905
Apr-23	1,116,000	979,332	324,138	323,000	332,194
May-23	876,000	854,422	270,909	283,285	300,228
Jun-23	637,000	690,482	226,931	231,165	232,387
Jul-23	518,000	381,255	124,683	125,868	130,704
Production 2022 (ytd) (kWh)	6,561,000	6,529,937	2,150,223	2,133,515	2,246,200
Total Production (kWh) (LTM)	10,787,000	11,423,113	3,763,528	3,734,948	3,924,638
Capacity Factor (LTM)	28.98%				

B. Site Energy Production Graph

July-2023

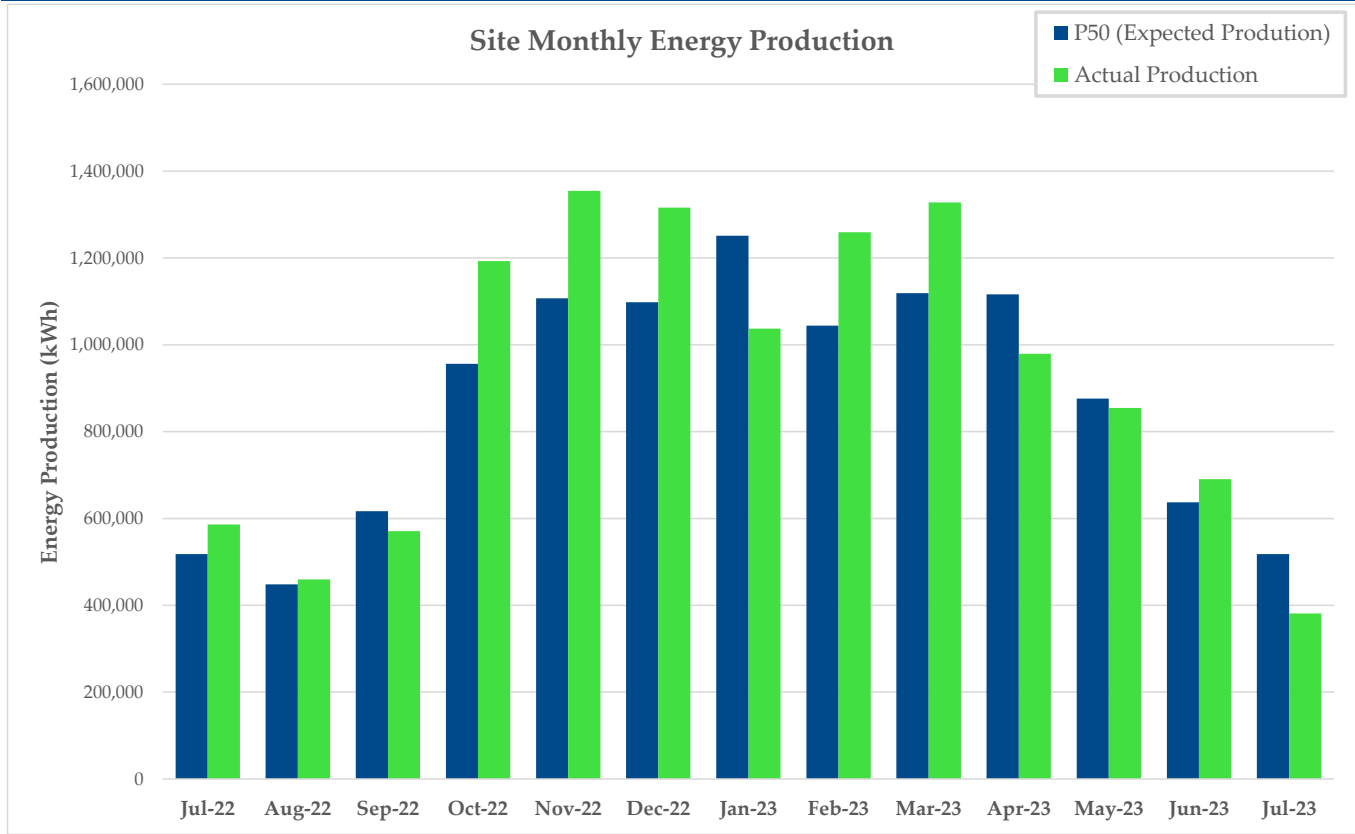

Monthly Report
July-2023

C. Safety Summary

	This Month	Project Cumulative
Recordable Incident(s)	0	0
First Aid	0	1

D. Planned Maintenance Events

Date	Event	Duration (hr)	Turbine
September-2023	Goldwind 3 Year Maintenance	~15	Z4
September-2023	Goldwind 3 Year Maintenance	~15	Z5
September-2023	Goldwind 3 Year Maintenance	~15	Z6

E. Actual Maintenance Events

Date	Event	Planned/Unplanned	Duration (hrs)	Turbine
------	-------	-------------------	----------------	---------

F. Turbine Availability & Downtime

Availability	This Month	Year To Date
Z4	99.89%	99.98%
Z5	99.97%	97.93%
Z6	100.00%	99.99%
Avg	99.95%	99.30%

Downtime (hr)	This Month	Year To Date
Z4	5.12	72.67
Z5	5.55	181.33
Z6	4.29	71.54
Total	14.96	325.54

G. Billed Data

Meter Reading (Date/Time)	7/20/2023 12:00 AM
Ball 2.0 Production (This Period)	482,537 kWh
Ball 2.0 Consumption (This Period)	4,314 kWh
Billed kWh	478,223 kWh
Next Meter Reading	8/18/2023 12:00 AM

H. Report Notes and Comments

*June 23 - June 25 Production is an estimate due to a SCADA server error.