


A. Site Energy Production Summary

	Energy Production (kWh)				
	Site		By Turbine		
	P50 (Expected Production)	Actual Production	WG1	WG2	WG3
Aug-22	514,000	462,848	160,121	151,764	150,963
Sep-22	716,000	611,606	217,120	197,200	197,286
Oct-22	1,051,000	1,275,567	446,816	420,408	408,343
Nov-22	1,224,000	1,260,789	450,647	410,211	399,931
Dec-22	1,217,000	1,186,817	407,671	389,062	390,084
Jan-23	1,343,000	1,022,726	364,829	333,353	324,544
Feb-23	1,133,000	1,357,316	469,593	443,298	444,425
Mar-23	1,312,000	1,397,327	483,104	451,227	462,996
Apr-23	1,272,000	971,079	347,951	314,716	308,412
May-23	974,000	666,913	244,432	206,831	215,650
Jun-23	714,000	586,809	200,667	193,800	192,342
Jul-23	566,000	447,128	154,258	148,599	144,271
Aug-23	514,000	508,391	179,206	161,643	167,542
Production 2023 (ytd) (kWh)	7,828,000	6,957,689	2,444,040	2,253,467	2,260,182
Total Production (kWh) (LTM)	12,036,000	11,292,468	3,966,294	3,670,348	3,655,826
Capacity Factor (LTM)	28.65%				

B. Site Energy Production Graph

August-2023

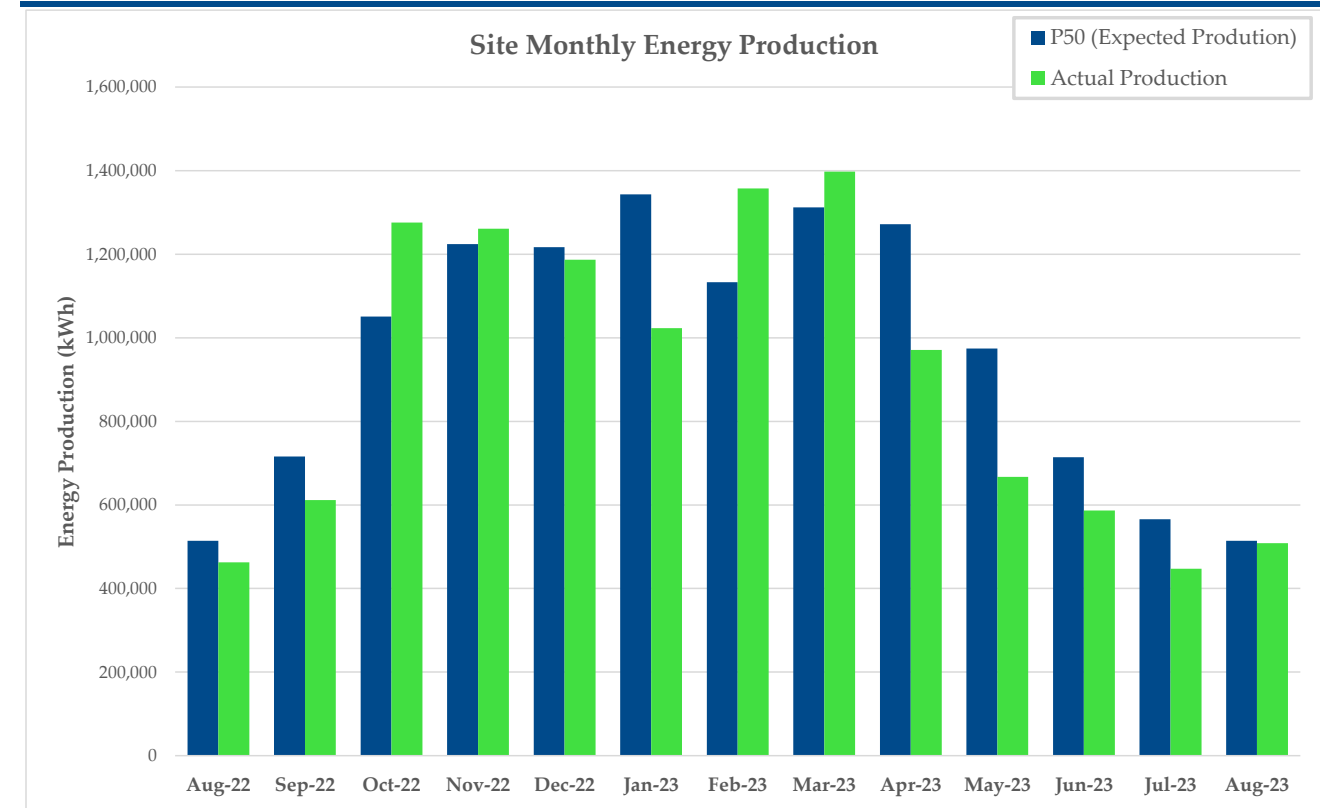

C. Safety Summary

	This Month	Project Cumulative
Recordable Incident(s)	0	0
First Aid	0	0

D. Planned Maintenance Events

Date	Event	Duration (hr)	Turbine
November-2023	Goldwind 5 Year Maintenance	~15	WG 1
November-2023	Goldwind 5 Year Maintenance	~15	WG 2
November-2023	Goldwind 5 Year Maintenance	~15	WG 3

E. Actual Maintenance Events

Date	Event	Planned/Unplanned	Duration (hrs)	Turbine
8/4/2023-8/5/2023	Turbine Fault	Unplanned	23.48	WTG 2

F. Turbine Availability & Downtime

Availability	This Month	Year To Date
WG1	100.00%	99.99%
WG2	96.84%	99.14%
WG3	99.99%	98.45%
Avg	98.94%	99.20%

Downtime (hr)	This Month	Year To Date
WG1	-	67.40
WG2	23.51	113.89
WG3	0.10	140.81
Total	23.61	322.10

G. Billed Data

Meter Reading (Date/Time)	8/29/2023 12:00 AM
Meter To Date Produced	52,497,802 kWh
Meter To Date Consumed	192,266 kWh
Last Reading Produced	52,002,371 kWh
Last Reading Consumed	186,951 kWh
Billed kWh	490,116 kWh
Next Meter Reading	9/29/2023 12:00 AM

H. Report Notes and Comments