


A. Site Energy Production Summary

	Energy Production (kWh)				
	Site		By Turbine		
	P50 (Expected Production)	Actual Production	WG1	WG2	WG3
Dec-22	1,217,000	1,186,817	407,671	389,062	390,084
Jan-23	1,343,000	1,022,726	364,829	333,353	324,544
Feb-23	1,133,000	1,357,316	469,593	443,298	444,425
Mar-23	1,312,000	1,397,327	483,104	451,227	462,996
Apr-23	1,272,000	971,079	347,951	314,716	308,412
May-23	974,000	666,913	244,432	206,831	215,650
Jun-23	714,000	586,809	200,667	193,800	192,342
Jul-23	566,000	447,128	154,258	148,599	144,271
Aug-23	514,000	508,391	179,206	161,643	167,542
Sep-23	716,000	353,349	120,898	111,723	120,728
Oct-23	1,051,000	833,613	294,717	274,789	264,107
Nov-23	1,224,000	1,145,351	403,047	369,056	373,248
Dec-23	1,217,000	968,195	337,648	315,435	315,112
Production 2023 (ytd) (kWh)	12,036,000	10,258,197	3,600,350	3,324,470	3,333,377
Total Production (LTM) (kWh)	12,036,000	10,258,197	3,600,350	3,324,470	3,333,377
Capacity Factor (LTM)	26.02%				

B. Site Energy Production Graph

December-2023

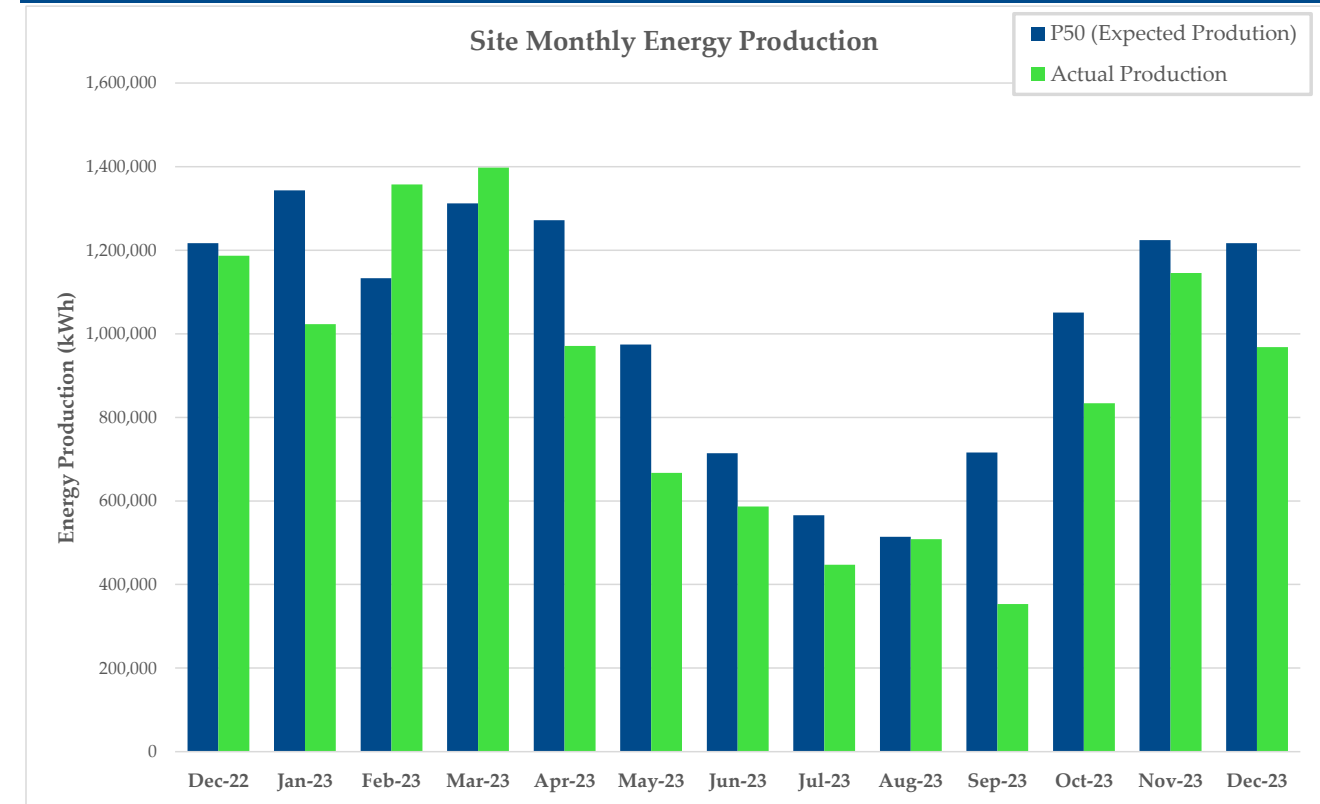

C. Safety Summary

	This Month	Project Cumulative
Recordable Incident(s)	0	0
First Aid	0	0

D. Planned Maintenance Events

Date	Event	Duration (hr)	Turbine
June-2024	5.5 Year Maintenance	~8	WG 1
June-2024	5.5 Year Maintenance	~8	WG 2
June-2024	5.5 Year Maintenance	~8	WG 3

E. Actual Maintenance Events

Date	Event	Planned/Unplanned	Duration (hrs)	Turbine
12/14/2023	5 Year Maintenance	Planned	2.00	WG 1
12/14/2023	5 Year Maintenance	Planned	2.00	WG 2
12/14/2023	5 Year Maintenance	Planned	2.32	WG 3
12/14/2024	Turbine Fault	Unplanned	5.14	WG 1
12/14/2023-12/15/2023	Turbine Fault	Unplanned	21.65	WG 2

F. Turbine Availability & Downtime*

Availability	This Month	Year To Date
WG1	100.00%	100.00%
WG2	100.00%	99.43%
WG3	100.00%	98.71%
Avg	100.00%	99.38%

Downtime (hr)	This Month	Year To Date
WG1	10.56	84.70
WG2	23.65	142.77
WG3	4.84	174.19
Total	39.05	401.66

G. Billed Data

Meter Reading (Date/Time)	12/29/2023 12:00 AM
Meter To Date Produced	55,750,232 kWh
Meter To Date Consumed	203,009 kWh
Last Reading Produced	54,716,367 kWh
Last Reading Consumed	201,223 kWh
Billed kWh	1,032,079 kWh
Next Meter Reading	1/29/2024 12:00 AM

H. Report Notes and Comments

* Due to expiration of the OEM warranty, turbine availability and downtime reporting will no longer include warrantied availability. Downtime will be categorized appropriately.